
HENDRIX

CERTIFIED TEST REPORT NUMBER 30011
INSULATED POWER CABLE RATED 5 TO 35 KV

PURCHASER	**Shealy Electrical Wholesalers**
PURCHASER'S ORDER #	**1260140-00**
PURCHASER'S SPECIFICATION #	**ICEA 649**
PURCHASER'S PART #	**U015K0010A-0045**
CABLE DESCRIPTION	**1/0 AWG 19X FS Al 15kV 0.175 TRXLP EZ 16 #14BC FN LLDPE 1C**
CABLE QUANTITY	**54576 Ft**
NUMBER OF REELS	**17**
SHIPMENT LOAD ID	**00030389**
OUR ORDER NUMBER	**027340**
REPORT DATE	**December 17th, 2010**

CERTIFICATION OF TESTS

Gordon D. Estabrook Jr. Mgr. QA & Prod. Eng.
Typewritten Name and Title

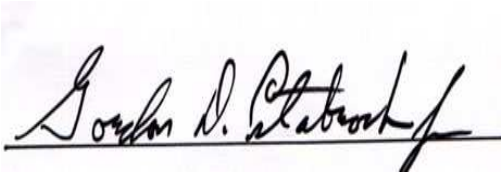

kef

Plan 100%		
Reel #	Spark (KV)	DC Resistance 1K 25 (O1K)
Specs		Max=.171
LN5BGA01	Pass	.1680
LN5BGA02	Pass	.1680
LN5BGA03	Pass	.1680
LN5BGA04	Pass	.1680
LN5BGA05	Pass	.1680
LN5BGA06	Pass	.1680
LN5BGA07	Pass	.1680

Plan A						
Reel #	Cond Reel Number	Conductor Diameter (In)	Void & Contaminant	Ins OD (In)	IS OD (In)	Hot Oil
Specs		Min=.3548 Max=.3692		Min=.740 Max=.800	Min=.800 Max=.900	
3CNL01	E1AZV03	.3580	Pass	.745	.820	Pass
3CNL06	E3AUZ06	.3570	Pass	.747	.815	Pass
3CNL07	E1BAB10	.3570	Pass	.743	.815	Pass
3CNL13	E1BAB07	.3562	Pass	.760	.820	Pass
3CNL22	E3AVB03	.3560	Pass	.750	.819	Pass
3CNL23	E1AZY07	.3570	Pass	.751	.822	Pass
3CNL24	E1AZY07	.3570	Pass	.755	.845	Pass

Plan B&C RunID# = CV3-01/19/09-1											
Reel #	Hot Creep Elong (%)	Hot Creep Set (%)	Strip side 1 (Lbs)	Strip side 2 (Lbs)	Wafer Boil	Waterblock (psi)	Shrinkback (In)	Tensile Unaged Insulation (psi)	Tensile Aged Insulation (%)	Elongation Unaged Insulation (%)	Elongation Aged Insulation (%)
Specs	Max=175	Max=10	Min=3 Max=12	Min=3 Max=12		Min=5	Max=.020	Min=1800	Min=75	Min=250	Min=75
3CNL01	59.00	.00	12.0	12.0	Pass	5	.007	1950	116	430	113
3CNL01S					Pass	5					
3CNL02						5					
3CNL03						5	.005				
3CNL04						5					
3CNL05						5					
3CNL06						5					
3CNL07					Pass	5					
3CNL08					Pass	5	.005				
3CNL09						5					
3CNL10						5		1980	129	460	104
3CNL11						5					
3CNL12					Pass	5					
3CNL13						5	.006				
3CNL14						5					
3CNL15						5					
3CNL16						5					
3CNL17						5					
3CNL18	60.00	.00	12.0	12.0	Pass	5		2120	113	460	97
3CNL19					Pass	5					
3CNL19S					Pass	5	.007				
3CNL21						5					
3CNL22						5					
3CNL23						5	.005				
3CNL24						5					
3CNM01					Pass		.006				
3CNM02						5		2110	109	400	112
3CNM03						5	.004				
3CNM04						5					
3CNM05					Pass	5	.006	1960	132	400	110
3CNM06						5					
3CNM07						5					
3CNM08					Pass	5	.008				
3CNM09	69.00	.00	15.0	14.0	Pass			1890	125	440	102
3CNM11						5					
3CNM12	71.00	.00	14.0	14.0	Pass			1950	127	460	102

Plan D RunID# = LN5-01/28/09-1		
Reel #	Neutral Indent (In)	
Specs	Max=.015	
LN5BFZ01	.008	
LN5BGA01	.009	
LN5BGA02	.009	
LN5BGA03	.009	
LN5BGA04	.009	
LN5BGA05	.009	

Plan E1					
Reel #	SS Wall 1 (In)	SS Wall 2 (In)	SS Wall 3 (In)	SS Wall 4 (In)	SS Wall Average (In)
Specs	Min=.012	Min=.012	Min=.012	Min=.012	Min=.012
3CNL01	.016	.017	.018	.018	.0173
3CNL02	.014	.016	.017	.018	.0163
3CNL03	.014	.015	.015	.017	.0153
3CNL04	.014	.015	.016	.016	.0153
3CNL05	.016	.016	.017	.018	.0168
3CNL06	.013	.015	.016	.017	.0153
3CNL07	.014	.015	.016	.016	.0153
3CNL08	.015	.016	.017	.017	.0163
3CNL09	.016	.016	.017	.018	.0168
3CNL10	.017	.017	.017	.018	.0173
3CNL11	.015	.016	.016	.017	.0160
3CNL12	.015	.016	.018	.019	.0170
3CNL13	.015	.016	.017	.018	.0165
3CNL14	.015	.017	.017	.018	.0168
3CNL15	.014	.015	.016	.017	.0155
3CNL16	.015	.017	.017	.018	.0168
3CNL19	.015	.016	.016	.017	.0160
3CNL21	.015	.015	.016	.016	.0155
3CNL22	.016	.017	.017	.018	.0170
3CNL23	.015	.015	.015	.016	.0153
3CNL24	.014	.016	.017	.018	.0163

Plan E2					
Reel #	Ins Wall 1 (In)	Ins Wall 2 (In)	Ins Wall 3 (In)	Ins Wall 4 (In)	Ins Wall Average (In)
Specs	Min=.165 Max=.205	Min=.165 Max=.205	Min=.165 Max=.205	Min=.165 Max=.205	Min=.165 Max=.205
3CNL01	.178	.183	.183	.189	.1833
3CNL02	.174	.174	.186	.188	.1805
3CNL03	.173	.176	.187	.188	.1810
3CNL04	.174	.182	.184	.192	.1830
3CNL05	.176	.177	.191	.191	.1838
3CNL06	.170	.173	.179	.184	.1765
3CNL07	.173	.174	.186	.186	.1798
3CNL08	.177	.181	.187	.190	.1838
3CNL09	.178	.187	.188	.195	.1870
3CNL10	.178	.180	.190	.191	.1848
3CNL11	.179	.182	.182	.192	.1838
3CNL12	.172	.172	.185	.186	.1788
3CNL13	.172	.177	.186	.192	.1818
3CNL14	.168	.178	.181	.191	.1795
3CNL15	.170	.178	.192	.196	.1840
3CNL16	.169	.174	.190	.198	.1828
3CNL19	.175	.176	.185	.187	.1808
3CNL21	.177	.178	.183	.188	.1815
3CNL22	.173	.176	.185	.187	.1803
3CNL23	.174	.174	.187	.188	.1808
3CNL24	.187	.188	.194	.201	.1925

Plan E3					
Reel #	IS Wall 1 (In)	IS Wall 2 (In)	IS Wall 3 (In)	IS Wall 4 (In)	IS Wall Average (In)
Specs	Min=.030 Max=.060	Min=.030 Max=.060	Min=.030 Max=.060	Min=.030 Max=.060	Min=.030 Max=.060
3CNL01	.033	.034	.036	.036	.0348
3CNL02	.031	.032	.033	.033	.0323
3CNL03	.032	.032	.033	.034	.0328
3CNL04	.035	.035	.036	.036	.0355
3CNL05	.032	.034	.034	.035	.0338
3CNL06	.033	.034	.034	.036	.0343
3CNL07	.033	.034	.034	.035	.0340
3CNL08	.033	.034	.035	.035	.0343
3CNL09	.034	.035	.036	.036	.0353
3CNL10	.033	.034	.034	.035	.0340
3CNL11	.033	.033	.035	.035	.0340
3CNL12	.031	.031	.032	.033	.0318
3CNL13	.033	.035	.035	.036	.0348
3CNL14	.034	.034	.034	.035	.0343
3CNL15	.033	.034	.035	.037	.0348
3CNL16	.033	.034	.035	.036	.0345
3CNL19	.033	.033	.035	.036	.0343
3CNL21	.032	.033	.034	.036	.0338
3CNL22	.032	.033	.033	.035	.0333
3CNL23	.035	.035	.036	.036	.0355
3CNL24	.032	.034	.035	.035	.0340

Plan E4		
Reel #	Wire Size - Min (In)	Wire Size - Avg (In)
Specs	Min=.0609	Min=.0635
LN5BGA01	.0635	.0648
LN5BGA02	.0635	.0646
LN5BGA03	.0636	.0646
LN5BGA04	.0637	.0646
LN5BGA05	.0635	.0647
LN5BGA06	.0637	.0647
LN5BGA07	.0635	.0648

Plan E5					
Reel #	Jacket Wall 1 (In)	Jacket Wall 2 (In)	Jacket Wall 3 (In)	Jacket Wall 4 (In)	PriorTag
Specs	Min=.045 Max=.080	Min=.045 Max=.080	Min=.045 Max=.080	Min=.045 Max=.080	
LN5BGA01	.058	.054	.057	.052	3CNL07
LN5BGA02	.050	.054	.051	.057	3CNL24
LN5BGA03	.053	.056	.055	.058	3CNL01
LN5BGA04	.064	.052	.056	.058	3CNL13
LN5BGA05	.059	.057	.052	.056	3CNL23
LN5BGA06	.057	.053	.056	.059	3CNL06
LN5BGA07	.055	.057	.059	.053	3CNL22

Plan G				
Reel #	Partial Discharge (Corona) (PC)	AC Withstand (KV)	Dry Check	Test Duration AC (Min)
Specs	Max=5	Min=35		
LN5BGA01	2.43	35	Pass	5
LN5BGA02	1.58	35	Pass	5
LN5BGA03	2.74	35	Pass	5
LN5BGA04	1.93	35	Pass	5
LN5BGA05	2.61	35	Pass	5
LN5BGA06	1.68	35	Pass	5
LN5BGA07	2.00	35	Pass	5

Inventory Report			
Reel #	Total Ftg	Top	Drum
LN5BGA01A	3190	6519318	6522508
LN5BGA01B	3190	6516126	6519316
LN5BGA01C	3180	6512944	6516124
LN5BGA02A	3274	6525800	6529074
LN5BGA02B	3270	6522528	6525798
LN5BGA03A	3056	6532148	6535204
LN5BGA03B	3058	6529088	6532146
LN5BGA04A	3134	6538368	6541502
LN5BGA04B	3134	6535232	6538366
LN5BGA05A	3262	6551304	6554566
LN5BGA05B	3262	6548040	6551302
LN5BGA05C	3262	6544776	6548038
LN5BGA05D	3254	6541520	6544774
LN5BGA06A	3254	6561090	6564344
LN5BGA06B	3254	6557834	6561088
LN5BGA06C	3254	6554578	6557832
LN5BGA07	3288	6567642	6564354