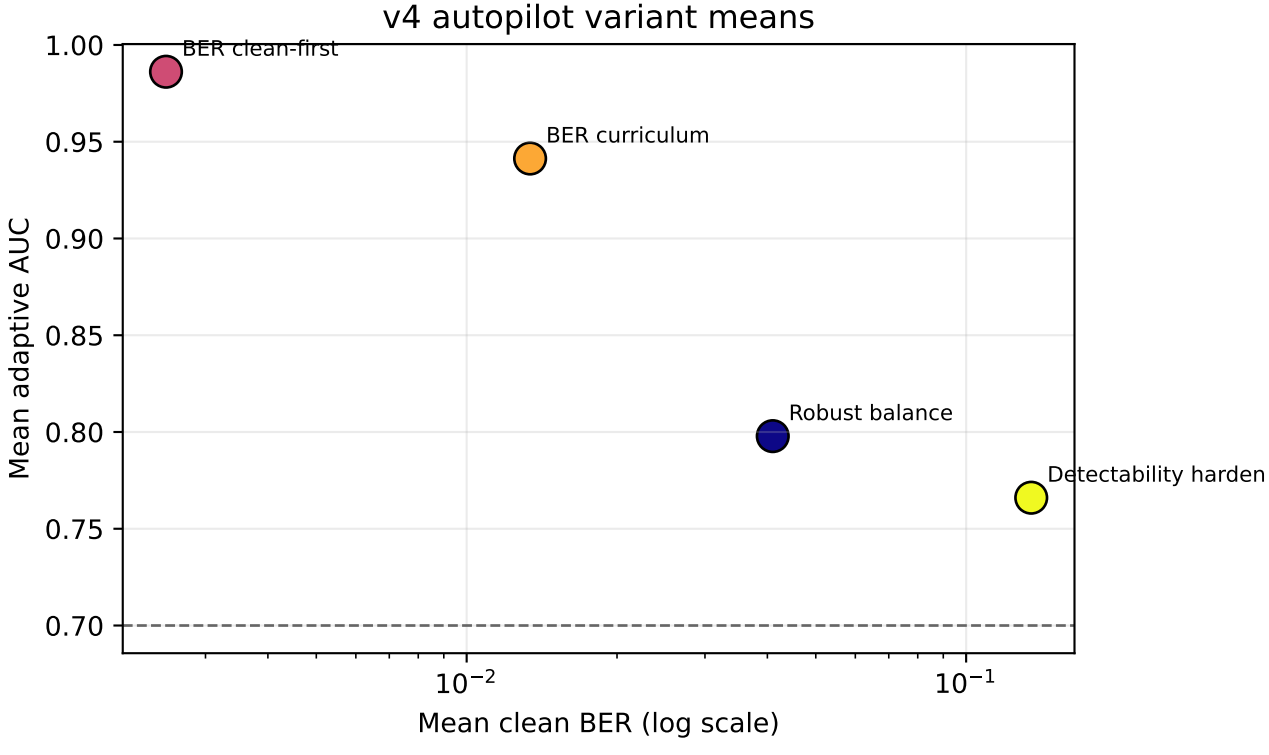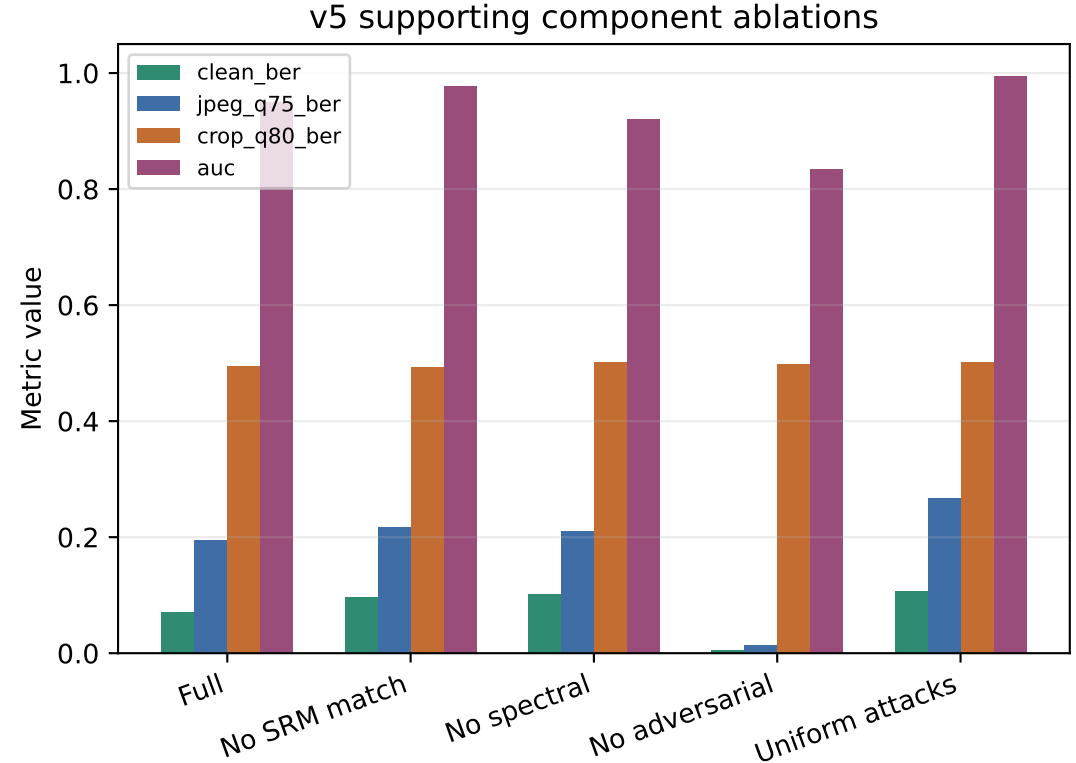Ablation summary from outputs_tifs_ablation/latest_ablation.json and outputs_v5_ablation/ablation_results.json
The no_redundant v5 run failed to train and is listed only in the table.