

Anexo 01

Análisis de seguridad eléctrica


System Information

System Voltage		V
Upstream Overcurrent Breaker (device)		A
Short Circuit Current (Isc)		kA
Energy Storage (e.g. Capacitors)		kJ
Opening Time		Sec
Working Distance (From the arc source)		(*)
Power - For Arc Flash prot. Boundaries		kVA (*)
(*) Fixed or Automatic Value		
Incident Energy		cal/cm2

Frontera de protección de arco y choque eléctrico

Distancias para instalación de barricada durante verificación de Seven Steps y señalización perimetral

According to NFPA70E: Table 130.4(E)(a)

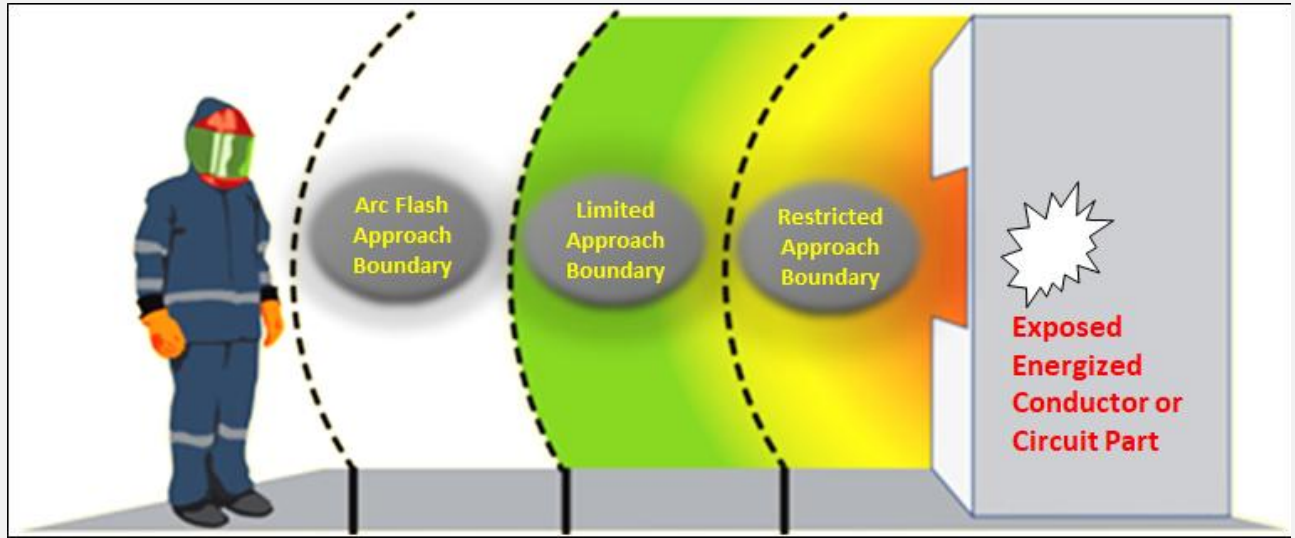

↑
Exposed Movable Conductor

Etiqueta NFPA70E

Etiqueta para imprimir y colocar en el área de trabajo

		WARNING	
		Arc Flash & Shock Hazard Appropriate PPE Required	
ARC FLASH PROTECTION BOUNDARY AND REQUIRED PPE			
Arc Flash boundary:		Glove Class/ CAT:	
Required PPE:		Footwear:	
SHOCK HAZARD PROTECTION BOUNDARIES			
Shock Hazard:		Restricted Approach:	
Limited Approach:		Assessment Date:	
Bus/Equipment ID:			
Protective Device (Upstream):			
THIS LABEL IS FOR TEMPORARY USE AND MUST BE REMOVED AFTER SERVICE IS COMPLETED			
IMPORTANT: This label was generated using estimated values and may be used in the absence of a formal arc flash risk assessment.			

ABB Electrical Safety Calculator V1.6a Jan. 2024