(a) held-out vertebra recall, % [95 % case bootstrap]

	DeepFluoro six specimens	DeepFluoro test specimen	COBRA Elekta 27 patients	C-ArmLSpine 28 cases, outline
D only (styled + real)	not scored	in training	38.1 [32.3, 44.5]	12.9 [8.3, 18.1]
E only (styled + real)	not scored	92.8 (one cluster)	in training	86.8 [81.1, 91.8]
E only, real cut to 240 frames / 10 patients	not scored	20.5 (one cluster)	in training	39.0 [33.2, 44.7]
S only (styled + real), run 1	17.4 [2.1, 40.4]	31.3 (one cluster)	7.5 [3.5, 12.1]	in training
S only (styled + real), run 2	not scored	26.5 (one cluster)	12.2 [8.0, 16.0]	in training
D+E, design A, seed 0	not scored	in training	in training	84.7 [77.7, 90.7]
D+E, design A, seed 1	not scored	in training	in training	80.5 [72.5, 87.6]
D+E, design B (own poses), seed 1	not scored	in training	in training	87.8 [81.7, 93.2]
D+S, design A, seed 0	not scored	in training	30.2 [26.3, 34.2]	in training
D+S, design A, seed 1	not scored	in training	31.4 [26.6, 35.4]	in training
D+S, design B (own poses)	not scored	in training	32.7 [28.4, 36.2]	in training
S+E, design A, seed 0	72.1 [59.1, 86.1]	91.6 (one cluster)	in training	in training
S+E, design A, seed 1	77.7 [64.8, 87.9]	91.6 (one cluster)	in training	in training
S+E, design B (own poses), seed 0	78.6 [68.8, 92.0]	94.0 (one cluster)	in training	in training
S+E, design B (own poses), seed 1	75.3 [63.6, 90.9]	94.0 (one cluster)	in training	in training
real frames only, D+E	not scored	in training	in training	90.6 [85.4, 95.2]
real frames only, D+S	not scored	in training	18.5 [13.7, 22.8]	in training
real frames only, S+E	not scored	95.2 (one cluster)	in training	in training
real frames only, S	not scored	10.8 (one cluster)	8.8 [5.0, 12.2]	in training
renders only, no real frame	not scored	59.0 (one cluster)	37.8 [33.9, 42.1]	31.7 [27.1, 36.1]

(b) by view and gantry-angle band (frames)

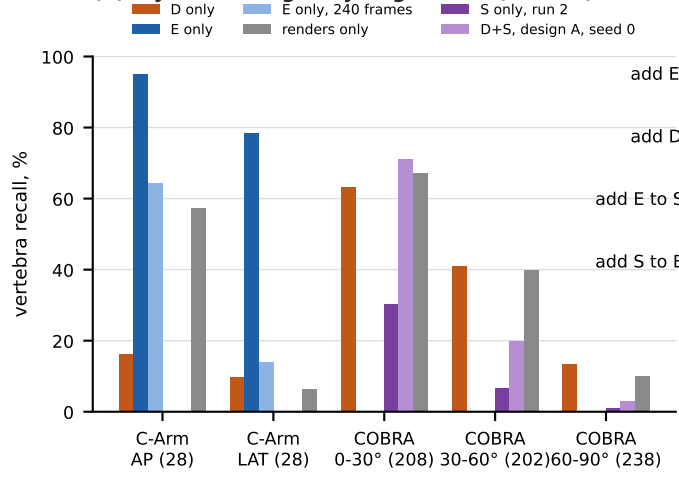
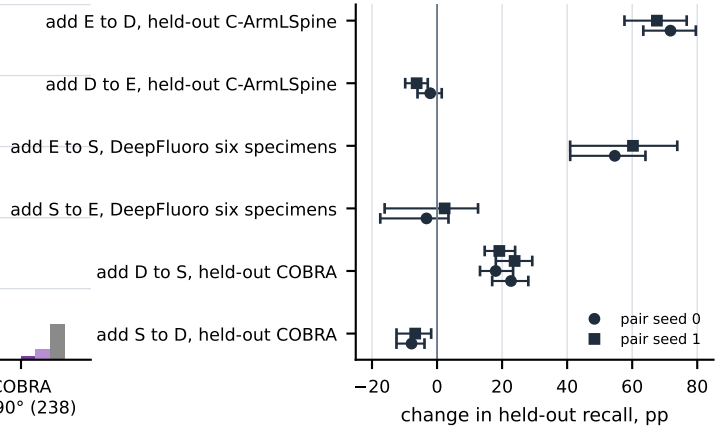
(c) marginal contribution