


ASPHALT IS APPLIED UNIFORMLY TO EACH
PLY AT EVT, AT A RATE OF 25 LBS
PER 100 SQ/FT OF ROOF SURFACE (±15%)

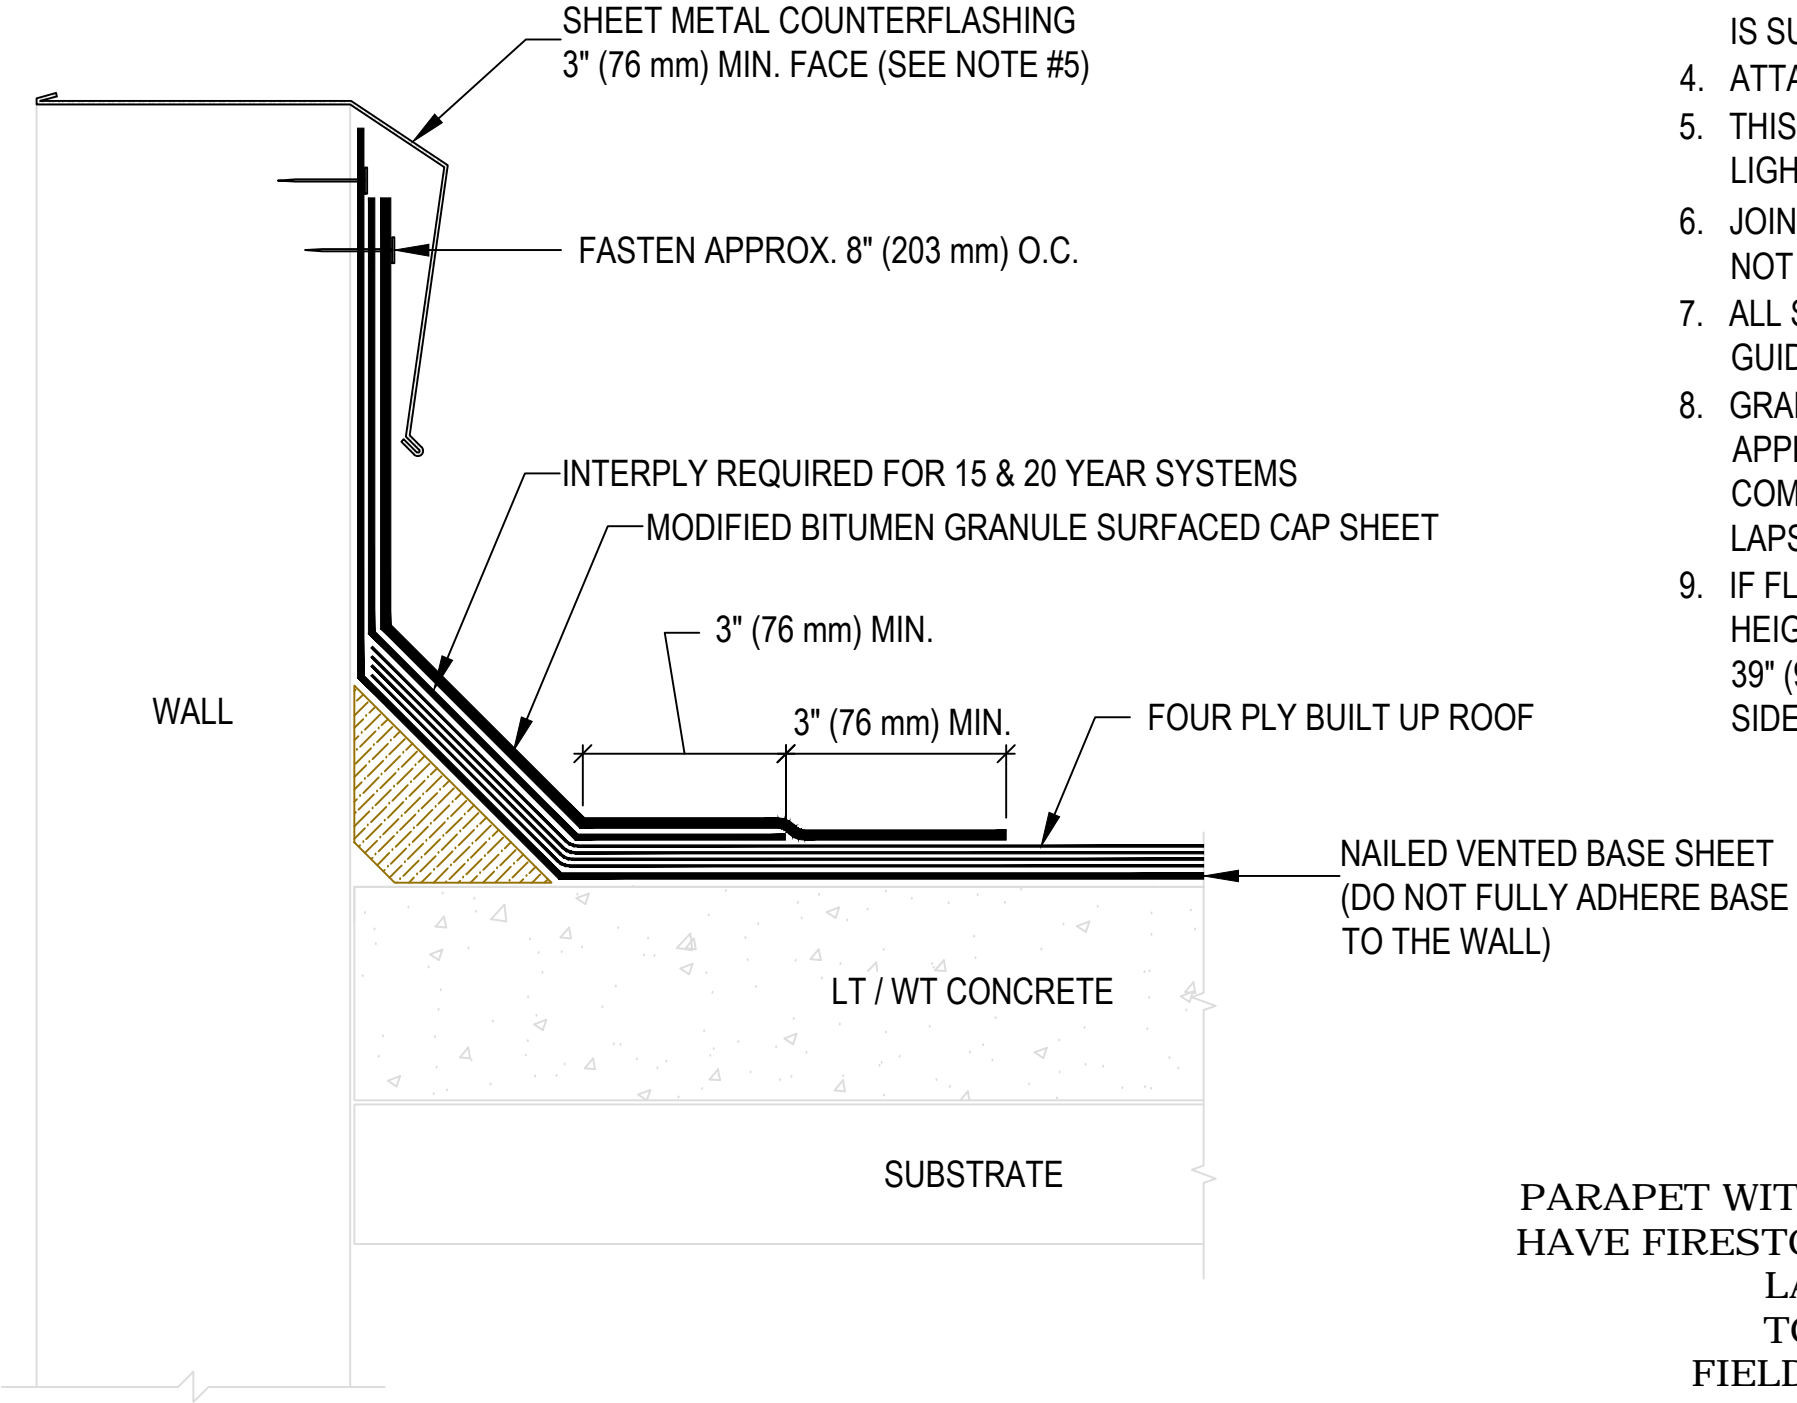

- NOTES:
- 1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION AT firestonebpco.com.
 - 2. THIS DETAIL TO BE USED OVER LIGHTWEIGHT INSULATION OR CELLULAR CONCRETE WET-FILL DECKS.
 - 3. THIS DETAIL MUST BE USED ONLY WHERE THE DECK IS SUPPORTED BY THE WALL.
 - 4. ATTACH WOOD NAILERS WITH SUITABLE FASTENERS.
 - 5. THIS DETAIL MAY NOT BE APPLICABLE FOR USE WITH LIGHTWEIGHT FILLS.
 - 6. JOINTS IN SHEET METAL COUNTERFLASHING MUST NOT BE SOLDERED OR FASTENED.
 - 7. ALL SHEET METAL IS TO BE INSTALLED PER SMACNA GUIDELINES.
 - 8. GRANULES MUST BE EMBEDDED WHEN USING TORCH APPLIED GRANULE SURFACED CAP SHEETS PRIOR TO COMPLETING SIDE LAPS, END LAPS, AND BASE FLASHING LAPS.
 - 9. IF FLASHING MUST EXTEND ABOVE 24" (610 mm) IN HEIGHT, FLASHING WIDTH MUST NOT EXCEED 39" (991 mm) AND SHALL BE ATTACHED IN SIDE LAPS AT 9" (229 mm) O.C.

PARAPET WITH NAILABLE SUBSTRATES MUST
HAVE FIRESTONE MB BASE SHEET ATTACHED:
LAPS 9" (229 mm) O.C.
TOPS 8" (203 mm) O.C.
FIELD 1 PER 1 S.F. (11 SQ. M.)

MAXIMUM WARRANTY: 20 YEARS