


**REFER TO MB-BT-9  
FOR TERMINATION**

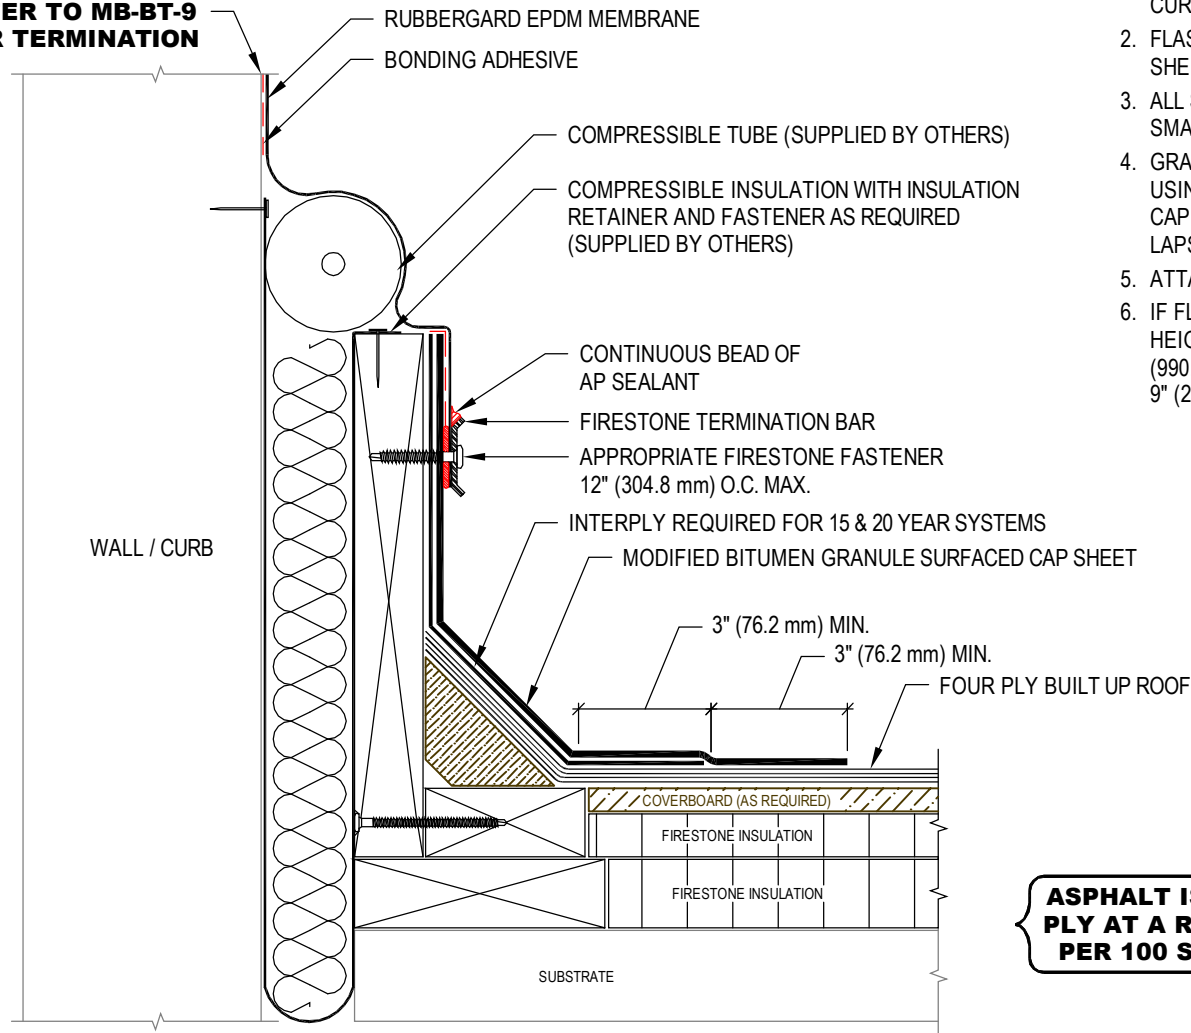

**NOTES:**

1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
2. FLASHING LAPS MUST BE OFFSET FROM FIELD SHEET LAPS A MIN. 12" (304.8 mm)
3. ALL SHEET METAL TO BE INSTALLED PER SMACNA GUIDELINES.
4. GRANULES MUST BE EMBEDDED WHEN USING TORCH APPLIED GRANULE SURFACED CAP SHEETS PRIOR TO COMPLETING SIDE LAPS, END LAPS, AND BASE FLASHING LAPS.
5. ATTACH NAILER TO DECK WITH SUITABLE FASTENER.
6. IF FLASHING MUST EXTEND ABOVE 24" (609.6mm) IN HEIGHT, FLASHING WIDTH MUST NOT EXCEED 39" (990.6mm) AND SHALL ATTACH IN SIDE LAPS AT 9" (228.6mm) O.C.

**ASPHALT IS APPLIED UNIFORMLY TO EACH PLY AT A RATE OF APPROXIMATELY 25 LBS PER 100 SQ/FT OF ROOF SURFACE (±15%)**

**MAXIMUM WARRANTY: 20 YEARS**

**Firestone**  
BUILDING PRODUCTS  
**NOBODY COVERS YOU BETTER.™**  
[www.firestonebpco.com](http://www.firestonebpco.com)

**EXPANSION JOINT WITH RUBBERGARD MEMBRANE**

**ASPHALT SYSTEMS**

ACCEPTABLE SYSTEMS: BUR

ISSUE/REVISION  
DATE:

1/1/2006

NOT TO SCALE

DETAIL NO.

**BU-E-4**