


NOTES:

1. REFER TO FIRESTONE WEB SITE FOR MOST CURRENT INFORMATION.
2. WALKWAY SECTIONS SHOULD BE SPACED PROPERLY TO ALLOW FOR DRAINAGE. SPACING BETWEEN WALKWAY SECTIONS SHALL BE 1" (25.4 mm) MIN. TO 3" (76.2 mm) MAX.
3. INSTALL AN ADDITIONAL LAYER OF FIRESTONE SBS MEMBRANE TO THE FINISHED FIRESTONE SBS SYSTEM USING STANDARD APPLICATION TECHNIQUES.

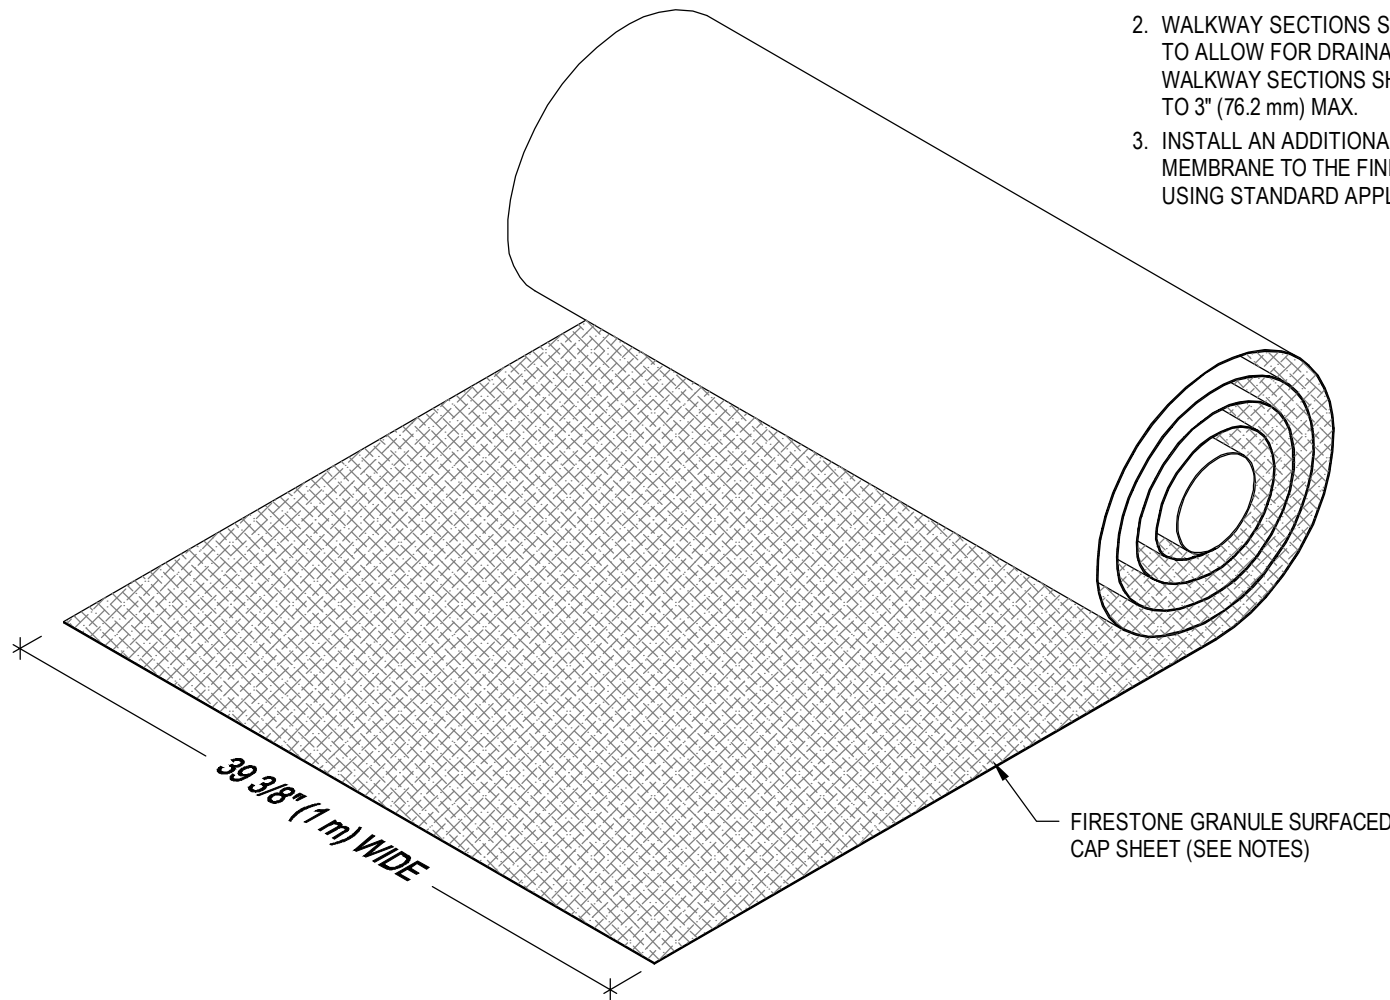

FIRESTONE GRANULE SURFACED
CAP SHEET (SEE NOTES)

MAXIMUM WARRANTY: **20 YEARS**

Firestone
BUILDING PRODUCTS
NOBODY COVERS YOU BETTER.™
www.firestonebpco.com

WALKWAY PAD

ASPHALT SYSTEMS

ACCEPTABLE SYSTEMS: BUR

ISSUE/REVISION
DATE:

1/1/2006

NOT TO SCALE

DETAIL NO.

BU-M-8