


NOTES:

1. SPLICE TWO PIECES OF ELASTOFORM OR PRESSURE-SENSITIVE ELASTOFORM TOGETHER TO ACHIEVE DESIRED WIDTH.
2. ON MECHANICALLY FASTENED SYSTEMS, CD-10 OR HD 14-10 FASTENERS AND SEAM FASTENING PLATES ARE REQUIRED OVER CONCRETE DECKS.
3. WATER CUT-OFF MUST BE UNDER CONSTANT COMPRESSION.
4. CARLISLE IS NOT RESPONSIBLE FOR DAMAGE TO THE BUILT-UP ROOF OR STRUCTURAL DECK RESULTING FROM PONDED WATER; THIS DETAIL APPLIES TO RE-ROOFING WHEN A TEAR-OFF IS NOT SPECIFIED AND WAS DESIGNED TO PREVENT MIGRATION OF WATER INTO THE NEW ROOFING SYSTEM.
5. ON BALLASTED SYSTEMS, USE CONCRETE PAVERS TO PREVENT BALLAST MIGRATION.

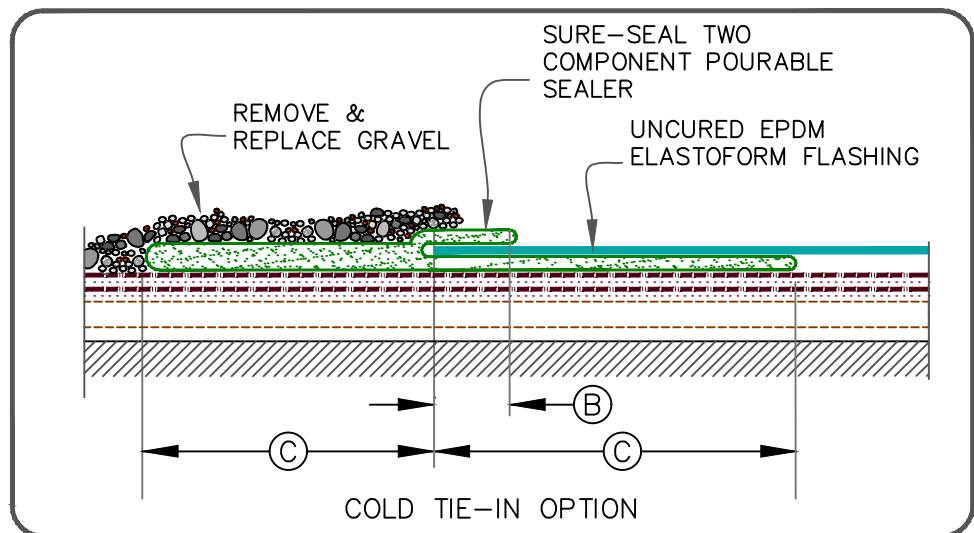


DIMENSIONS	mm	
(A)	5"	127 MIN.
(B)	2"	51 ± 1/2" (13mm)
(C)	6"	152

	• EPDM
	• APPROVED SUBSTRATE
	• SEE NOTE(S)

BUILT-UP ROOFING TIE-IN OVER
CONCRETE ROOF DECK

For additional information, refer to Specifications



DETAIL NO.

U-13B

THERMOSET UNIVERSAL