



CAUTION

WHEN A PRE-MOLDED PIPE SEAL IS NOT FEASIBLE, PROJECTS WITH 25 & 30-YEAR WARRANTIES REQUIRE ALL ROUND PIPE PENETRATIONS TO BE DOUBLE WRAPPED WITH TWO LAYERS OF PRESSURE-SENSITIVE ELASTOFORM FLASHING, TERMINATED WITH A STAINLESS STEEL CLAMPING RING & SEALED WITH CONTINUOUS LAP SEALANT (AS SHOWN).

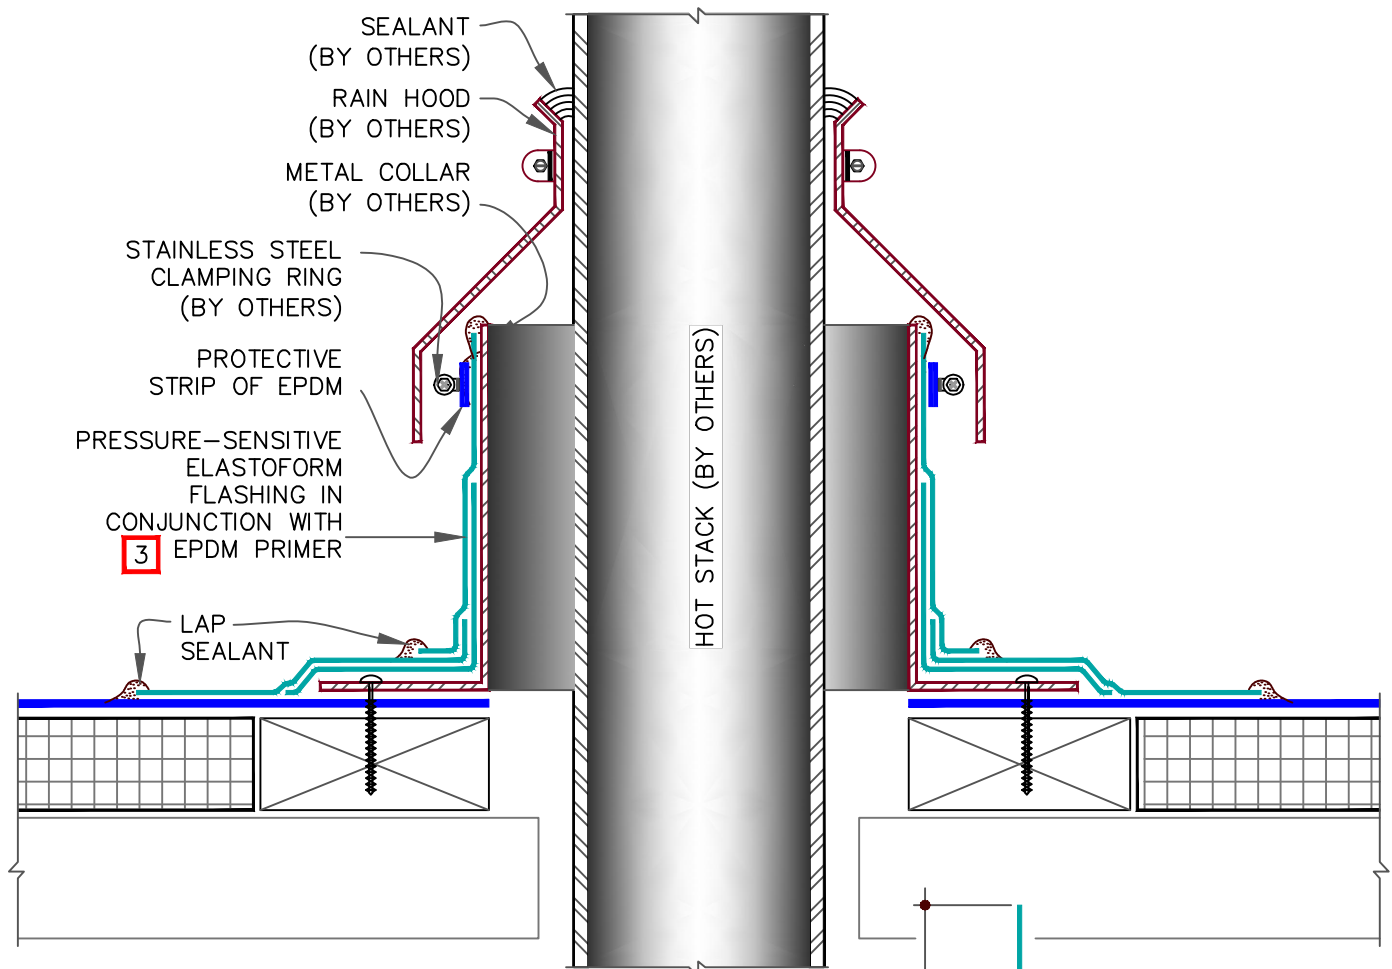

NOTES:

1. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING FIELD FABRICATED PIPE SEAL.
2. TEMPERATURE OF METAL COLLAR MUST NOT EXCEED 180°F (82°C).
3. EPDM PRIMER MUST BE APPLIED TO THE MATING SURFACES PRIOR TO APPLYING PRESSURE-SENSITIVE ELASTOFORM FLASHING.
4. IN COLDER TEMPERATURES, A HEAT GUN MUST BE USED WHEN FORMING PRESSURE-SENSITIVE ELASTOFORM FLASHING.

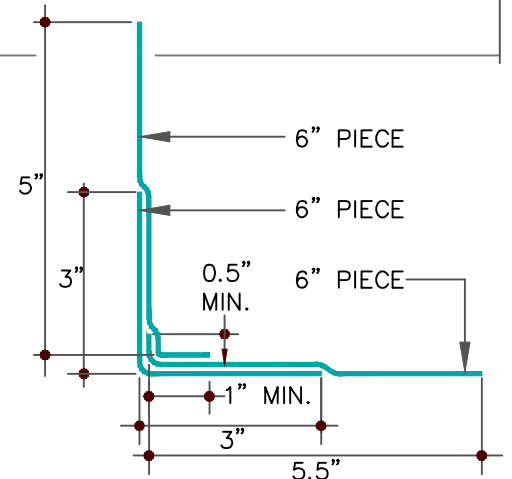

0.5"	mm	5.0"	mm
1.0"	25	5.5"	140
3.0"	76	6.0"	152

 —• EPDM  —• APPROVED SUBSTRATE  —• SEE NOTE(S)	FIELD FABRICATED HOT STACK For additional information, refer to Specifications		DETAIL NO. U-8D THERMOSET UNIVERSAL
--	--	---	--