


CAUTION


WHEN A WARRANTY WIND SPEED GREATER THAN 90MPH IS SPECIFIED, CARLISLE FASTENERS AND SEAM FASTENING PLATES SHALL NOT EXCEED 6" (152mm) ON CENTER FOR ADHERED MEMBRANE ASSEMBLIES.





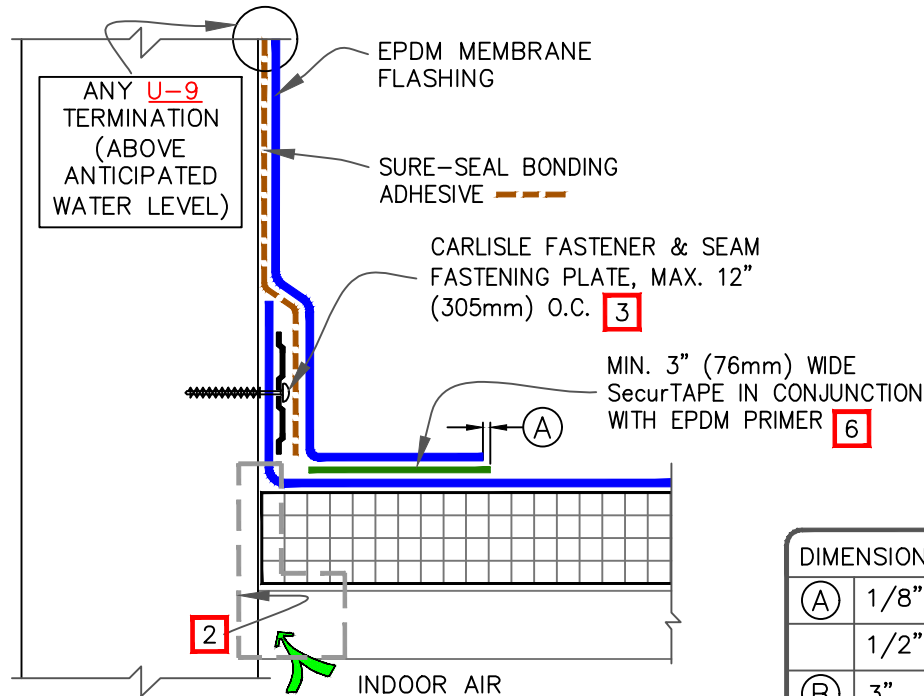

DIMENSIONS	mm	
(A) 1/8"	3	TO
1/2"	13	MAX.
(B) 3"	76	
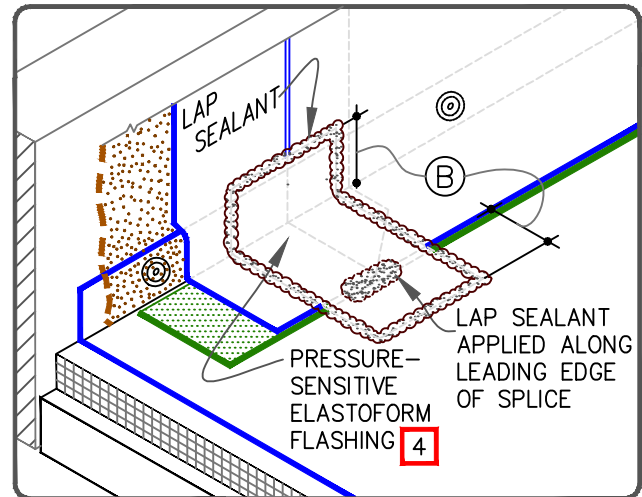
## NOTES:

- PRIOR TO THE INSTALLATION OF SecurTAPE AND PRESSURE-SENSITIVE FLASHING APPLY EPDM PRIMER TO SPLICE AREAS.
- REFER TO SPECIAL CONDITION SPEC. SUPPLEMENTS G-01-17 OR G-08-17:
  - TO BLOCK INDOOR AIR INFILTRATION AND HUMIDITY AT THE JUNCTION (G-01-17).
  - WHERE ROOF SYSTEM IS DESIGNED WITH A VAPOR RETARDER (G-08-17).
- SEAM FASTENING PLATE/FASTENER MAY BE INSTALLED INTO THE STRUCTURAL DECK. HP FASTENERS AND POLYMER SEAM PLATES ARE REQUIRED FOR MECHANICALLY-FASTENED ROOFING SYSTEMS OVER STEEL DECKS.
- PROJECTS WITH 25 AND 30-YEAR WARRANTIES OR WHEN USING 90-MIL MEMBRANE, ALL VERTICAL SPLICES AT THE BASE OF A WALL AND SPLICE INTERSECTIONS MUST BE OVERLAID WITH TWO LAYERS OF PRESSURE-SENSITIVE ELASTOFORM FLASHING. THE BOTTOM LAYER SHALL BE 6" (152mm) WIDE COVERED WITH A 12" (305mm) WIDE PRESSURE-SENSITIVE ELASTOFORM FLASHING PIECE. BOTH LAYERS SHALL BE CENTERED AND SEALED WITH CONTINUOUS LAP SEALANT. REFER TO DETAIL U-2C.
- MEMBRANE SPLICES SHALL INCORPORATE 6" (152mm) WIDE FIELD APPLIED SecurTAPE FOR PROJECTS WITH 20, 25 and 30-YEAR WARRANTIES.
- LAP SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED MEMBRANE.



 —• EPDM  —• APPROVED SUBSTRATE  —• SEE NOTE(S)	PARAPET / CURB WITH SEPARATE MEMBRANE FLASHING For additional information, refer to Specifications		DETAIL NO. <b>U-12C</b> THERMOSET UNIVERSAL
--	---	---	---