



- Ⓑ HP FASTENERS @ 12" (305mm) O.C.
OR RING-SHANK NAILS @ 4" (102mm) O.C. & STAGGERED 3/4" (19mm) O.C. RAKE AND CLIP REMOVED
- Ⓓ FASTENERS TO MATCH EXISTING @ 6" O.C., MAX., EXPOSED 3/4" (19mm) MIN. BEYOND EXISTING SUBSTRATE

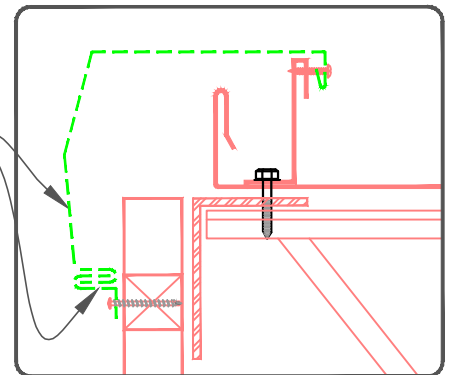

EXISTING FLOATING RAKE EDGE

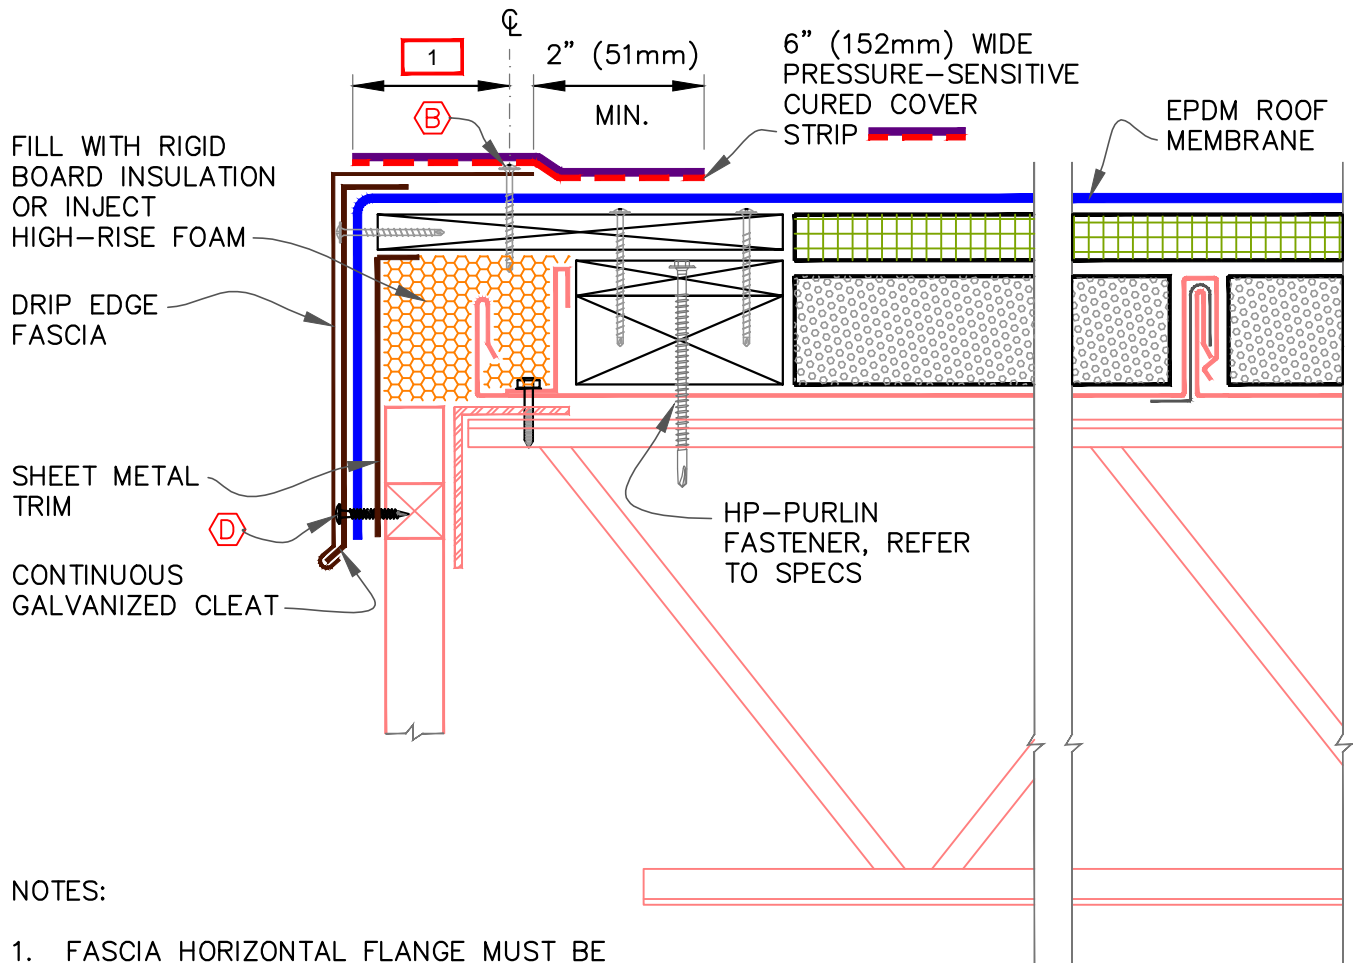


NOTES:

1. FASCIA HORIZONTAL FLANGE MUST BE TOTALLY COVERED MINIMUM 2" (51mm) BEYOND THE NAIL.
2. REFER TO [MR Z1.1](#) & [MR Z1.2](#) AT THE END OF THIS SECTION.

RAKE EDGE

	• HIGH DENSITY RECOVER BOARD		• ROOF MEMBRANE
	• IN-FILL INSULATION		• WOOD NAILER (BY OTHERS)
	• SEE DRAWING NOTE(S)		



SHEET NO.

MR E1.9