



5 MASONRY WALL - REINF.DETAILS
S200

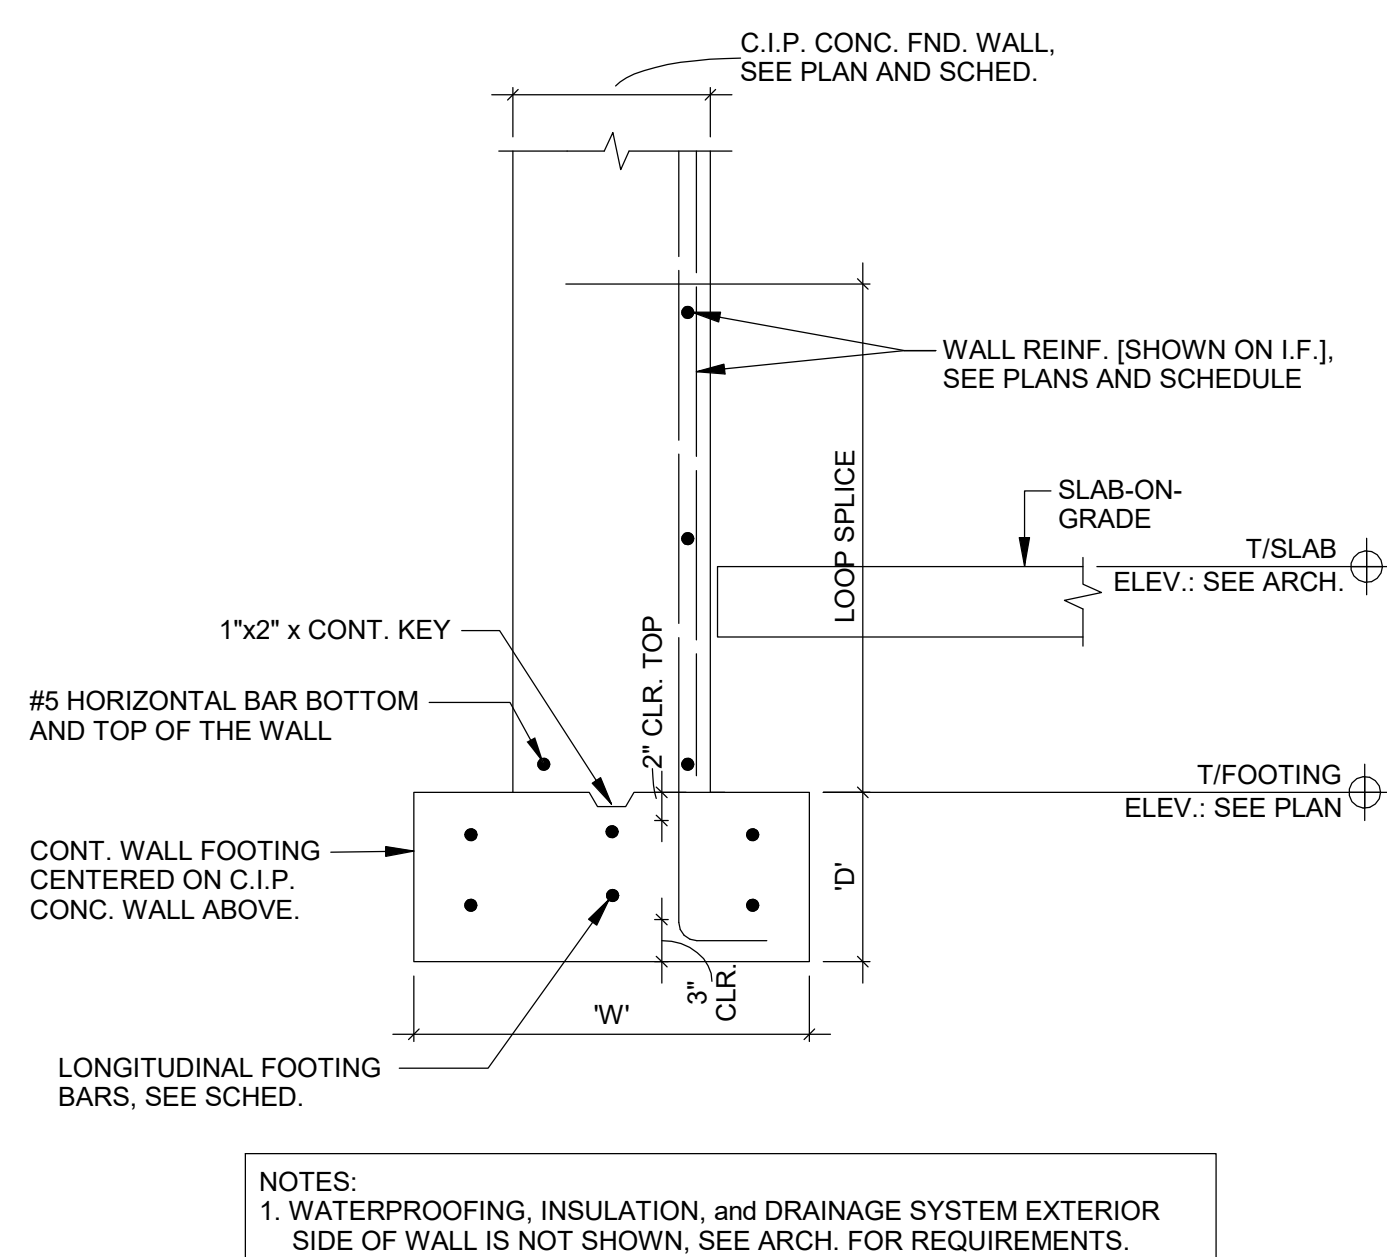


12 CONCRETE WALL ON FOOTING
S200

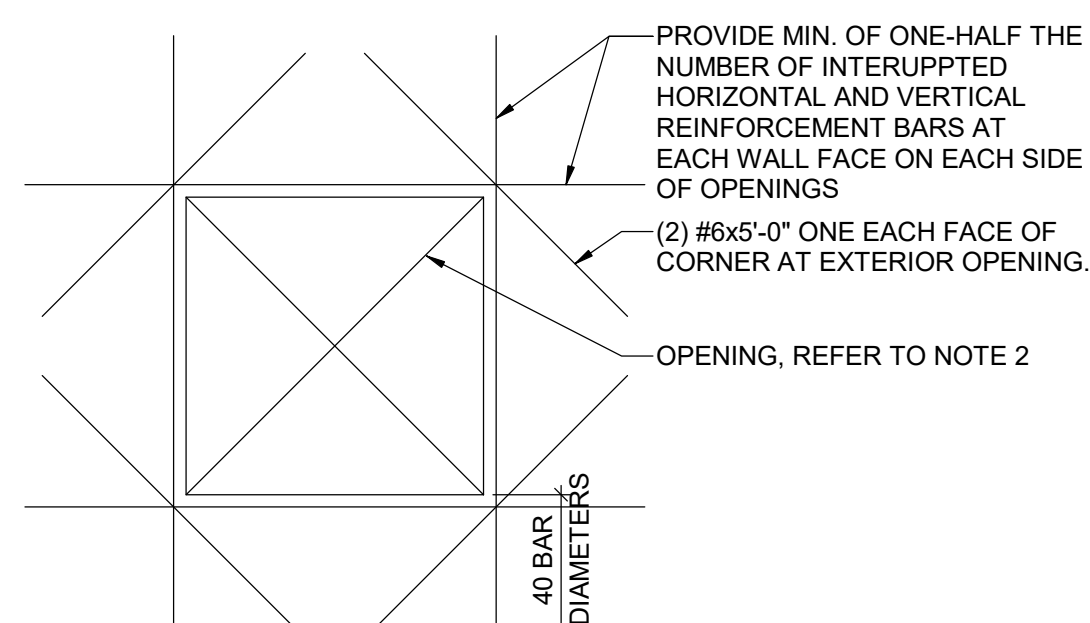


7
S200

NOTES:


1. ADDED REINFORCEMENT AS SHOWN SHALL BE PROVIDED FOR ALL OPENINGS 12" DIAMETER OR SQUARE AND LARGER IN SIZE, UNLESS DETAILED ELSEWHERE.
2. SPACE ADDED BARS AS CLOSE AS PERMISSIBLE BY CODE FOR THE REQUIRED BAR SIZE.
3. VERIFY SIZE AND LOCATION OF OPENINGS WITH TRADE OR SUBCONTRACTOR WHICH REQUIRES OPENINGS.

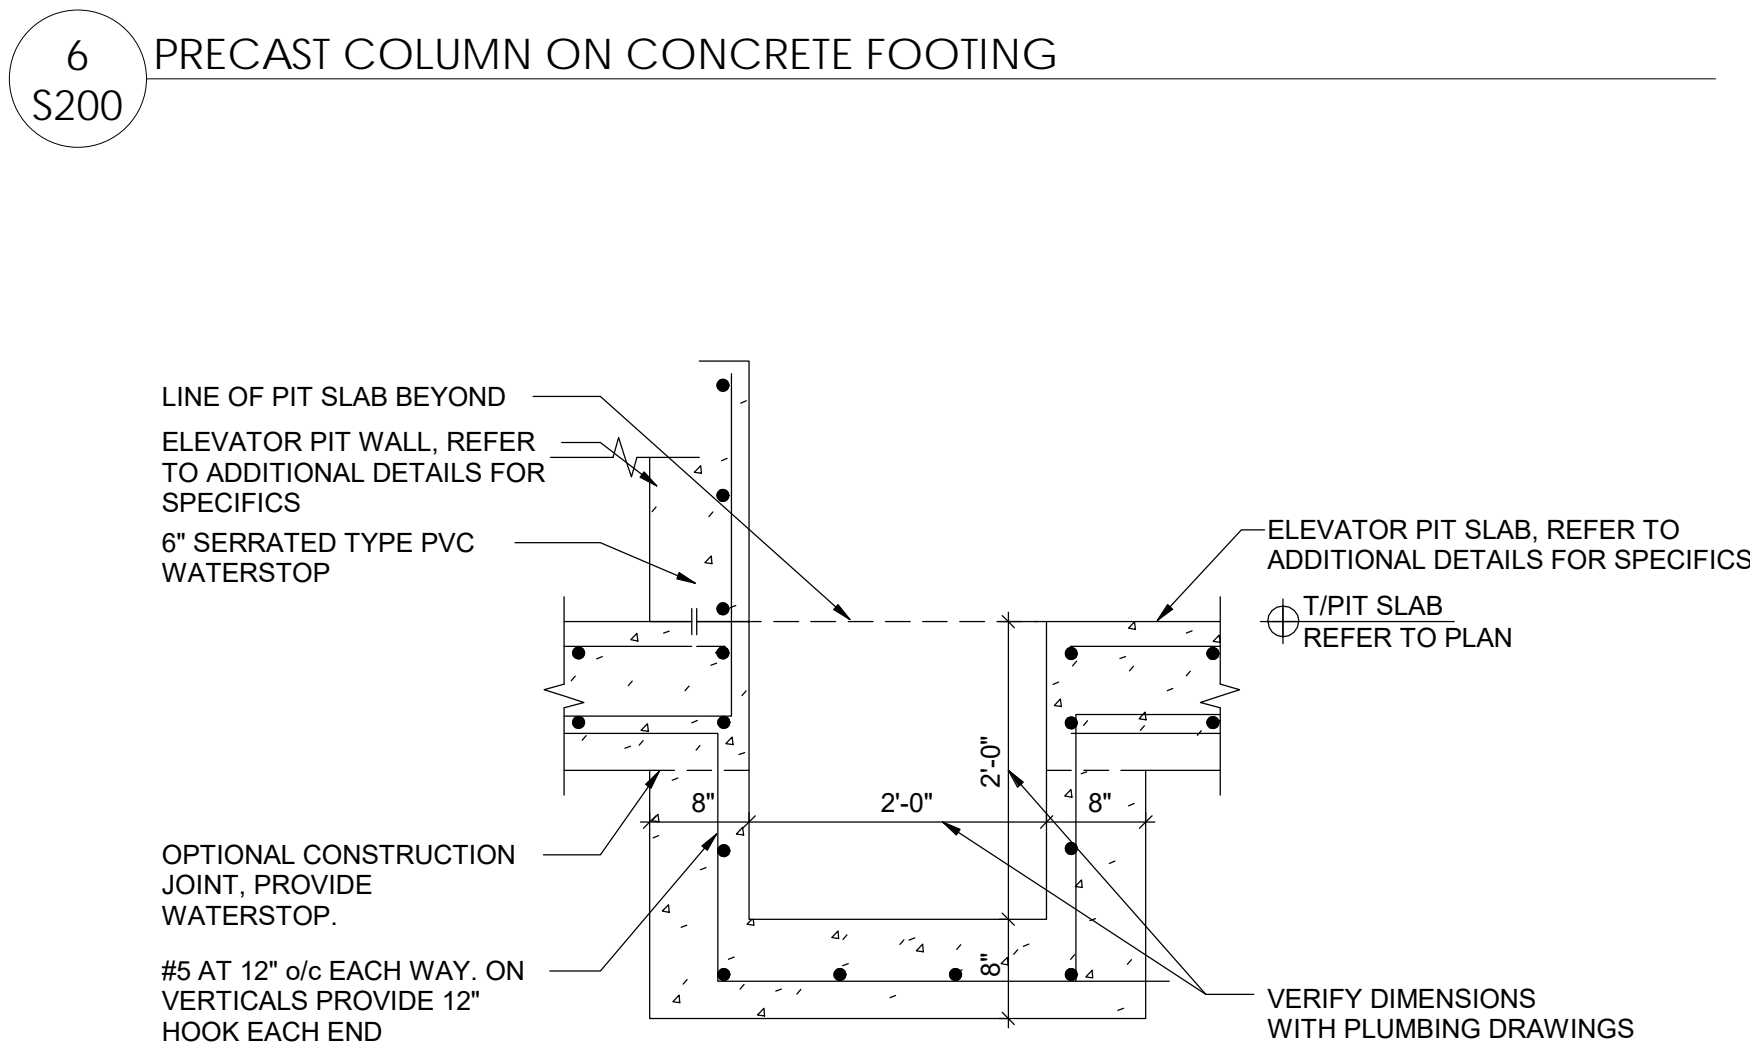


8 ELEVATOR PIT SUMP CROCK
S200

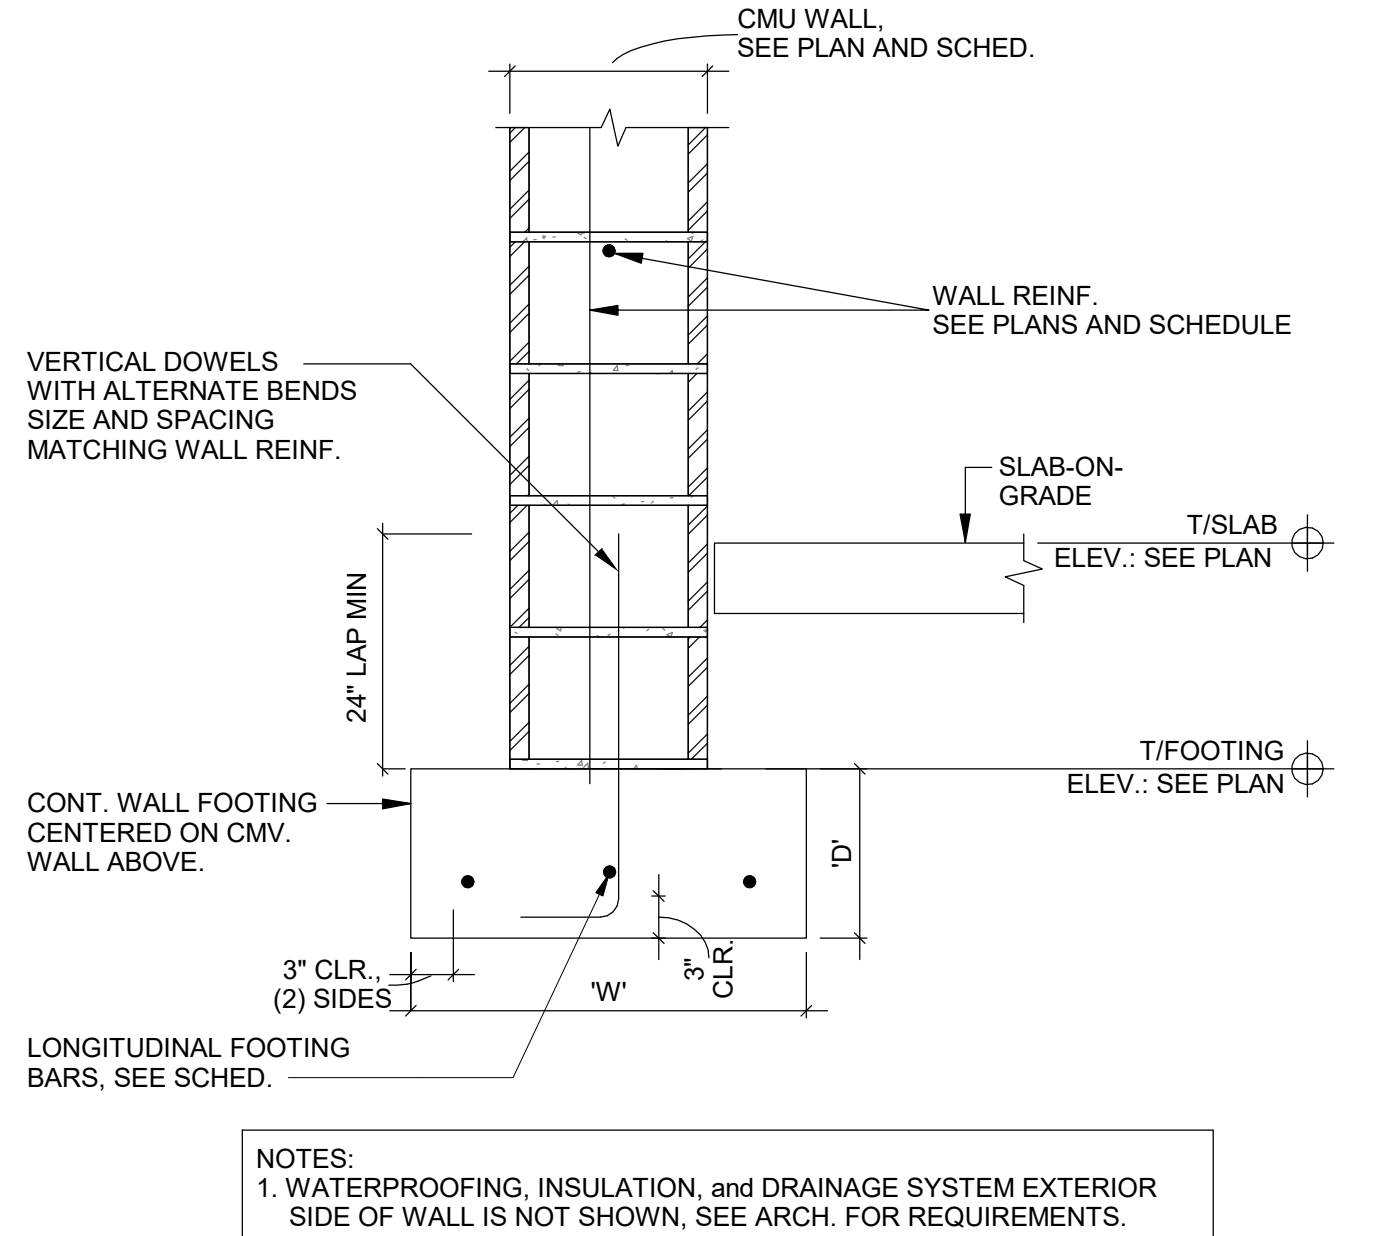

13 CMU WALL ON FOOTING
S200

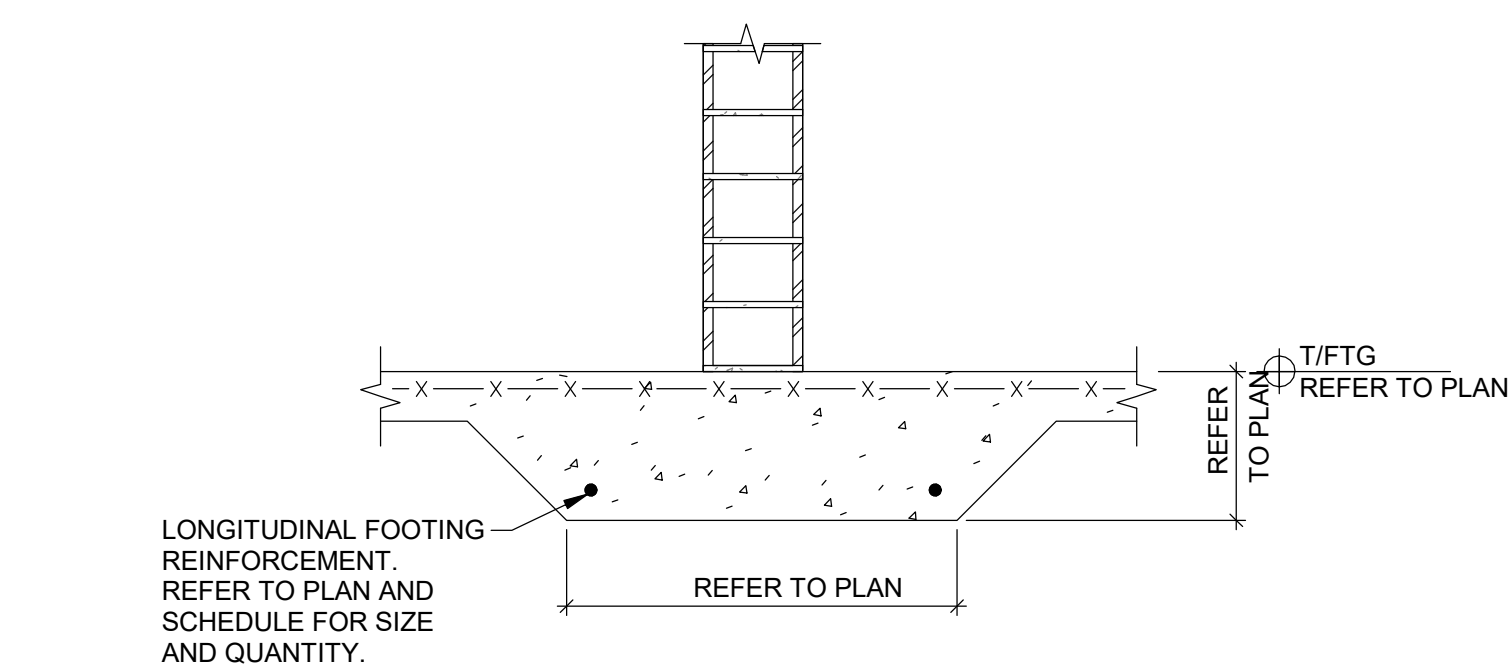

10 INTERIOR STUD WALL ON THICKENED SLAB
S200

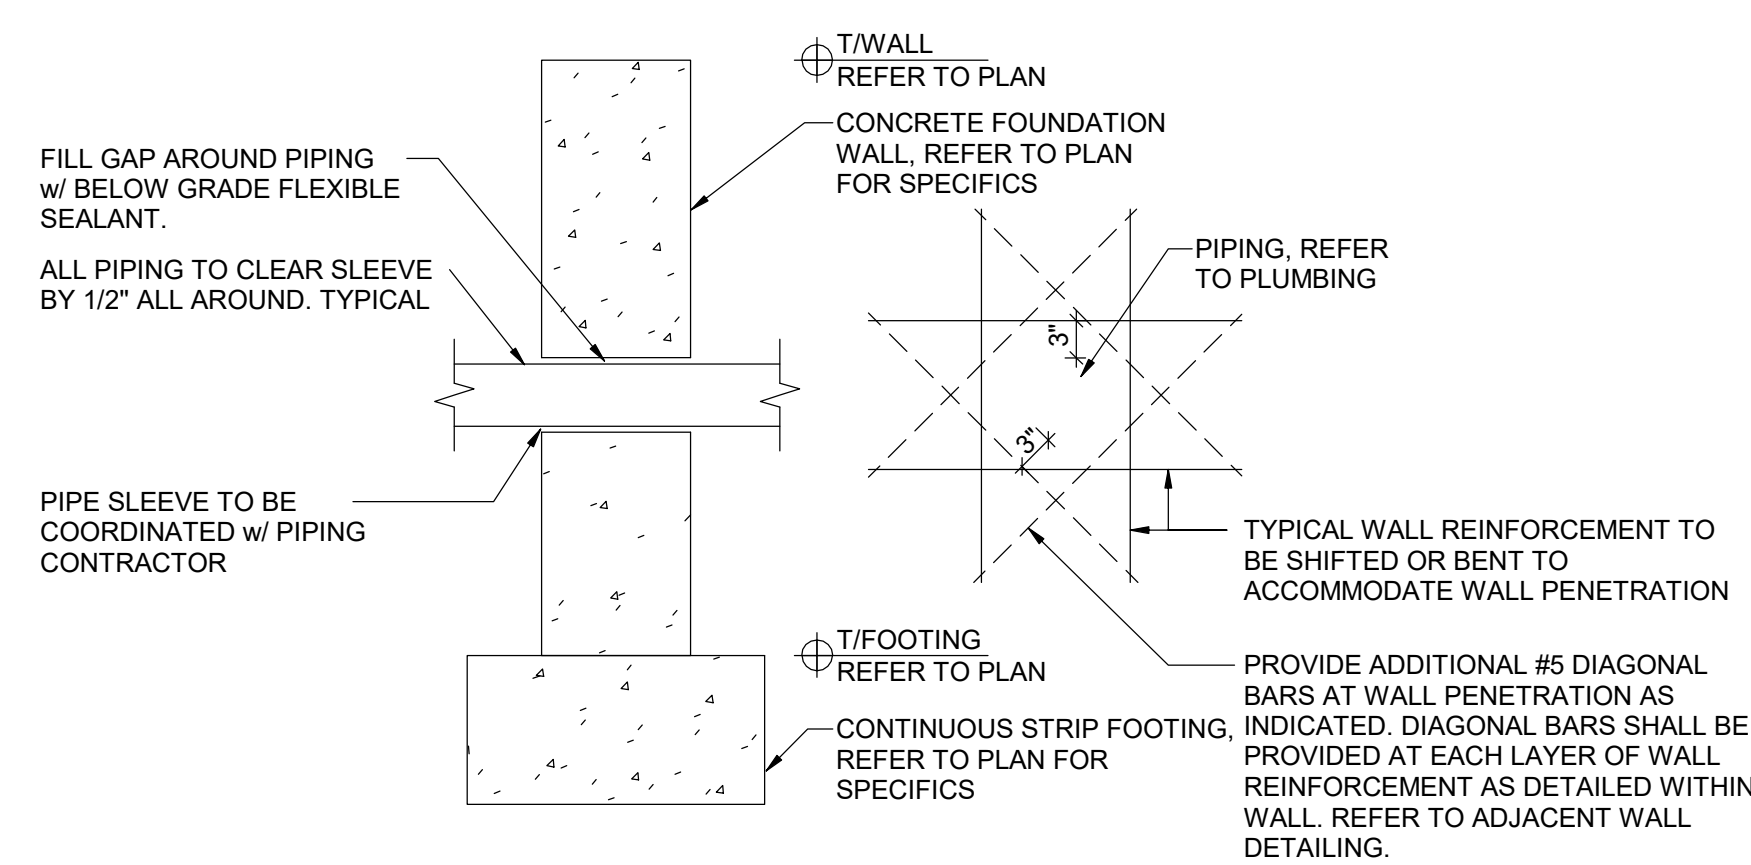

11 PIPE PENETRATION AT FOUNDATION WALL
S200

Date	Description
07.08.2019	Footing and Foundation Plan Permit
08.15.2019	75% CD Set