
Room or Space <u>Designation</u>	Occupancy Classification	Floor Area (Square Feet)	Density Persons/1,000 SF	Occupant Load by Calculation	Ventilation CFM needed
113	Fitness	210	-	-	-
114	Restroom	50	-	-	-
115	Conference	410	50	20	150
116	Kitchen	122	20	2	15
				Total:	165

^{*}Minimum required outdoor air ventilation for B-3 is 165 CFM.

Interlocked B-3 outdoor air MOD with EF-5 & EF-7, to be energized during OCCUPIED hours.



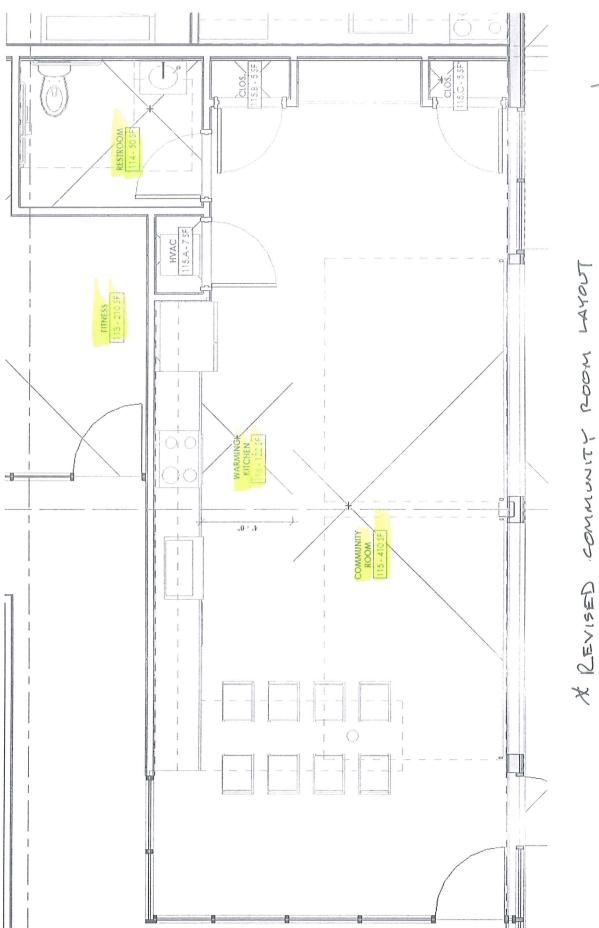

4-17-2020 X REVISED COMMUNITY ROOM LAYOUT system. 86.8