




- | WOOD HEADER/POST SCHEDULE | | | |
|---------------------------|-----------------------|------------------------|---|
| MARK | SIZE | BEARING STUD | REMARKS |
| HP1 | SEE DETAIL 9/S421 | | |
| HP2 | (3) 1-3/4"x9-1/4" LVL | (3) 2x | BEARING STUD WIDTH TO MATCH STUD WALL WIDTH |
| HP3 | (3) 2x10 | (3) 2x | BEARING STUD WIDTH TO MATCH STUD WALL WIDTH |
| HP4 | (2) 2x8 | (3) 2x | BEARING STUD WIDTH TO MATCH STUD WALL WIDTH |
| HP5 | (3) 2x12 P.T. | | |
| HP6 | (2) 1-3/4"x14" LVL | (2) 2x | BEARING STUD WIDTH TO MATCH STUD WALL WIDTH |
| HP7 | (2) 1-3/4"x18" LVL | REFER TO PLAN | |
| HP8 | (3) 1-3/4"x16 LVL | REFER TO DETAIL 1/S412 | |
| HP9 | (2) 1-3/4"x5-1/2" LVL | REFER TO DETAIL1/S412 | |
| HP10 | (3) 1-3/4"x20" LVL | (4) 2x | BEARING STUD WIDTH TO MATCH STUD WALL WIDTH |
| HP11 | (2) 2x12 | (2) 2x | BEARING STUD WIDTH TO MATCH STUD WALL WIDTH |
| HP12 | (3) 2x12 | (2) 2x | BEARING STUD WIDTH TO MATCH STUD WALL WIDTH |
| WP1 | (2) 2x | | POST WIDTH TO MATCH STUD WALL WIDTH |
| WP2 | (3) 2x | | POST WIDTH TO MATCH STUD WALL WIDTH |
| WP3 | P.T. 6x6 | | |
| WP4 | (3) 1-3/4"x5-1/2" LSL | | |
| WP5 | 10"x10" P.T. GLULAM | | DESIGNED BY SUPPLIER |
| WP6 | 5-1/4"x 5-1/4" PSL | | |
| WP7 | (5) 2x | | POST WIDTH TO MATCH STUD WALL WIDTH |
| WP8 | (4) 2x | | POST WIDTH TO MATCH STUD WALL WIDTH |

- WOOD HEADER/POST SCHEDULE NOTES:**
1. WOOD MOISTURE CONTENT SHALL NOT EXCEED 19% MAXIMUM.
 2. HEADER MEMBERS SHALL BE NAILED TOGETHER w/ 16d NAILS AT 12" o/c TOP & BOTTOM.
 3. WHERE HEADER WIDTH IS LESS THAN 6" W/ 12" WIDTH, PROVIDE CONTINUOUS SOLD WOOD BLOCKING MATCHING HEADER DEPTH AS NEEDED TO MAKE OVERALL HEADER WIDTH EQUAL TO WALL WIDTH.
 4. ALL JOINTS ABOVE AND BELOW A FLOOR LINE.
 5. WOOD POST CONSISTING OF MULTIPLE α MEMBERS SHALL BE NAILED TOGETHER w/ 16d NAILS AT 12" o/c STAGGERED.
 6. WHERE GIRDER TRUSS WIDTH EXCEEDS POST WIDTH, ADD ADDITIONAL 2 α MEMBERS AS REQUIRED TO MATCH GIRDER WIDTH.
 7. ALL JOINTS SHALL BE PRESSURE TREATED TO 15% MOISTURE.
 8. REFER TO TYPICAL WOOD WALL DETAILS FOR FRAMING AROUND OPENING THRU WOOD STUD BEARING WALL.
 9. UNLESS HEADING STUDS ARE NOT TREATED IN HEADER.
 10. U.N.O., PROVIDE KING STUDS AT EXTERIOR OPENING PER THE FOLLOWING:
 - a. 0'-0" \leq OPENING \leq 5'-0" (1) STUD
 - b. 5'-0" \leq OPENING \leq 8'-0" (2) STUDS
 - c. 8'-0" \leq OPENING \leq 12'-0" (3) STUDS

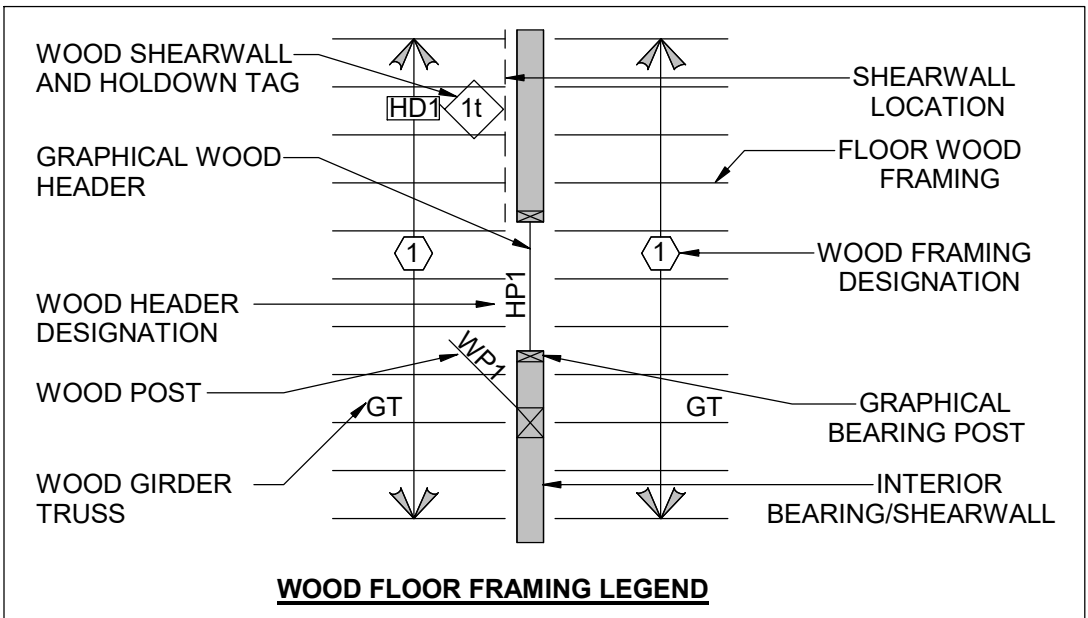

FIRST FLOOR FRAMING PLAN
CANNERY TRAIL RESIDENCES - 1750 N OXFORD AVE. - EAU CLAIRE, WI



Developer: W Capital Group
tyler@wcapitalgroupre.com | 608.345.9848

d

Architect: OpeningDesign
316 W Washington Ave | Suite 675
Madison, WI 53703
ryan@openingdesign.com | 773.425.6456



General Contractor: ROYAL CONSTRUCTION
3653 Greenway Street | Eau Claire, WI 54701
jim@royalbuilt.com | 715-225-6377



Civil Engineer: CEDAR CORPORATION
604 Wilson Avenue | Menomonie, WI 54751
kevin.ojum@cedarcorp.com | 715-235-9081



Structural Engineer: Structural Engineering
Calle Apolonio Morales, 628036 Madrid,
erezatato@xcengineering.xyz | +34 610 56 26 37



Structural Engineer: Structural Engineering
4729 Dale-Curtain Dr, McFarland, WI 53558
kfrey@ennovationbuilt.com



Mechanical Engineer: HOVLAND'S HVAC
954 E. Melby Street | Chippewa Falls, WI 54729
jhansen@hovlands-inc.com | 715.552.5595

Electrical Engineer: PRISM DESIGN ELECTRICAL
CONSULTANS INC
E8403 State Rd 85 | Mondovi, WI 54755
gren@prismdesign-electrical.com | 715.797.0602



Plumbing Engineer: TAILORED ENGINEERING
 100 Aspen Commons | Ste 210 | Middleton, WI
 53562
 bnovak@tailoredeng.com | 608.209.7500

[illegible]

6211

07/2019 13:51:19 |