

FIG. 607.5  
LOCATION OF BATHTUB CONTROLS


**607.8 Water Temperature.** Bathtubs shall deliver water that is 120°F (49°C) maximum.

### 608 Shower Compartments

**608.1 General.** Accessible shower compartments shall comply with Section 608.

**608.2 Size, clearance and seat.** Shower compartments shall have sizes, clearances and seats complying with Section 608.2.

**608.2.1 Transfer-type Shower Compartments.** Transfer-type shower compartments shall comply with Section 608.2.1.

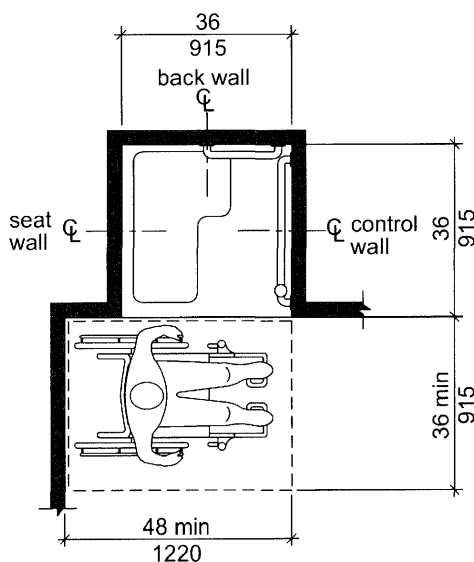

Note: inside finished dimensions measured at the center points of opposing sides

FIG. 608.2.1  
TRANSFER-TYPE SHOWER  
COMPARTMENT SIZE AND CLEARANCE

**608.2.1.1 Size.** Transfer-type shower compartments shall have a clear inside dimension of 36 inches (915 mm) in width and 36 inches (915 mm) in depth, measured at the center point of opposing sides. An entry 36 inches (915 mm) minimum in width shall be provided.

**608.2.1.2 Clearance.** A clearance of 48 inches (1220 mm) minimum in length measured perpendicular from the control wall, and 36 inches (915 mm) minimum in depth shall be provided adjacent to the open face of the compartment.

**608.2.1.3 Seat.** A folding or non-folding seat complying with Section 610 shall be provided on the wall opposite the control wall.

**Exception:** A seat is not required to be installed in a shower for a single occupant, accessed only through a private office and not for common use or public use, provided reinforcement has been installed in walls and located so as to permit the installation of a shower seat.

**608.2.2 Standard Roll-in-type Shower Compartments.** Standard roll-in-type shower compartments shall comply with Section 608.2.2.

**608.2.2.1 Size.** Standard roll-in-type shower compartments shall have a clear inside dimension of 60 inches (1525 mm) minimum in width and 30 inches (760 mm) minimum in depth, measured at the center point of opposing sides. An entry 60 inches (1525 mm) minimum in width shall be provided.

**608.2.2.2 Clearance.** A clearance of 60 inches (1525 mm) minimum in length adjacent to the 60-inch (1525 mm) width of the open face of the shower compartment, and 30 inches (760 mm) minimum in depth, shall be provided.

**EXCEPTION:** A lavatory complying with Section 606 shall be permitted at the end of the clearance opposite the seat.

**608.2.2.3 Seat.** A folding seat complying with Section 610 shall be provided on an end wall.

#### EXCEPTIONS:

1. A seat is not required to be installed in a shower for a single occupant accessed only through a private office and not for common use or public use, provided reinforcement has been installed in walls and located so as to permit the installation of a shower seat.
2. A fixed seat shall be permitted where the seat does not overlap the minimum clear inside dimension required by Section 608.2.2.1.

**608.2.3 Alternate Roll-in-type Shower Compartments.** Alternate roll-in-type shower compartments shall comply with Section 608.2.3.

**608.2.3.1 Size.** Alternate roll-in shower compartments shall have a clear inside dimension of 60 inches (1525 mm) minimum in width, and 36 inches (915 mm) in depth, measured at the center point of opposing sides. An entry 36 inches (915 mm) minimum in width shall be provided at one end of the 60-inch (1525 mm) width of the compartment. A seat wall, 24 inches (610 mm) minimum and 36 inches (915 mm) maximum in length, shall be provided on the entry side of the compartment.

**608.2.3.2 Seat.** A folding seat complying with Section 610 shall be provided on the seat wall opposite the back wall.

**EXCEPTION:** A seat is not required to be installed in a shower for a single occupant, accessed only through a private office and not for common use or public use, provided reinforcement has been installed in walls and located so as to permit the installation of a shower seat.

**608.3 Grab Bars.** Grab bars shall comply with Section 609 and shall be provided in accordance with Section 608.3. Where multiple grab bars are used, required horizontal grab bars shall be installed at the same height above the floor.

**EXCEPTION:** Grab bars are not required to be installed in a shower for a single occupant, accessed only through a private office and not for common use or public use, provided reinforcement has been installed in walls and located so as to permit the installation of grab bars complying with Section 608.3.

**608.3.1 Transfer-Type Showers.** Grab bars for transfer type showers shall comply with Section 608.3.1.


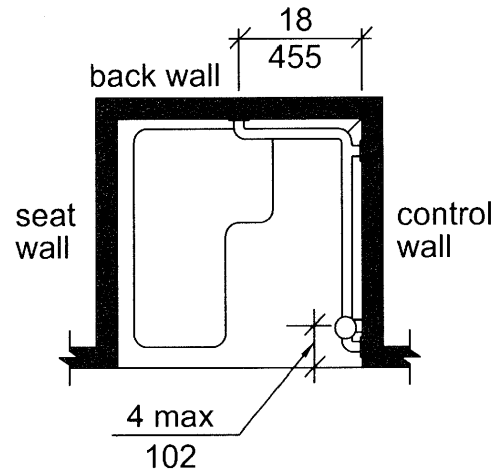


FIG. 608.3.1  
GRAB BARS IN TRANSFER-TYPE SHOWERS


**608.3.1.1 Horizontal Grab Bars.** Horizontal grab bars shall be provided across the control wall and on the back wall to a point 18 inches (455 mm) from the control wall.

**608.3.1.2 Vertical Grab Bar.** A vertical grab bar 18 inches (455 mm) minimum in length shall be provided on the control end wall 3 inches (75 mm) minimum and 6 inches (150 mm) maximum above the horizontal grab bar, and 4 inches (100 mm) maximum inward from the front edge of the shower.

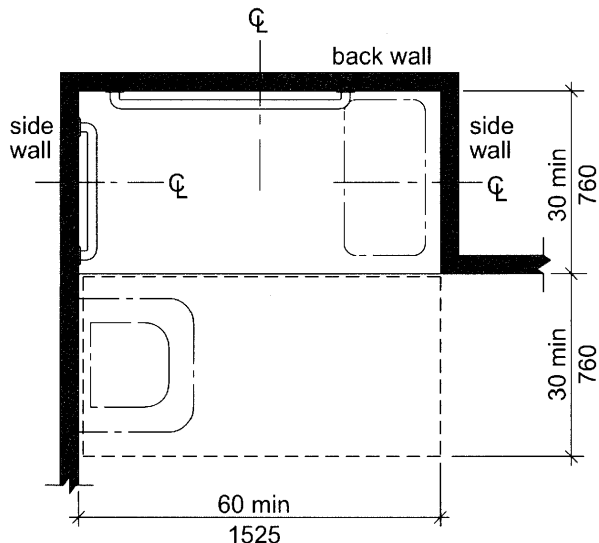

Note: inside finished dimensions measured at the center points of opposing sides

FIG. 608.2.2  
STANDARD ROLL-IN-TYPE SHOWER  
COMPARTMENT SIZE AND CLEARANCE

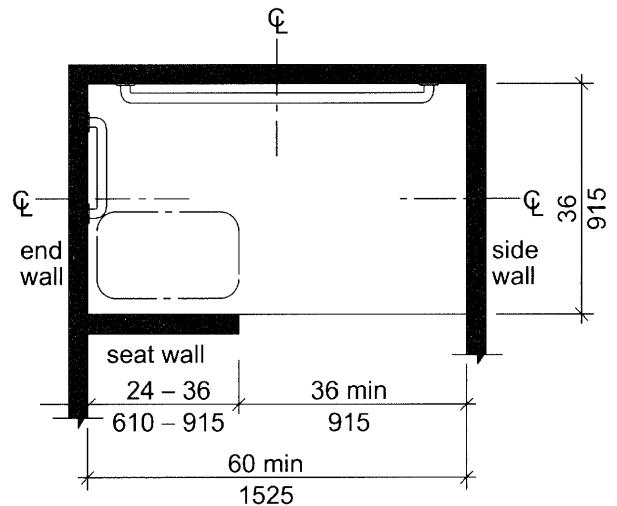

Note: inside finished dimensions measured at the center points of opposing sides

FIG. 608.2.3  
ALTERNATE ROLL-IN-TYPE SHOWER  
COMPARTMENT SIZE AND CLEARANCE