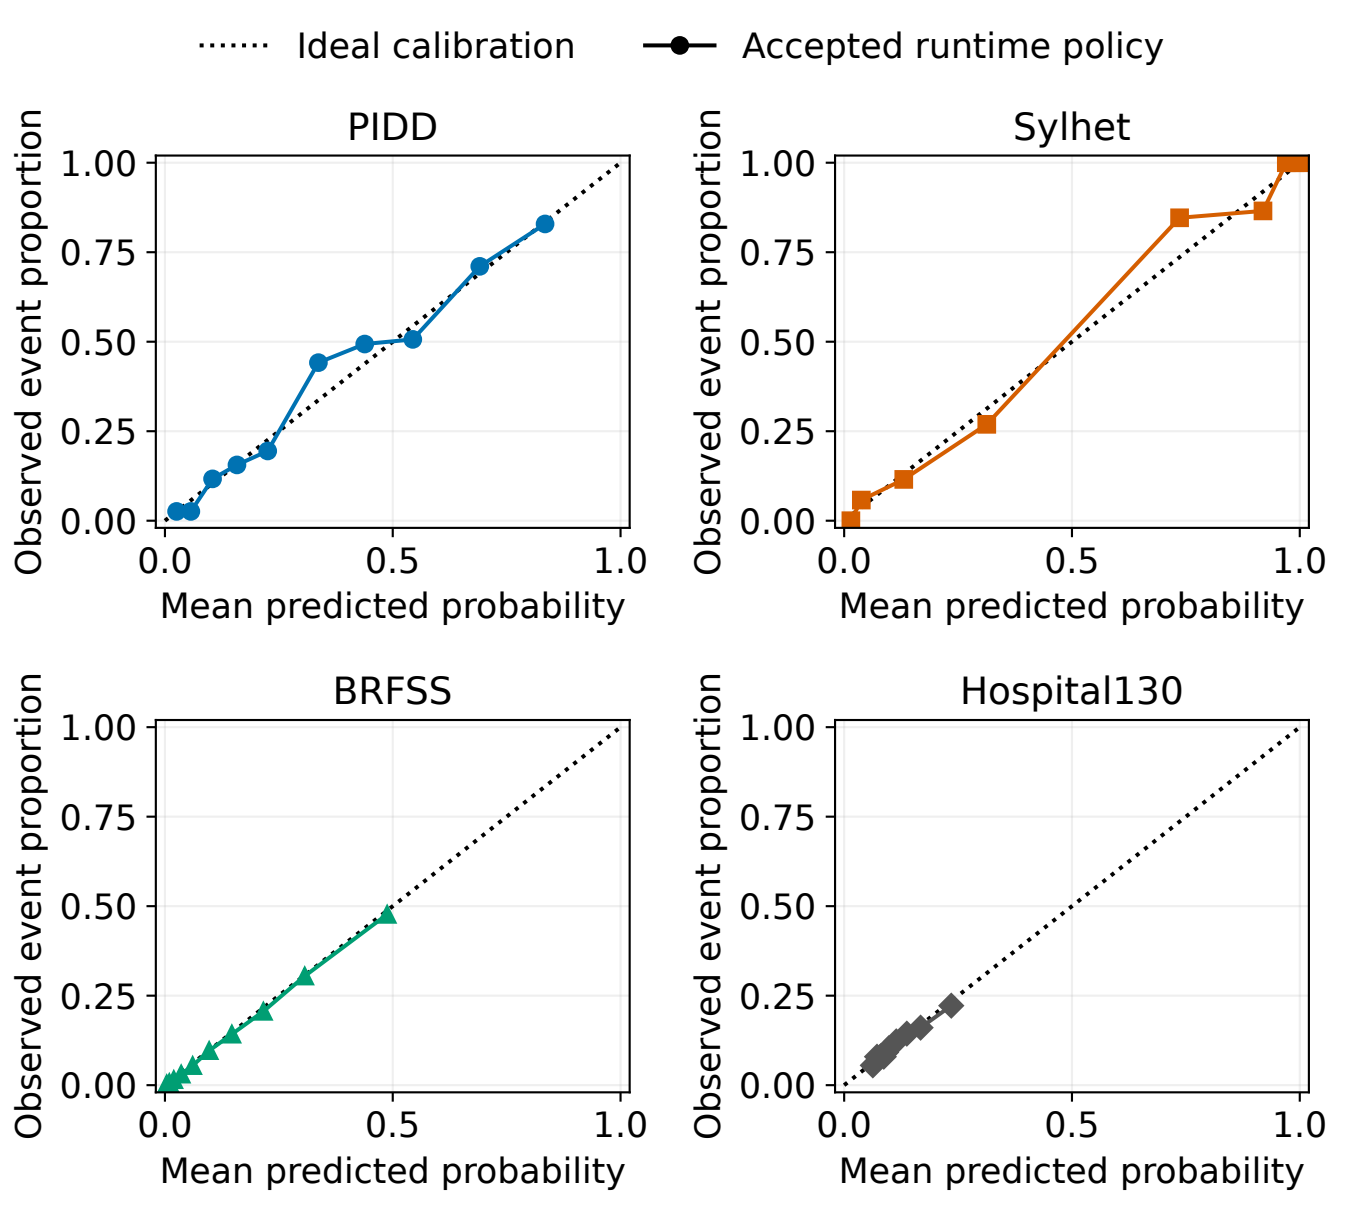
Ideal calibration
Accepted runtime policy
PIDD
Sylhet
BRFSS
Hospital130
Observed event proportion
Mean predicted probability
0.00
0.25
0.50
0.75
1.00
0.0
0.5
1.0