


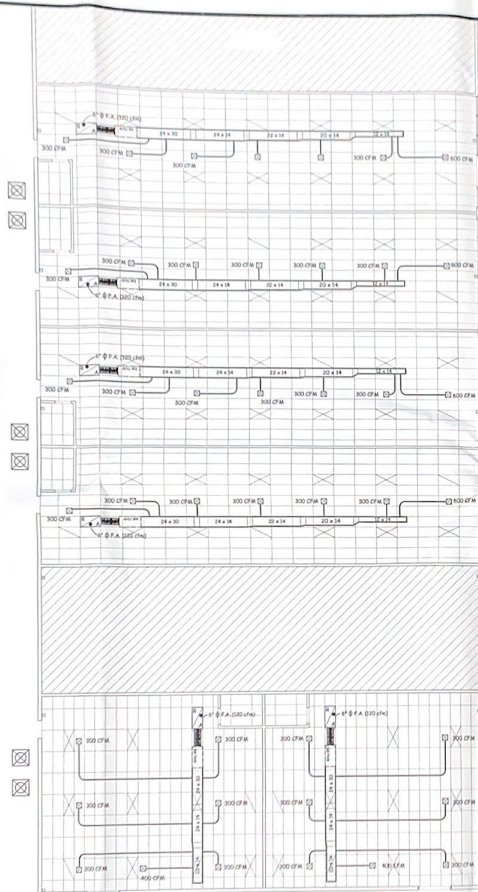

1/8" Mechanical Floor Plan

AC EQUIPMENT SCHEDULE

ANU #	HP	BTU COOLING	CFM	HEAT (BTU)	AIR HANDLER	ELEC HEAT	CONDENSER	ELEC POWER
1.2.3.4	Three	64,000	2,400	11.0	TRACOR 047	BAWHTR1214	TTXAG05A	208, 3 phase
5.6	Three	59,000	2,200	11.5	2-ATEC0504	BAWHTR1315000	TTXAG06A	208, 3 phase

FLEX DUCT SCHEDULE

CFM	DUCT SIZE
300	12" Ø
400	12" Ø
600	12" Ø

REVIEWED FOR:
STATE FIRE MARSHAL
AS PER REVIEW LETTER
BY KYLE W. CLIFFORD ARCHITECT
Kyle Clifford
5/27/18

REVISION	BY

William Z. Orr, AIA
302 Alca Road
Newquinn, LA 70562
(337) 856-4832



The Boulevard Shopping Center
Architects & Builders, Inc.
Lafayette, LA

Final Out of Existing Tenant Space:
STATE FIRE MARSHAL
AS PER REVIEW LETTER
BY KYLE W. CLIFFORD ARCHITECT
Kyle Clifford
5/27/18

DATE	BY
May 5, 2007	WZC
May 5, 2007	WZC
May 5, 2007	WZC
May 5, 2007	WZC
May 5, 2007	WZC

M-1
8 of 10 SHEETS