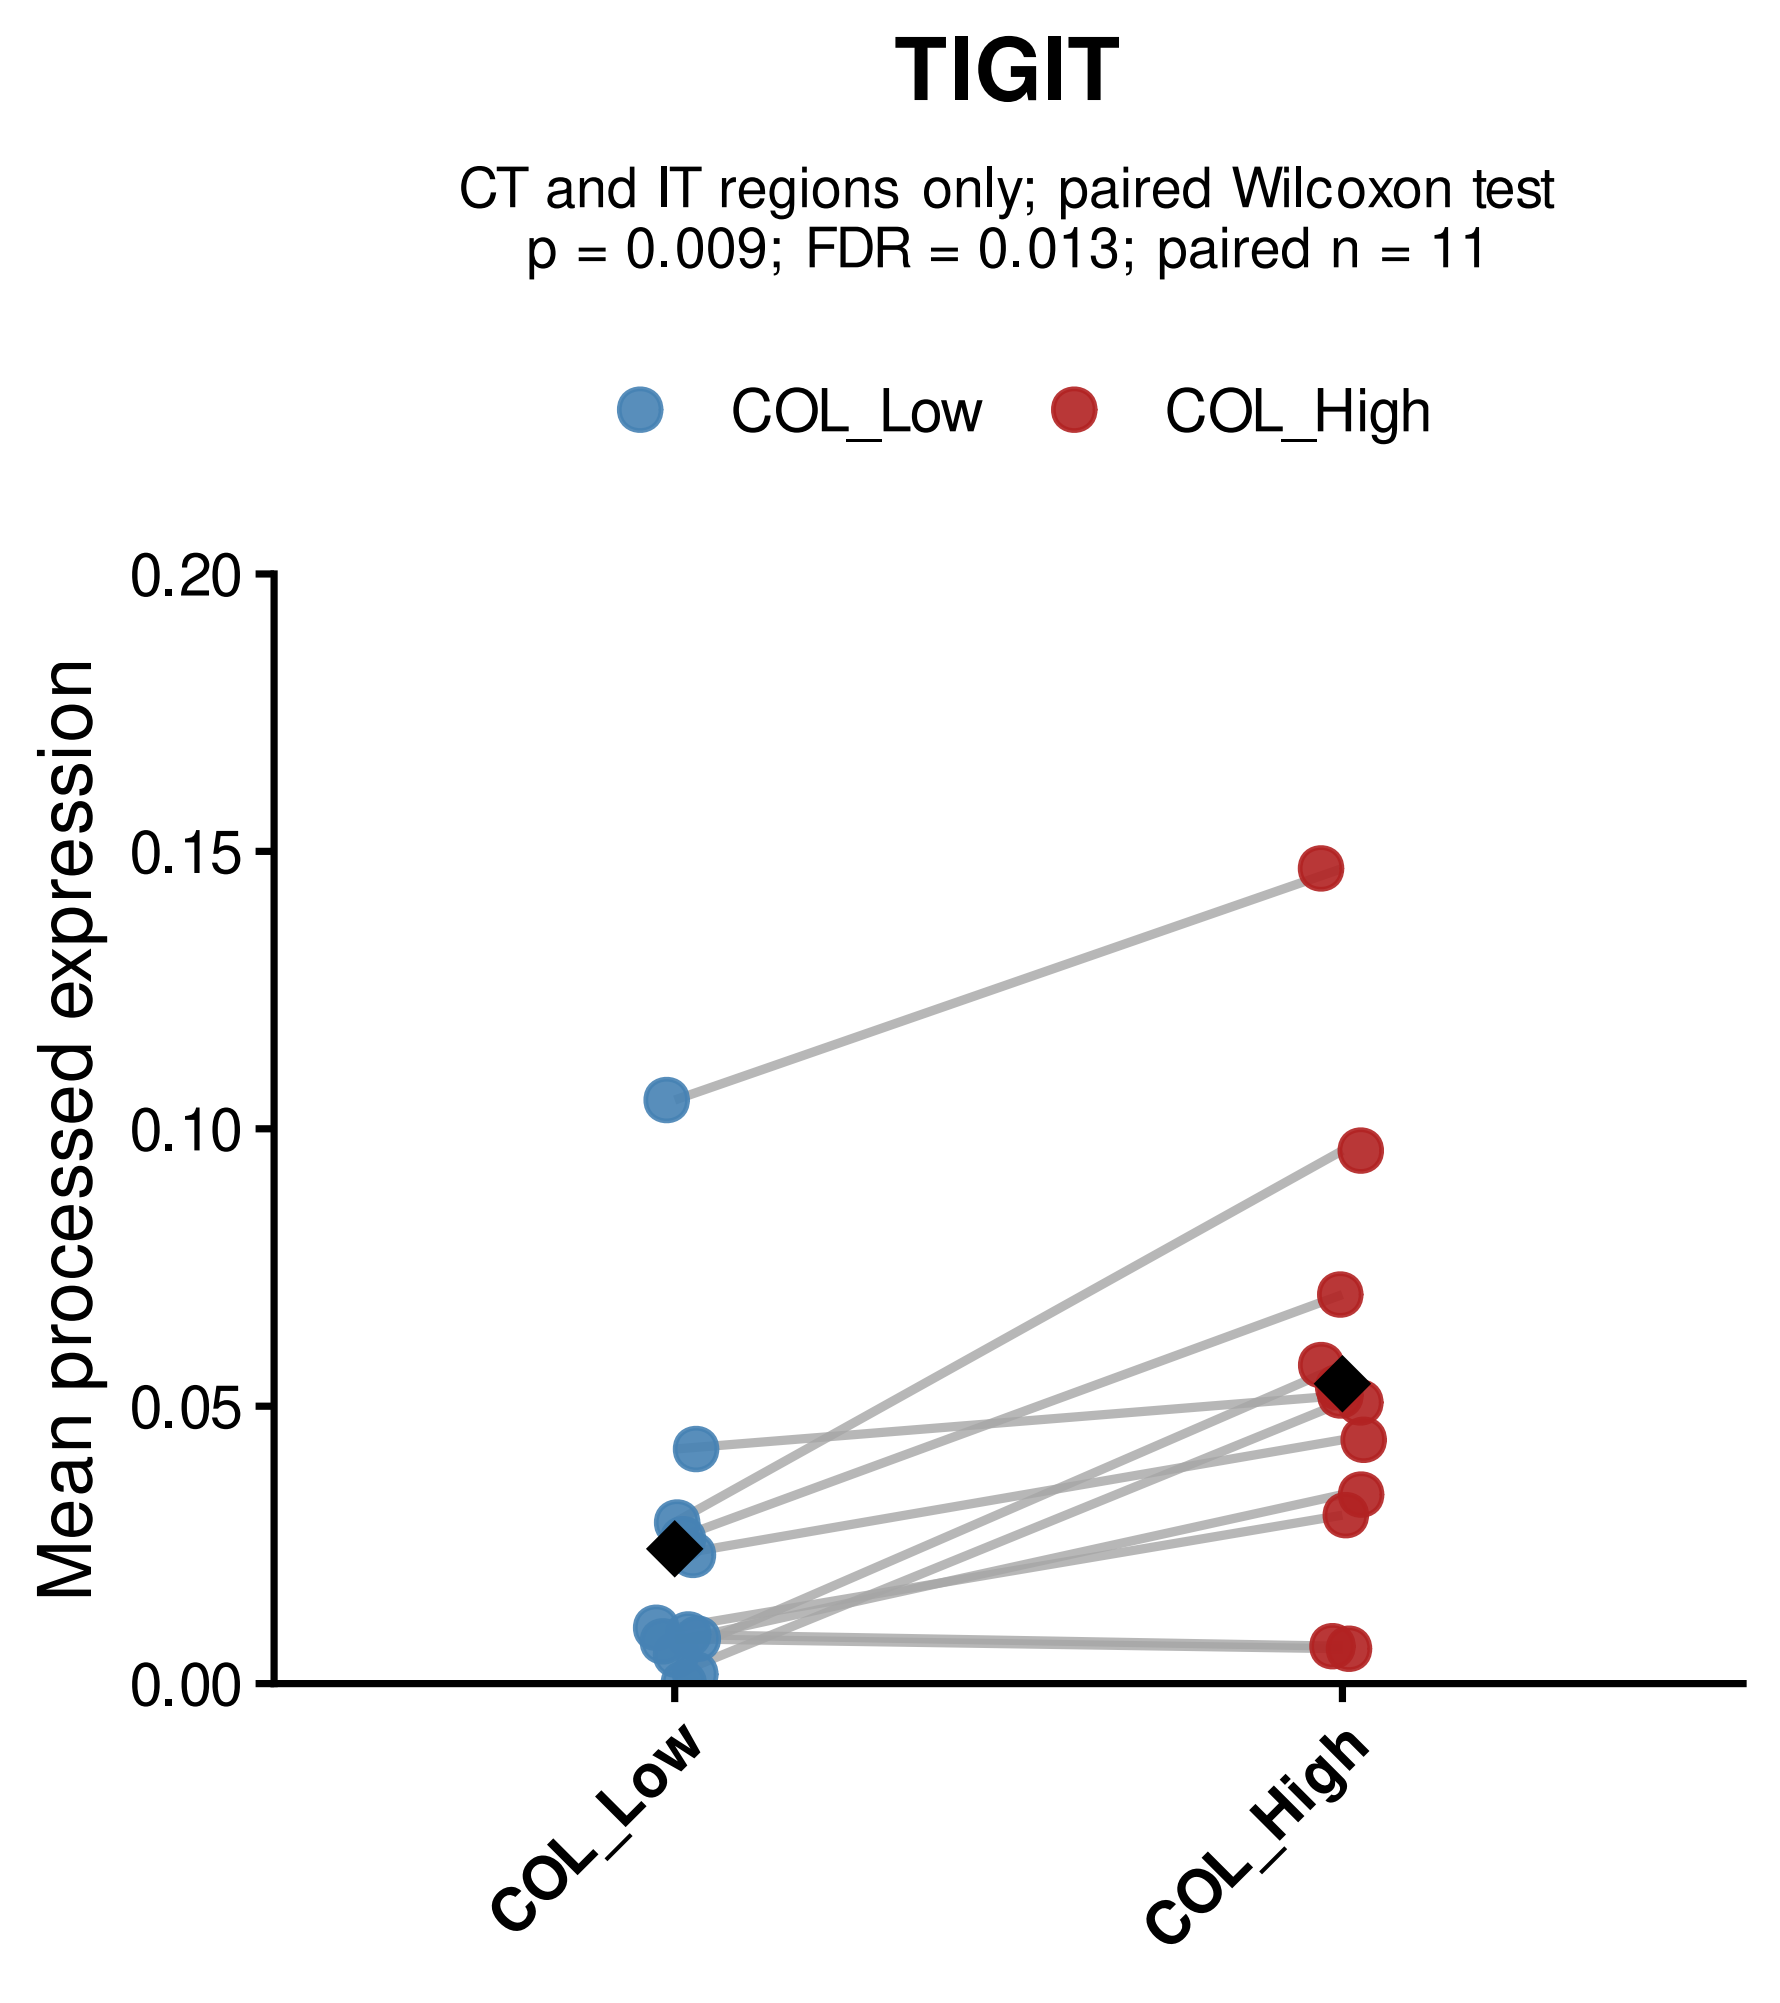
TIGIT
CT and IT regions only; paired Wilcoxon test
p = 0.009; FDR = 0.013; paired n = 11
COL_Low
COL_High
Mean processed expression
0.20
0.15
0.10
0.05
0.00
COL_Low
COL_High