

MIX GRADE	MIX DESCRIPTION	DESIGN REF. CODE	REV	STATUS
M25	Standard structural mix for slab and beam	OR20F207	0	APPROVED

MIX DESIGN SUMMARY		
Compressive Strength (f'ck) at 28 days 25.0 MPa	Standard Deviation (SD) 4.0 MPa	Maximum Aggregate Size 20 mm
Target Mean Strength (f'ck + 1.65 x SD) 31.6 MPa	Free Water / Binder Ratio (W/B) 0.450	Water Content 160 kg/m3
Total Binder (Cement + Fly Ash) 355 kg/m3	Target Workability at Site 100-125	Design Density 2,450 kg/m3


MIX PROPORTIONS (SSD/m3)	
Cement	320 kg/m3
Fly Ash (PFA) — 10% of Binder	35 kg/m3
Total Binder (Cement + Fly Ash)	355 kg/m3
Free Water Content	160 kg/m3
Free Water / Binder Ratio (W/B)	0.450
Fine Aggregate	720 kg/m3
Coarse Aggregate — 20 mm	700 kg/m3
Coarse Aggregate — 12.5 mm	480 kg/m3
Total Aggregate	1,900 kg/m3
Admixture — Sika ViscoCrete, 0.80% of Binder	2.84 kg/m3
Design Density	2,450 kg/m3

MATERIALS — TYPE / SOURCE / SP. GR.		
MATERIAL	TYPE / SOURCE	SP.GR.
Cement	OPC 53 Grade / Dalmia	3.15
Fly Ash (PFA)	Class F / Ramco	2.20
Fine Aggregate	M-Sand / Local Quarry	2.65
Coarse Aggregate — 20 mm	Crushed / Local Quarry	2.70
Coarse Aggregate — 12.5 mm	Crushed / Local Quarry	2.70
Admixture	Sika ViscoCrete	1.10
Maximum Aggregate Size	20 mm	—

AGGREGATE PROPORTIONS		
FRACTION	QTY (kg/m3)	% OF TOTAL
Fine Aggregate	720	38%
Coarse — 20 mm	700	37%
Coarse — 12.5 mm	480	25%
Total	1,900	100%

Coarse / Fine Aggregate Ratio	
COARSE 62%	FINE 38%

Aggregate Proportion

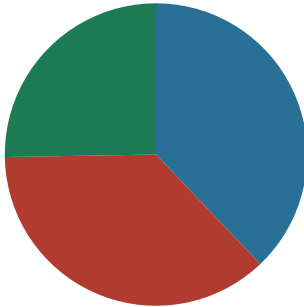

Fine 38% 20 mm 37% 12.5 mm 25%

NOTE
1. Admixture dosage to be adjusted based on ambient temperature and transport time. 2. Moisture correction of aggregates to be carried out daily. 3. All quantities are in SSD condition unless specified.

Quality Control Engineer
Quality Control, Our Own Ready Mix

Disclaimer: This mix design has been prepared in accordance with applicable Indian Standards based on laboratory trials and the materials specified herein. Actual field performance is dependent upon proper batching, transportation, placement, compaction, finishing, curing and site conditions. Any change in material source or characteristics may require review and revision of the mix design.