NE-USB USB Communication
Sample Program
(Excel Macro VBA 64-bit Version)

CONFIDENTIAL

PATLITE Corporation 2018
All rights reserved

Contents

NE-USB USB Communication Sample Program (Excel Macro VBA 64-bit Version) 1
1. Overview 3
1.1. System Overview 3
2. Development Environment 3
2.1. Windows Environment 3
3. Sample Source Overview 4
3.1. Screen Operation 4
3.1.1. Command List 4
3.1.2. LED Control 5
3.1.3. Control Alarm Pattern 5
3.1.4. Control Alarm Volume 6
3.1.5. Control Alarm Pattern and Volume 6
3.1.6. Connection display settings 6
3.1.7. Reset 7

CONFIDENTIAL

PATLITE Corporation 2018
All rights reserved

1. Overview

This is an outline of sample programming to control LR-USB via USB communication.

The programs are intended to control the unit using VBA (64-bit version) without the use of DLLs provided by PATLITE.

1.1. System Overview

The system configuration diagram of this program is as follows.

This program controls one NE-USB by USB communication.

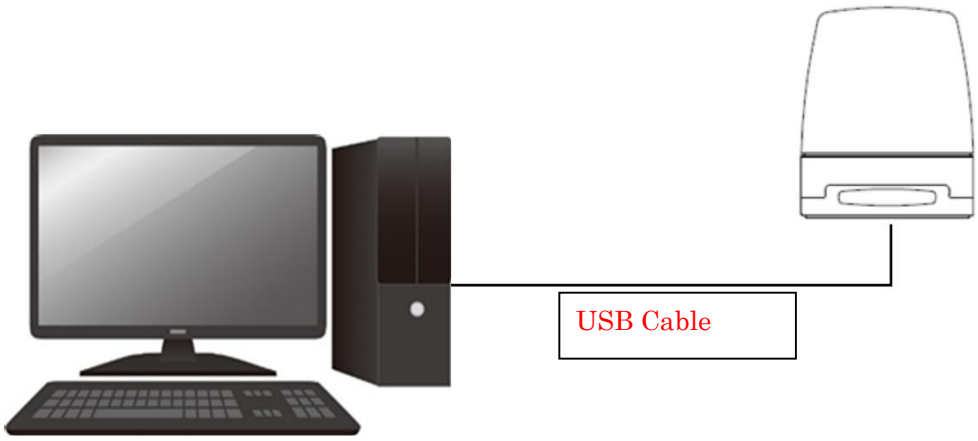

2. Development Environment

The development environment of the sample program is shown below.

2.1. Windows Environment

Development Environment		Remarks
Development OS	Windows 10	
Development Language	VBA	Excel 2013

CONFIDENTIAL

PATLITE Corporation 2018
All rights reserved

3. Sample Source Overview

3.1. Screen Operation

In Excel, the command for each action is executed by clicking the Execute button with the identifier of the command to be executed and the parameters to be used are specified.

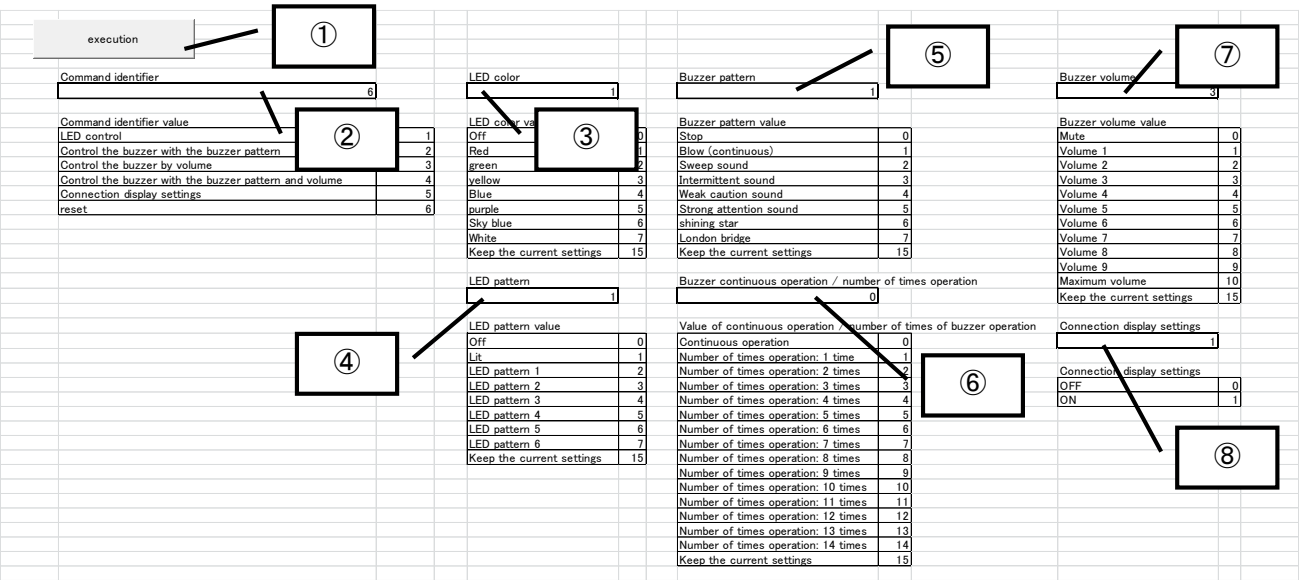

No.	Item Name	Description
①	Execute Button	Executes the command with the specified Command Identifier
②	Command Identifier	Select the Command Identifier to execute
③	LED Color	Set LED color to light
④	LED Pattern	LED lighting pattern
⑤	Alarm Pattern	Alarm sound pattern
⑥	Alarm Continuous Operation and Number of Cycles	Set the number of times the alarm sounds
⑦	Alarm Volume	Set the alarm volume
⑧	Connection Display Settings	Set the display when NE-USB is connected to USB

3.1.1. Command List

Command Name	Description
LED Control	Set LED color and LED pattern to display and activate it.
Control Alarm Pattern	Set the alarm pattern and the number of cycles.
Control Alarm Volume	Set alarm volume and activate it.
Control Alarm Pattern and Volume	Set alarm pattern, number of times, and volume and activate it.
Connection Display Settings	Change the display settings when connecting.
Reset	Turn off all LED units and stop the alarm.

CONFIDENTIAL

PATLITE Corporation 2018
All rights reserved

3.1.2. LED Control

Set the following values on Excel and press the execute button to execute the command.

No.	Command Line Arguments	Value
1	Command Identifier	1
2	LED Color	Off: 0 Red: 1 Green: 2 Amber: 3 Blue: 4 Purple: 5 Sky Blue: 6 White: 7 No change: 15
3	LED Pattern	Off: 0 Lit: 1 LED pattern 1: 2 LED pattern 2: 3 LED pattern 3: 4 LED pattern 4: 5 LED pattern 5: 6 LED pattern 6: 7 No change: 15

3.1.3. Control Alarm Pattern

Set the following values on Excel and press the execute button to execute the command.

No.	Command Line Arguments	Value
1	Command Identifier	2
2	Alarm Pattern	Stop: 0 Sounding (Continuous): 1 Sweep sound: 2 Intermittent sound: 3 Weak warning sound: 4 Strong warning sound: 5 Twinkle, Twinkle Little Star: 6 London Bridge: 7 No change: 15
3	Alarm Continuous Operation and Number of Cycles	Continuous cycles: 0 Number of cycles: 1 to 1 4

CONFIDENTIAL

PATLITE Corporation 2018
All rights reserved

		No change: 15

3.1.4. Control Alarm Volume

Set the following values on Excel and press the execute button to execute the command.

No.	Command Line Arguments	Value
1	Command Identifier	3
2	Alarm Volume	Mute: 0 Volume: 1-9 Maximum volume: 10 No change: 15

3.1.5. Control Alarm Pattern and Volume

Set the following values on Excel and press the execute button to execute the command.

No.	Command Line Arguments	Value
1	Command Identifier	4
2	Alarm Pattern	Stop: 0 Sounding (Continuous): 1 Sweep sound: 2 Intermittent sound: 3 Weak warning sound: 4 Strong warning sound: 5 Twinkle, Twinkle Little Star: 6 London Bridge: 7 No change: 15
3	Alarm Continuous Operation and Number of Cycles	Continuous operation: 0 Number of cycles: 1 to 1 4 No change: 15
4	Alarm Volume	Mute: 0 Volume: 1-9 Maximum volume: 10 No change: 15

3.1.6. Connection display settings

Set the following values on Excel and press the execute button to execute the command.

No.	Command Line Arguments	Value
1	Command Identifier	5
2	Connection Display Settings	OFF: 0 ON: 1

CONFIDENTIAL

PATLITE Corporation 2018
All rights reserved

3.1.7. Reset

Set the following values on Excel and press the execute button to execute the command.

No.	Command Line Arguments	Value
1	Command Identifier	6

CONFIDENTIAL

PATLITE Corporation 2018
All rights reserved