



**CNP P.H. Robinson to W.A. Parish
345-kV Hardening Project – ERCOT
Independent Review (EIR) Status Update**


Tanzila Ahmed

RPG Meeting
November 11, 2025

Introduction

- CenterPoint Energy (CNP) submitted the P.H. Robinson to W.A. Parish 345-kV Hardening Project (25RPG028) for Regional Planning Group (RPG) review in August 2025
 - This Tier 1 project is estimated cost to cost approximately \$511.3 million and will not require a Certificate of Convenience and Necessity (CCN)
 - Estimated in-service date (ISD) is December 2028
 - This project is needed to address aging infrastructure and to ensure resilience against hurricane-force winds and extreme cold conditions in the Brazoria, Ft. Bend, and Galveston Counties
- Oncor presented project overview and ERCOT presented EIR Scope at the September RPG meeting
 - <https://www.ercot.com/calendar/09252025-RPG-Meeting>
- ERCOT presented EIR status update at the October RPG meeting
 - <https://www.ercot.com/calendar/10282025-RPG-Meeting>
- ERCOT is currently conducting an ERCOT Independent Review (EIR)

Recap – Map with Project Need Seen by CNP

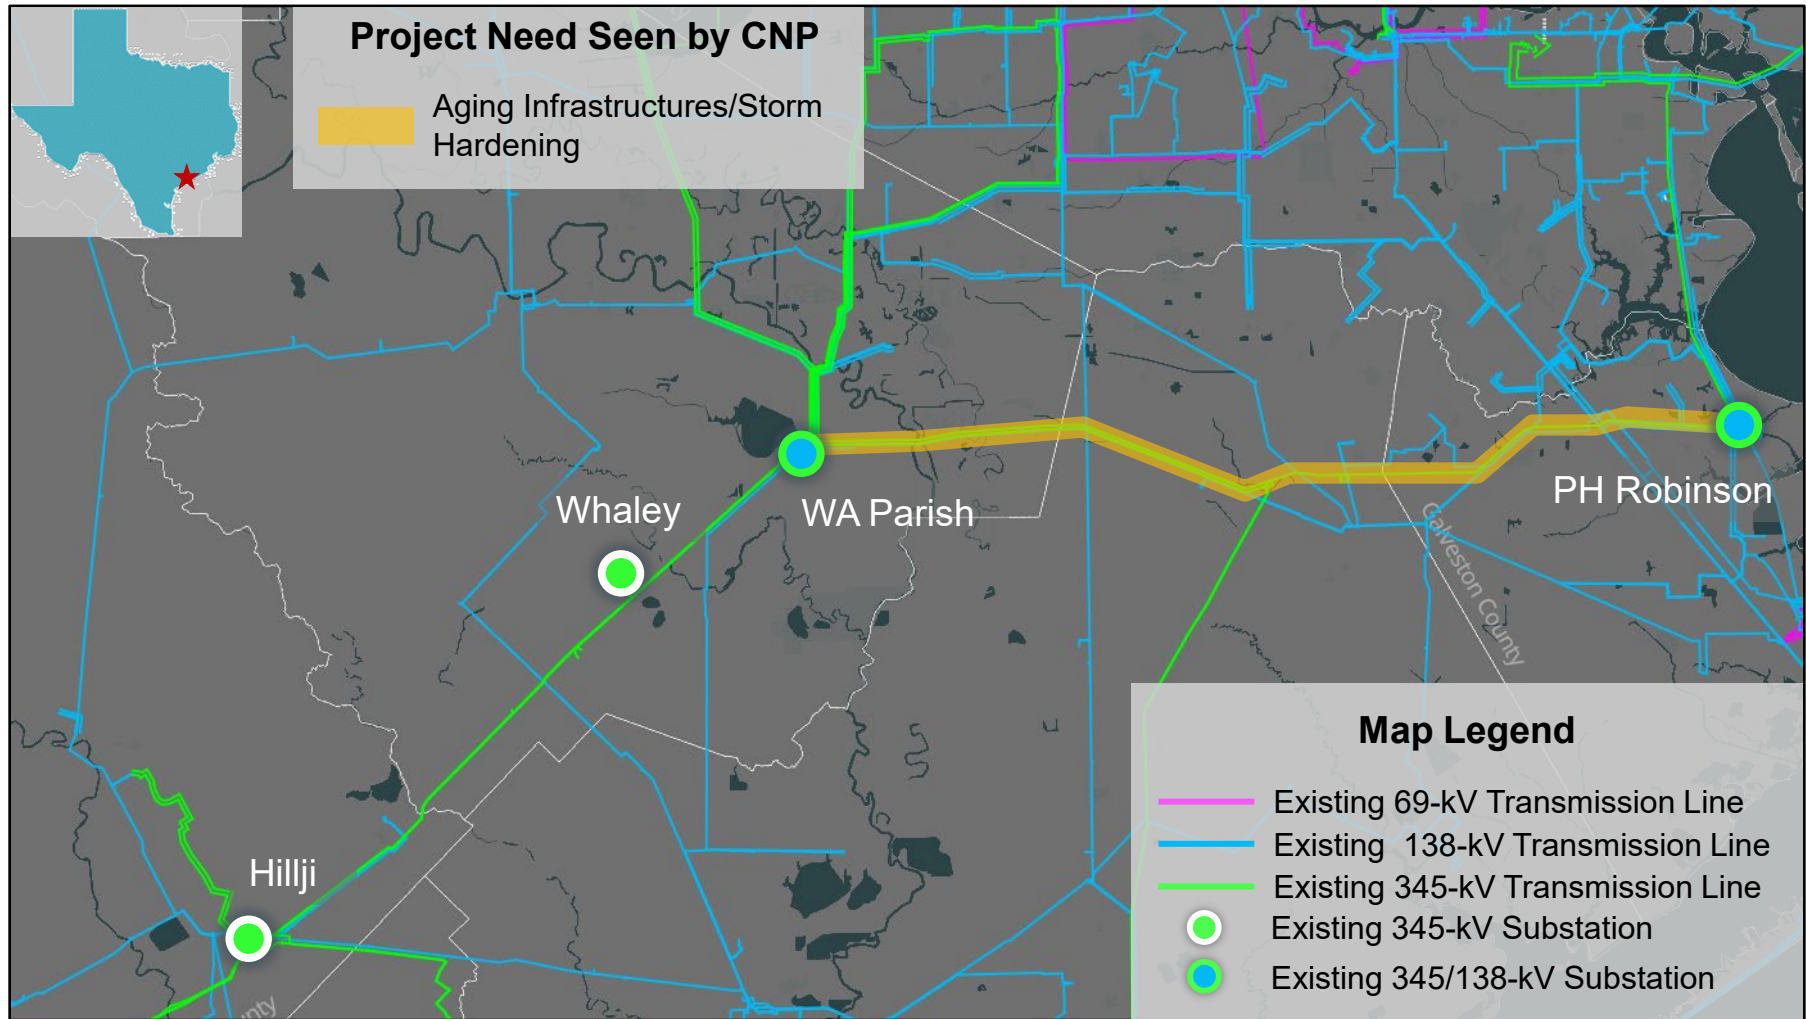

Recap – Preliminary Results of Reliability Assessments

- ERCOT conducted steady-state load flow analysis for the study base case according to the NERC TPL-001-5.1 and ERCOT Planning Criteria to identify project need and to evaluate the proposed option

	N-1		G-1*+N-1		X-1**+N-1		Unsolved Powerflow
	Thermal Violations	Voltage Violations	Thermal Violations	Voltage Violations	Thermal Violations	Voltage Violations	
Base case	None	None	None	None	None	None	None
CNP Proposed Project	None	None	None	None	None	None	None

* G-1: Cedar Bayou, South Texas Project (STP), and W.A. Parish generations

** X-1: Cedar Bayou, Obrian, and P.H. Robinson 345/138-kV transformers

Status Update

- ERCOT did not identify any reliability need in the study area for the submitted RPG project based on NERC and ERCOT Planning Criteria
- ERCOT conducted additional evaluations for the project proposed by CNP in accordance with the ERCOT Planning Criteria
 - Load Scaling Sensitivities per Planning Guide Section 3.1.3(4)
 - Subsynchronous Resonance (SSR) Assessment per Nodal Protocol Section 3.22.1.3

Load Scaling Sensitivity Analyses

- Load Scaling Sensitivity Analysis
 - Planning Guide Section 3.1.3(4)(b) requires an evaluation of the potential impact of load scaling on the criteria violations seen in this EIR. Starting 2024, ERCOT RTP adopted a new methodology of having one summer peak case for each study year with non-coincident peaks for each of the Weather Zones, which would eliminate the load scaling impact. The study case did not include load scaling as such load scaling sensitivity analysis is no longer needed

Subsynchronous Resonance (SSR) Assessment

- SSR Assessment was conducted for project proposed by CNP per Nodal Protocol Section 3.22.1.3
 - ERCOT found no adverse SSR impacts to the existing and planned generation resources at the time of this study

Next Steps and Tentative Timeline

- Additional analyses to be performed on the preferred option
 - Congestion Analysis to ensure that the identified transmission upgrades do not result in new congestion within the study area
 - Generation Addition
 - Planning Guide Section 3.1.3(4)
- Tentative Timelines
 - Status updates at the future RPG meetings
 - Final recommendation – Q4 2025

Thank you!



Stakeholder comments also welcomed through:

Tanzila.Ahmed@ercot.com

Robert.Golen@ercot.com

Appendix A – Proposed Project by CNP

- Rebuild/reconductor the existing P.H. Robinson to W.A. Parish 345-kV double-circuit transmission line, with a normal and emergency ratings of at least 2,987 MVA, approximately 40.2-mile:
 - Rebuild/reconductor the existing P.H. Robinson to Meadow Ckt.99 345-kV double-circuit transmission line, on double-circuit-capable steel structures with only one circuit in place, approximately 17.4-mile;
 - Ckt.93 will be rebuilt to the North of Ckt.99A within the existing transmission right of way (ROW). Ckt.99 will be rebuilt on double-circuit-capable lattice structures with conductor on both sides of the towers. One side will be Ckt.99, while the other side will be an energized tap;
 - Rebuild the existing Meadow to Oasis Ckt.99 345-kV double-circuit transmission line, on double-circuit-capable steel structures with only one circuit in place, approximately 3.18-mile;
 - Rebuild the existing Oasis to W.A. Parish Ckt.99 and Oasis to W.A. Parish Ckt.18 345-kV double-circuit transmission line on double-circuit-capable steel structures with both circuit in place, approximately 19.6-mile;
 - Upgrade the existing Oasis 345-kV substation to 63 kAIC fault duty breaker rating;
 - Upgrade substation equipment to 5,000A;

Appendix B – Transmission Projects Added

- List of recently approved RPG transmission projects added to study base case

RPG/TPIT No	Project Name	Tier	Project ISD	From County
63922	Tiki Island Distribution Upgrades	4	5/31/2026	Galveston
66208	Rebuild League City-Hidden Lakes with bundled 795 ACSS	4	5/31/2026	Galveston
73352A	PH Robinson Area 138kV Upgrades	4	10/31/2026	Galveston
72032	Stewart to West Bay Ckts 48A & 59A Upgrades	4	12/31/2027	Galveston

Appendix C – New Generation Projects Added

- List of new generation, that met the Planning Guide 6.9(1) condition, added to the study base case

GINR	Project Name	Fuel	Projected COD	Max Capacity (~MW)	County
23INR0029	Cedar Bayou 5 (TEF - Due Diligence)	GAS	12/15/2027	697.0	Chambers
23INR0137	BRP Diran BESS	OTH	1/31/2028	100.6	Wharton
24INR0493	Crowned Heron BESS 2	OTH	3/31/2026	154.2	Fort Bend
24INR0584	Houston IV BESS	OTH	6/3/2026	164.6	Harris
25INR0068	High Chap Solar	SOL	6/26/2028	152.3	Brazoria
25INR0102	Austin Bayou Solar	SOL	6/1/2027	753.4	Brazoria
25INR0103	Elio BESS	OTH	8/5/2027	317.2	Brazoria
25INR0319	Northington Solar	SOL	7/15/2027	129.8	Wharton
25INR0425	Aldrin 345 BESS	OTH	12/1/2027	362.0	Brazoria
26INR0189	Skipjack Energy Storage	OTH	2/28/2028	154.0	Brazoria
26INR0226	First Capitol BESS	OTH	5/1/2027	256.2	Brazoria
26INR0250	Duffy BESS	OTH	9/15/2026	235.9	Matagorda
26INR0333	VERTUS ENERGY STORAGE	OTH	2/1/2026	200.0	Galveston
26INR0405	Buffalo Creek BESS	OTH	6/1/2026	250.0	Fort Bend
27INR0224	Leopard BESS	OTH	7/9/2028	264.2	Victoria