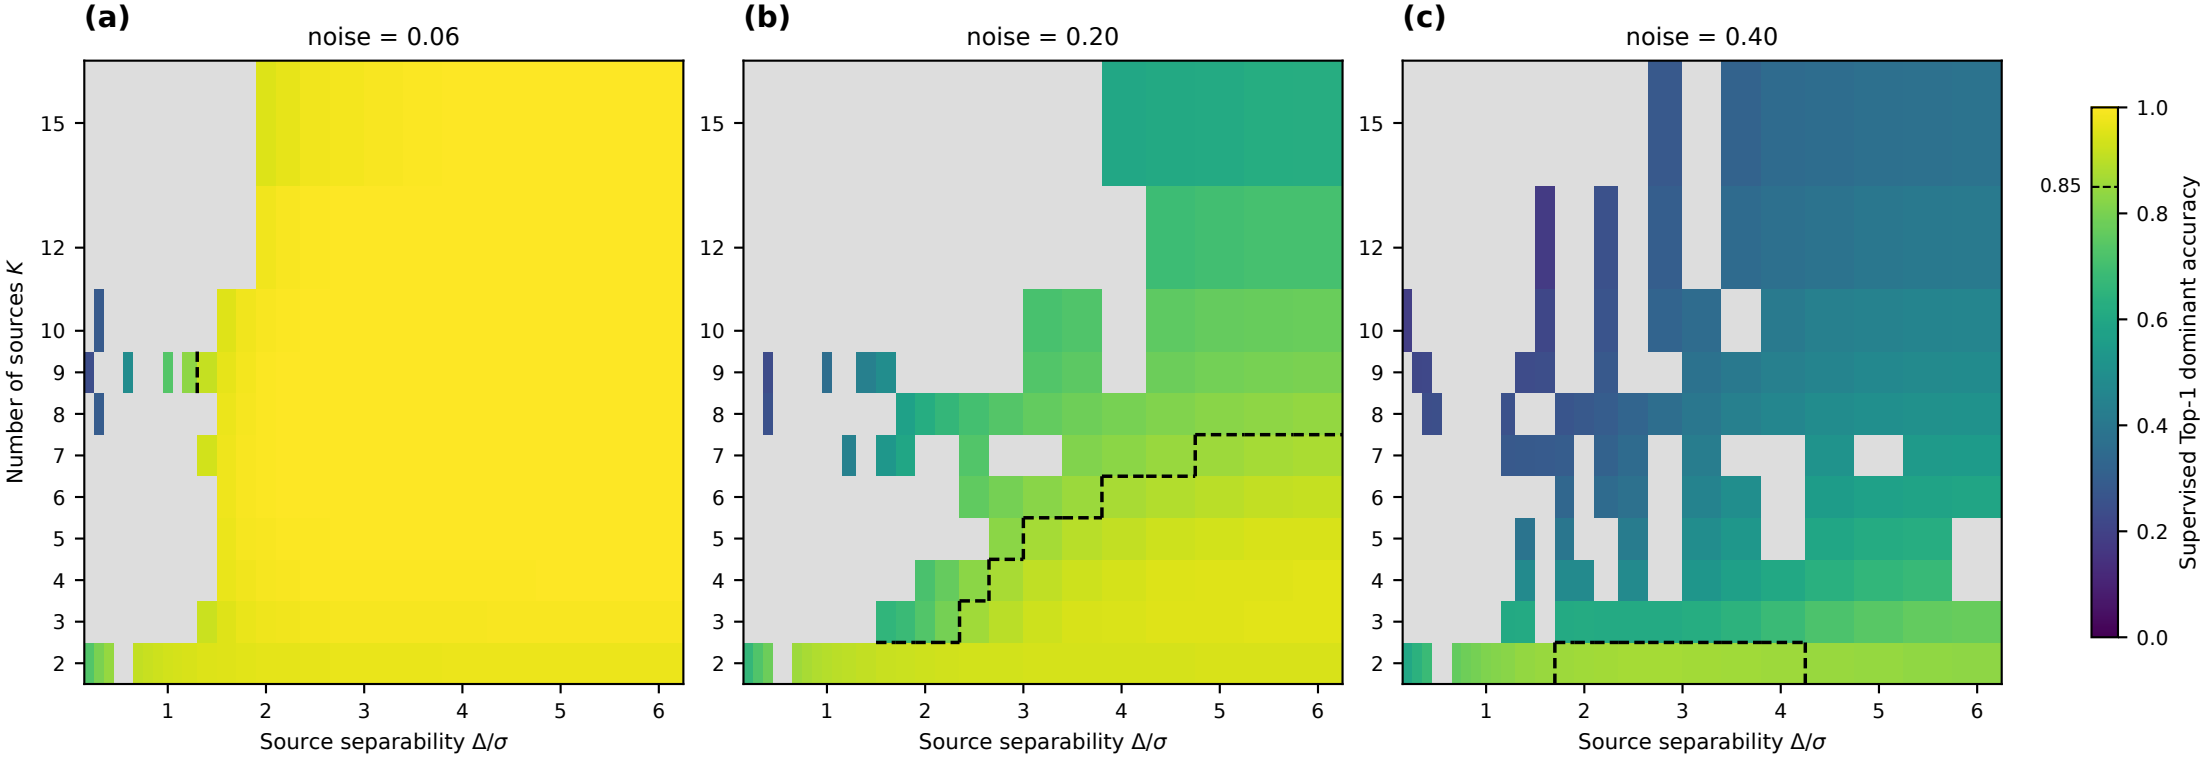
(a)
noise = 0.06
(b)
noise = 0.20
(c)
noise = 0.40
Number of sources K
Source separability Δ/σ
Source separability Δ/σ
Source separability Δ/σ
Supervised Top-1 dominant accuracy
0.85