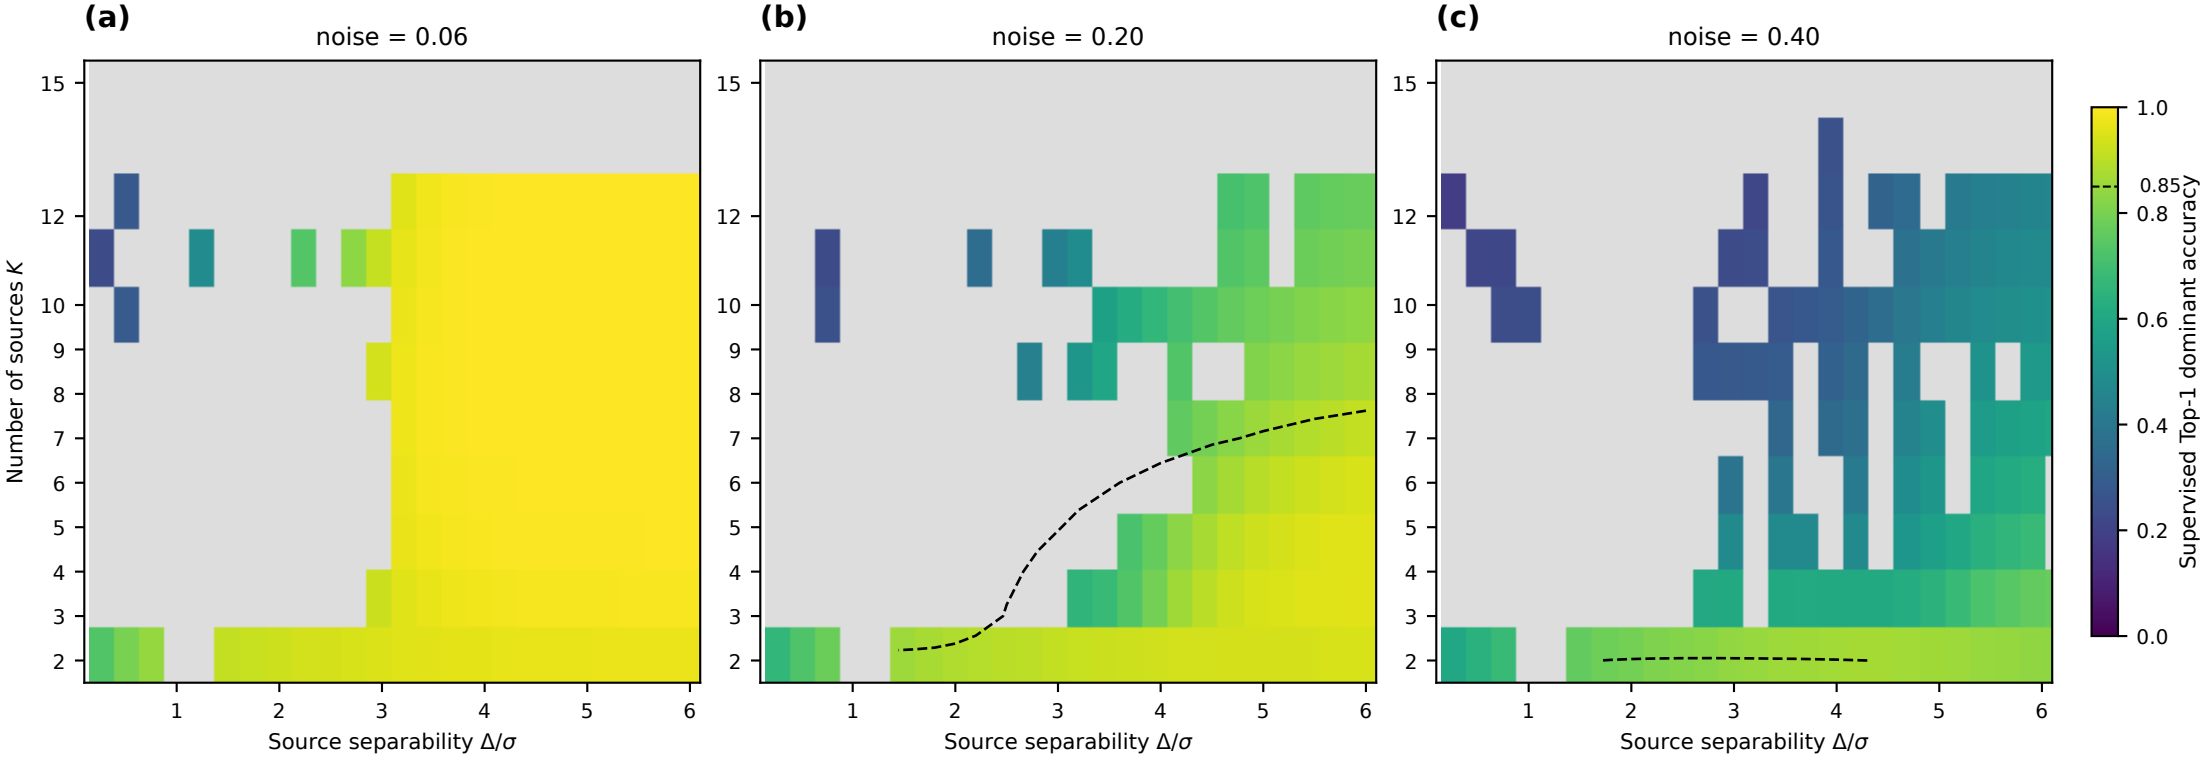
(a)
noise = 0.06
(b)
noise = 0.20
(c)
noise = 0.40
Number of sources K
Source separability Δ/σ
Supervised Top-1 dominant accuracy
0.0
0.2
0.4
0.6
0.8
0.85
1.0