
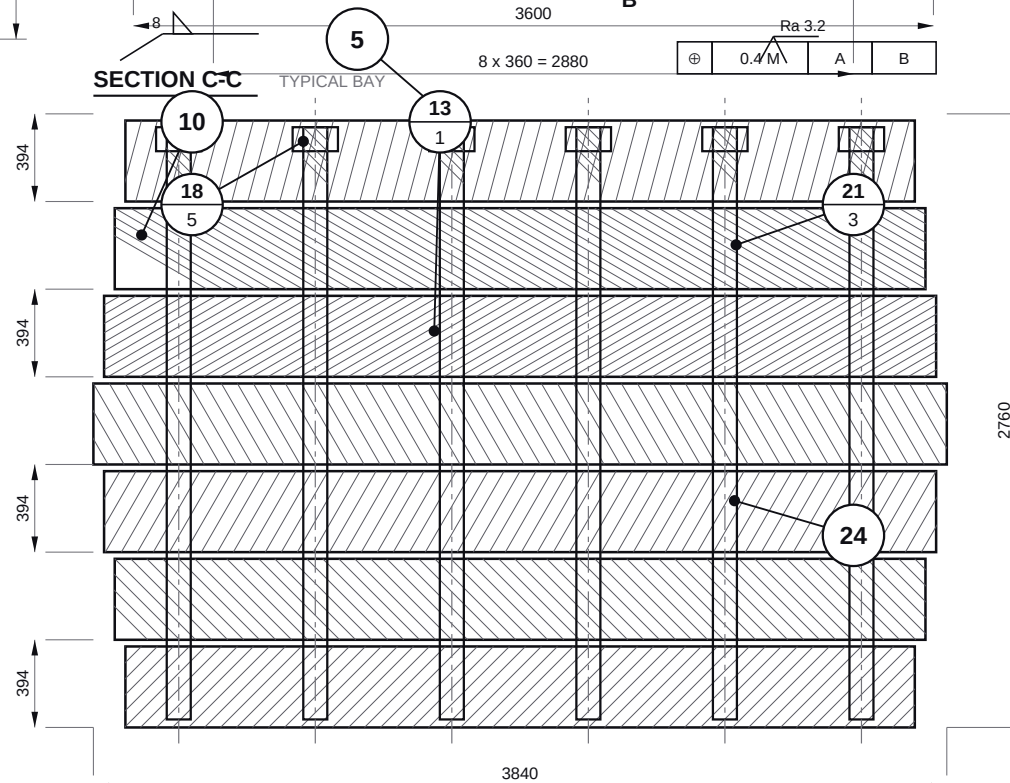
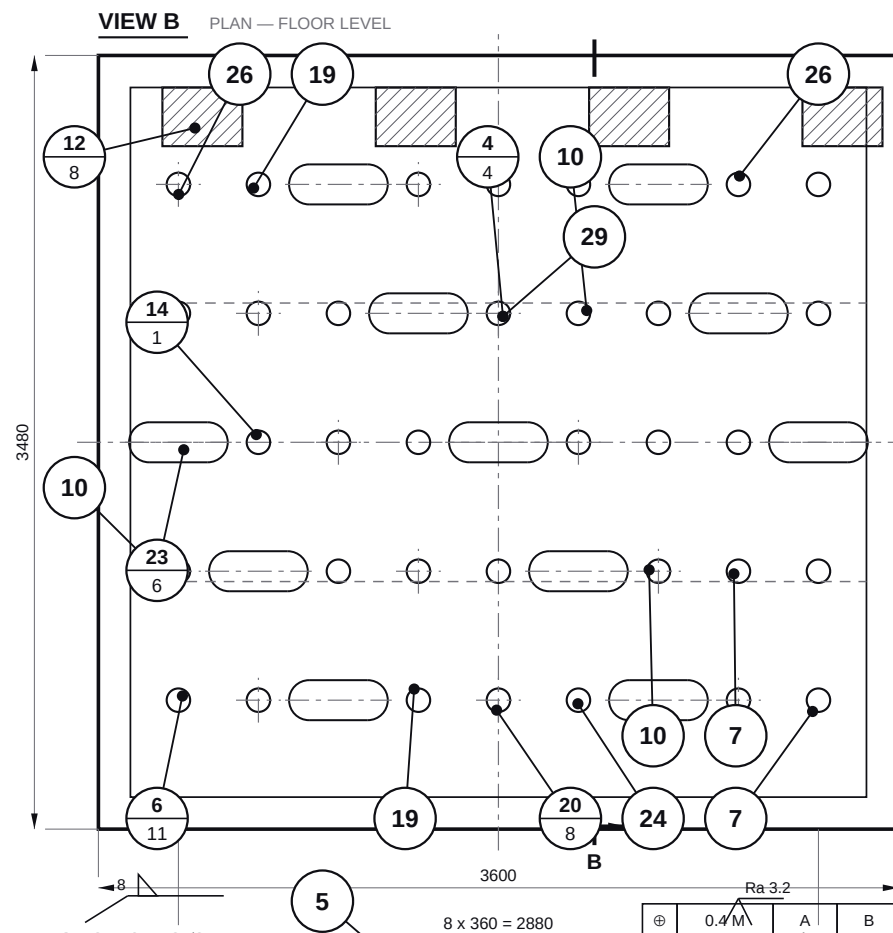


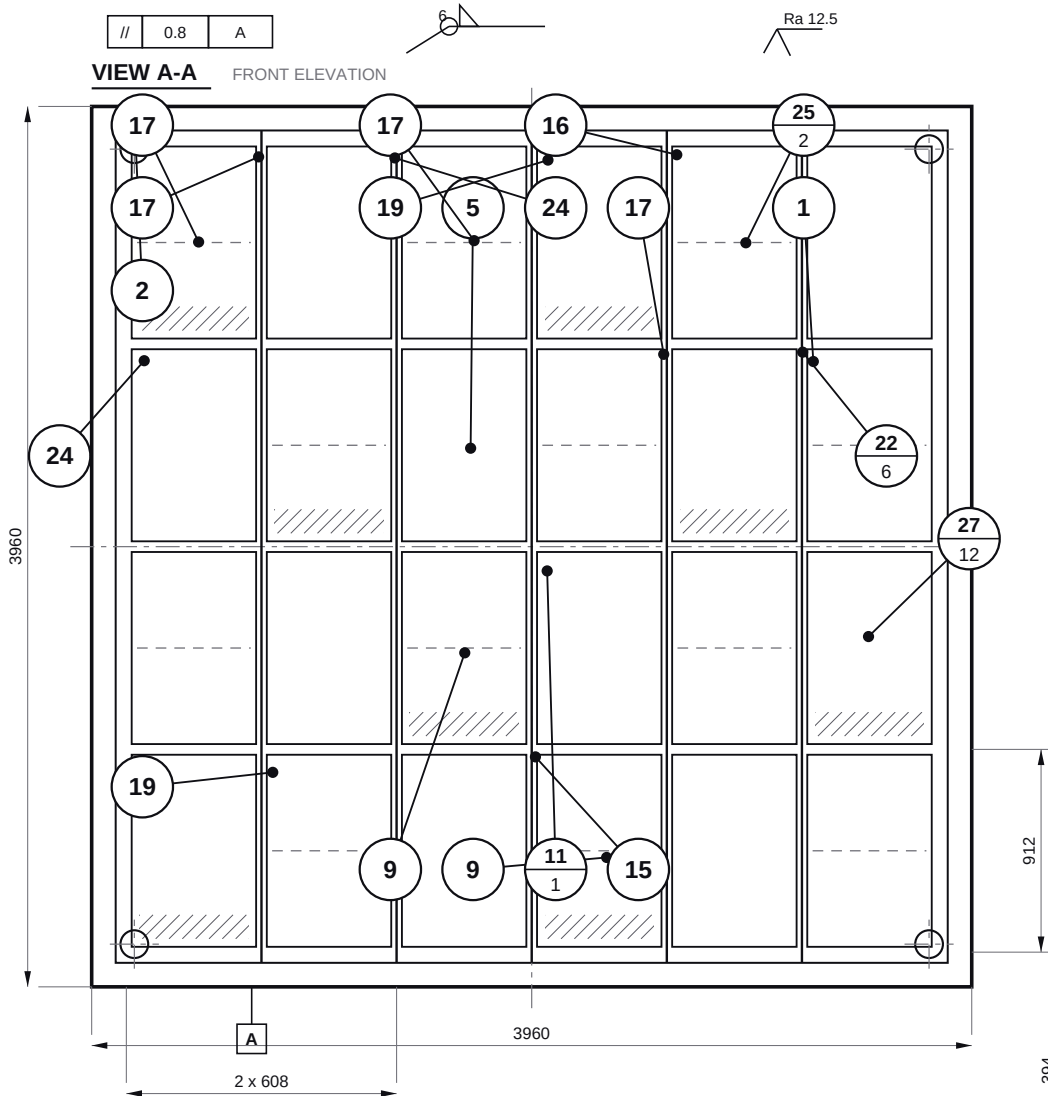

REV	DESCRIPTION	DATE	BY
A	ISSUED FOR INTERNAL REVIEW	2026-05-22	AP
B	BOM RESTRUCTURED PER ERP LOAD	2026-07-03	AP
C	BALLOONING UPDATED, QTY REVISED	2026-08-14	AP

ITEM	PART NUMBER	DESCRIPTION	MATERIAL / SPEC	QTY
27	CTN-2400-027	ARC FLASH LABEL SET	ANSI Z535.4	12
26	CTN-2400-026	NAMEPLATE, SS316 ETCHED	SS316 1.5mm	2
25	CTN-2400-025	PRESSURE RELIEF VENT PANEL	EN 14797	2
24	CTN-2400-024	H2 / VOC GAS DETECTOR	EN 60079-29-1	4
23	CTN-2400-023	SMOKE DETECTOR, OPTICAL	EN 54-7	6
22	CTN-2400-022	LED LUMINAIRE, 40W, EM 3h	IP65 / EN 60598	6
21	CTN-2400-021	EMERGENCY STOP STATION	IP66 / EN ISO 13850	3
20	CTN-2400-020	TWIST LOCK CORNER CASTING	GS-20Mn5 / ISO 1161	8
19	CTN-2400-019	LIFTING LUG, 12T SWL	S355J2+N / DIN 82101	4
18	CTN-2400-018	CABLE ENTRY GLAND PLATE	AL 5754 H22 6mm	6
17	CTN-2400-017	EARTH BAR, CU 50x6, TINNED	CU-ETP / EN 13601	4
16	CTN-2400-016	AUX DISTRIBUTION BOARD, 400V	IP54 / IEC 61439-1	1
15	CTN-2400-015	AUXILIARY TRANSFORMER 20kVA	DYN11 / IEC 60076	1
14	CTN-2400-014	EMS GATEWAY, IEC 61850 / MODBUS	DIN RAIL 35mm	1
13	CTN-2400-013	BMS MASTER CONTROLLER, MBMS-3	IEC 61508 SIL2	1
12	CTN-2400-012	AEROSOL SUPPRESSION CANISTER	NFPA 2010	8
11	CTN-2400-011	FIRE PANEL, ASPIRATING VESDA	IEC 62599-1	1
10	CTN-2400-010	HVAC UNIT, 12kW, R410A	IP55 / EN 14511	4
9	CTN-2400-009	PCS SKID ASSY (SEE SHT 5)	SUB-ASSEMBLY	2
7	CTN-2400-008	DC COMBINER PANEL, 1500V 630A	IP55 / IEC 61439-2	2
6	CTN-2400-006	BATTERY RACK ASSY (SEE SHT 2)	SUB-ASSEMBLY	12
5	CTN-2400-005	PERSONNEL DOOR, 900x2000, EI60	GALV STEEL / EN 1634-1	2
4	CTN-2400-004	ROOF PANEL, INSULATED 120mm	PUR CORE / ROCKWO...	4
3	CTN-2400-003	SIDE WALL PANEL, INSULATED 100mm	PUR CORE / ROCKWO...	6
2	CTN-2400-002	BASE FRAME WELDMENT ASSY	S355J2 / EN 10025-2	1
1	CTN-2400-001	CONTAINER SHELL, 20FT ISO, CORTEN	COR-TEN A / EN 10025-5	1

TOTAL PART COUNT THIS SHEET: 111 PCS (ROLL-UP FROM ERP BOM LOAD)

NOTES:


1. ASSEMBLE PER WORK INSTRUCTION WI-BESS-2400-ASM REV D.
2. ALL DC TERMINATIONS TORQUED TO 45 Nm ± 5% AND TORQUE SEALED.
3. IP RATING OF COMPLETED ENCLOSURE: IP55 PER IEC 60529.
4. CONTAINER TO BE EARTHED AT BOTH DIAGONALLY OPPOSITE BOSSES.
5. WEIGHTS SHOWN ARE DRY, EXCLUDING ELECTROLYTE TRANSPORT PACKAGING.
6. QUANTITIES IN BOM ARE PER CONTAINER UNLESS NOTED (PER RACK).

GENERAL TOLERANCES ISO 2768-mK
 LINEAR 0.5 - 6 : ± 0.1 6 - 30 : ± 0.2 30 - 120 : ± 0.3
 ANGULAR $\pm 0^{\circ}30'$ WELD PROFILE PER ISO 5817 CLASS B
 SURFACE Ra 6.3 UNLESS OTHERWISE STATED
 DO NOT SCALE DRAWING — REFER LATEST REV ONLY

DRAWN	A. PATIL	2026-08-14
CHECKED	R. MEHTA	2026-08-14
APPROVED	S. IYER	2026-08-14

L&T TECHNOLOGY SERVICES

ENERGY — GRID & STORAGE ENGINEERING / VADODARA







DRAWING TITLE

BESS CONTAINER — GENERAL ASSEMBLY

20FT ISO ENCLOSURE / 3.72 MWh LFP / 1500 Vdc STRING

DRAWING NUMBER		REV	SHEET
LTS-BESS-2400-GA-001		C	1 OF 6
SCALE	MASS (kg)	SIZE	UNITS
1:25	24 860	A3	mm

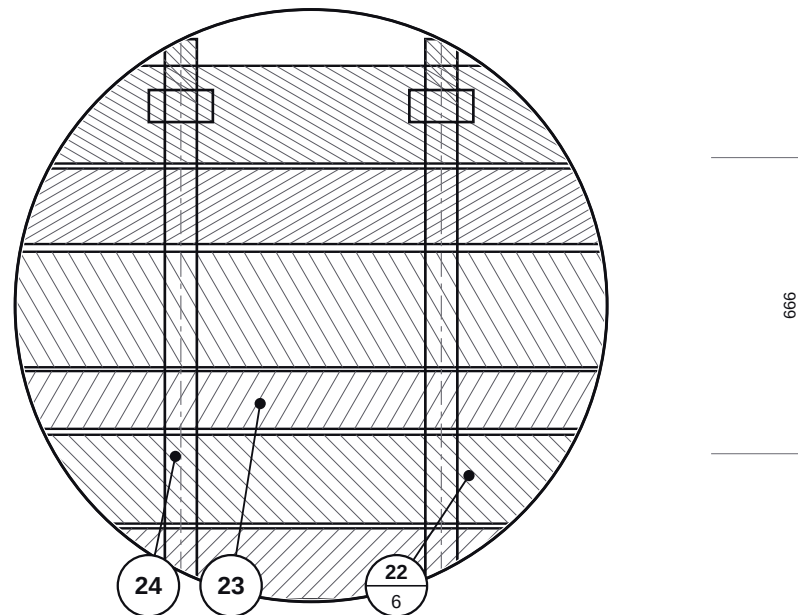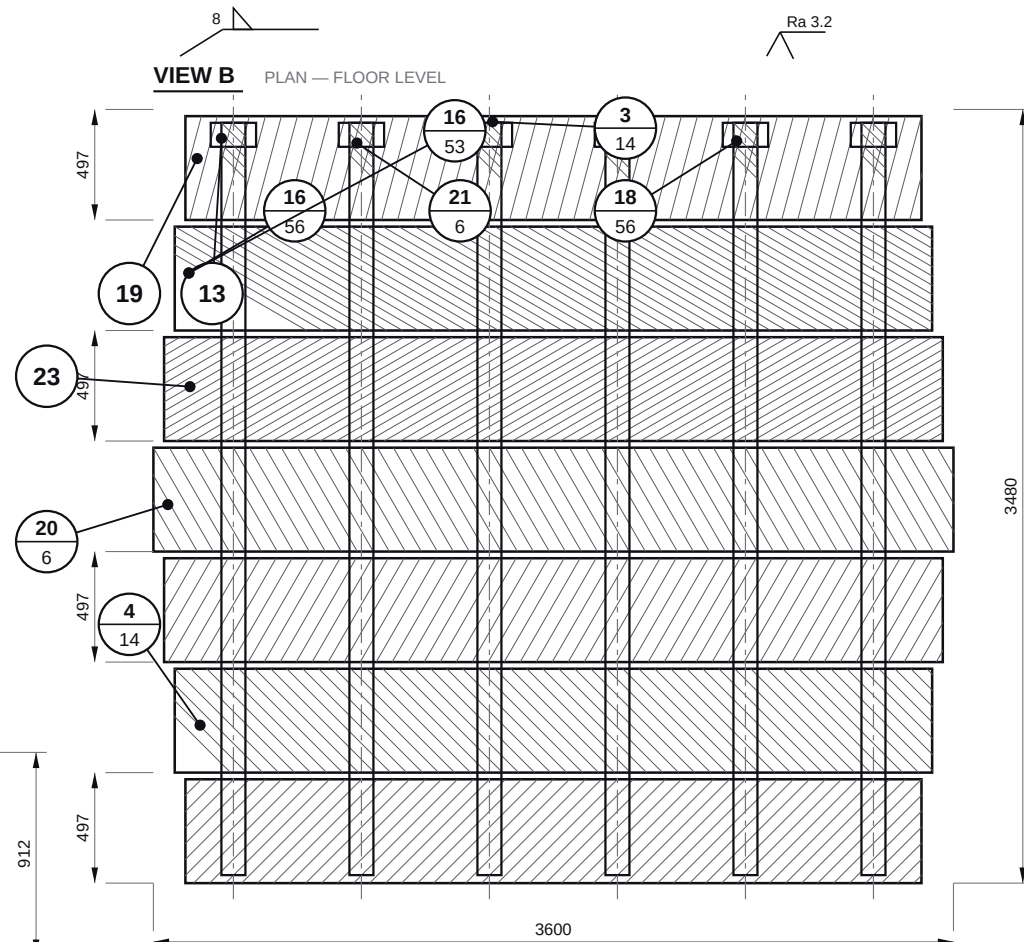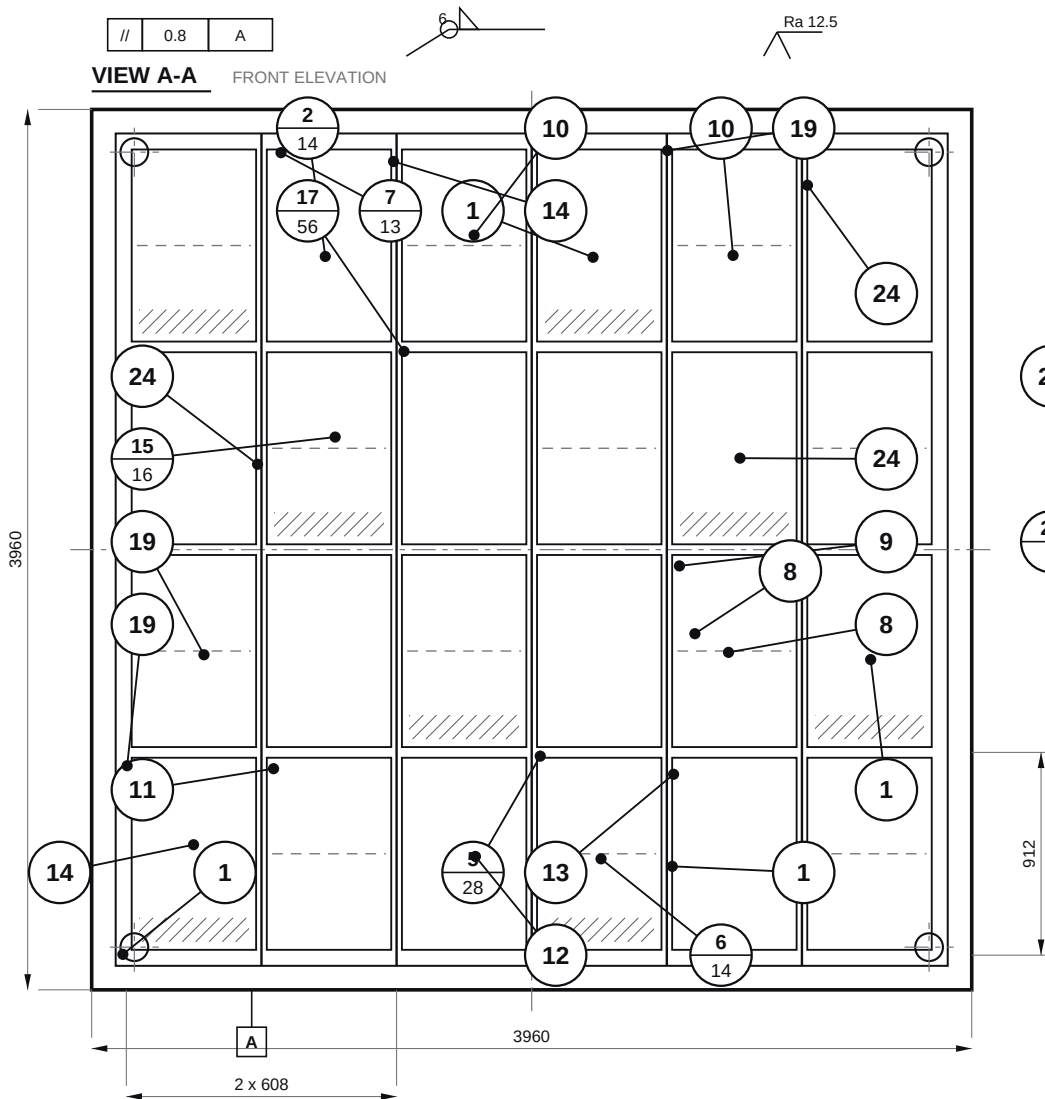

SCALE 4:1

REV	DESCRIPTION	DATE	BY
A	ISSUED FOR INTERNAL REVIEW	2026-05-22	AP
B	BOM RESTRUCTURED PER ERP LOAD	2026-07-03	AP
C	BALLOONING UPDATED, QTY REVISED	2026-08-14	AP

ITEM	PART NUMBER	DESCRIPTION	MATERIAL / SPEC	QTY
24	RCK-310-024	SEISMIC TIE-DOWN CLEAT	S355J2 8mm	4
23	RCK-310-023	RACK LABEL, ID + POLARITY	PET LAMINATE	3
22	RCK-310-022	CABLE GLAND M25, EMC	IP68 / EN 62444	6
21	RCK-310-021	TEMPERATURE SENSOR NTC 10k	CLASS B / IEC 60751	8
20	RCK-310-020	EARTH STRAP, 16mm² TINNED	H07V-K / GN-YE	6
19	RCK-310-019	ANTI-VIBRATION MOUNT, 60 SHORE	NR/SBR 60°5	4
18	RCK-310-018	NUT, NYLOC M8, A2-70	ISO 7040 / A2-70	56
17	RCK-310-017	WASHER, SPRING M8, A2	DIN 127B / A2	56
16	RCK-310-016	BOLT HHCS M8 x 25, A2-70	ISO 4017 / A2-70	56
15	RCK-310-015	INSULATOR STANDOFF, M8 x 40	GPO-3 / UL94 V-0	16
14	RCK-310-014	BUSBAR, CU 40x5 TINNED, NEG	CU-ETP / EN 13601	2
13	RCK-310-013	BUSBAR, CU 40x5 TINNED, POS	CU-ETP / EN 13601	2
12	RCK-310-012	RACK CONTROL BOX, IP54	SS304 1.5mm	1
11	RCK-310-011	CURRENT TRANSDUCER, HALL 600A	CLASS 0.5	1
10	RCK-310-010	FUSE, gPV 400A 1500Vdc	IEC 60269-6	2
9	RCK-310-009	PRE-CHARGE CONTACTOR ASSY	IEC 60947-4-1	1
8	RCK-310-008	RACK DC BREAKER, 630A 1500V	IEC 60947-2	1
7	RCK-310-007	INTER-MODULE CABLE, 35mm² 500mm	XLPE 1.8kV DC	13
6	RCK-310-006	BMU SLAVE BOARD, 52 CH	IEC 61508 SIL2	14
5	RCK-310-005	MODULE RETAINER BRACKET	S275JR 4mm	28
4	RCK-310-004	LFP BATTERY MODULE, 22.1 kWh	LFP 1P52S / IEC 62619	14
3	RCK-310-003	MODULE SHELF, 3mm FOLDED	DC01 / EN 10130	14
2	RCK-310-002	RACK CROSS MEMBER, 80x40x3 RHS	S275JR / EN 10219	14
1	RCK-310-001A	RACK UPRIGHT, 100x50x4 RHS	S275JR / EN 10219	4

NOTES:

1. MODULE INSTALLATION SEQUENCE: BOTTOM SHELF UPWARD ONLY.
2. DO NOT EXCEED 1500 Vdc STRING OPEN CIRCUIT AT 100% SOC.
3. ALL M8 FASTENERS TORQUED TO 22 Nm; M12 TO 60 Nm.
4. INTER-MODULE CABLE ROUTING PER DETAIL C, SHEET 3.
5. BMU SLAVE ADDRESSING 01 THROUGH 14, BOTTOM TO TOP.


GENERAL TOLERANCES ISO 2768-mK

LINEAR 0.5 - 6 : ± 0.1 6 - 30 : ± 0.2 30 - 120 : ± 0.3
ANGULAR $\pm 0^{\circ}30'$ WELD PROFILE PER ISO 5817 CLASS B
SURFACE Ra 6.3 UNLESS OTHERWISE STATED
DO NOT SCALE DRAWING — REFER LATEST REV ONLY

DRAWN	A. PATIL	2026-08-14
CHECKED	R. MEHTA	2026-08-14
APPROVED	S. IYER	2026-08-14

L&T TECHNOLOGY SERVICES

ENERGY — GRID & STORAGE ENGINEERING / VADODARA






DRAWING TITLE

BATTERY RACK — SUB-ASSEMBLY

14 x LFP MODULE / 1331 Vdc NOMINAL / 310 kWh PER RACK

DRAWING NUMBER		REV	SHEET
LTS-BESS-2400-SA-002		C	2 OF 6
SCALE	MASS (kg)	SIZE	UNITS
1:10	3 240	A3	mm

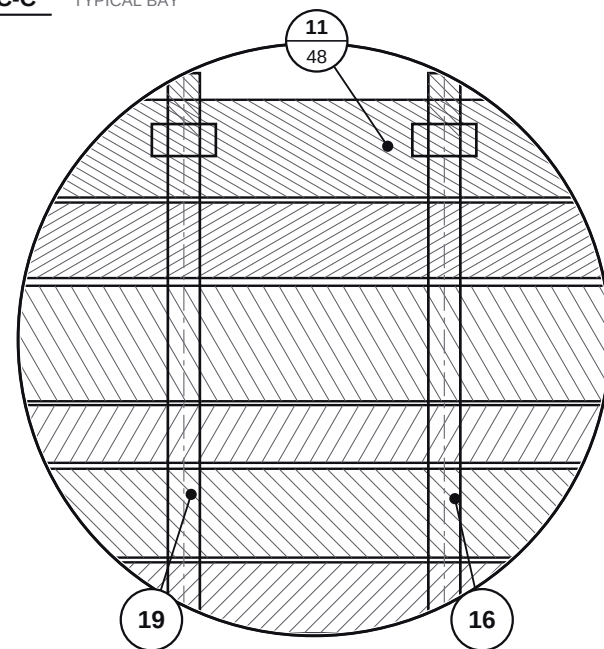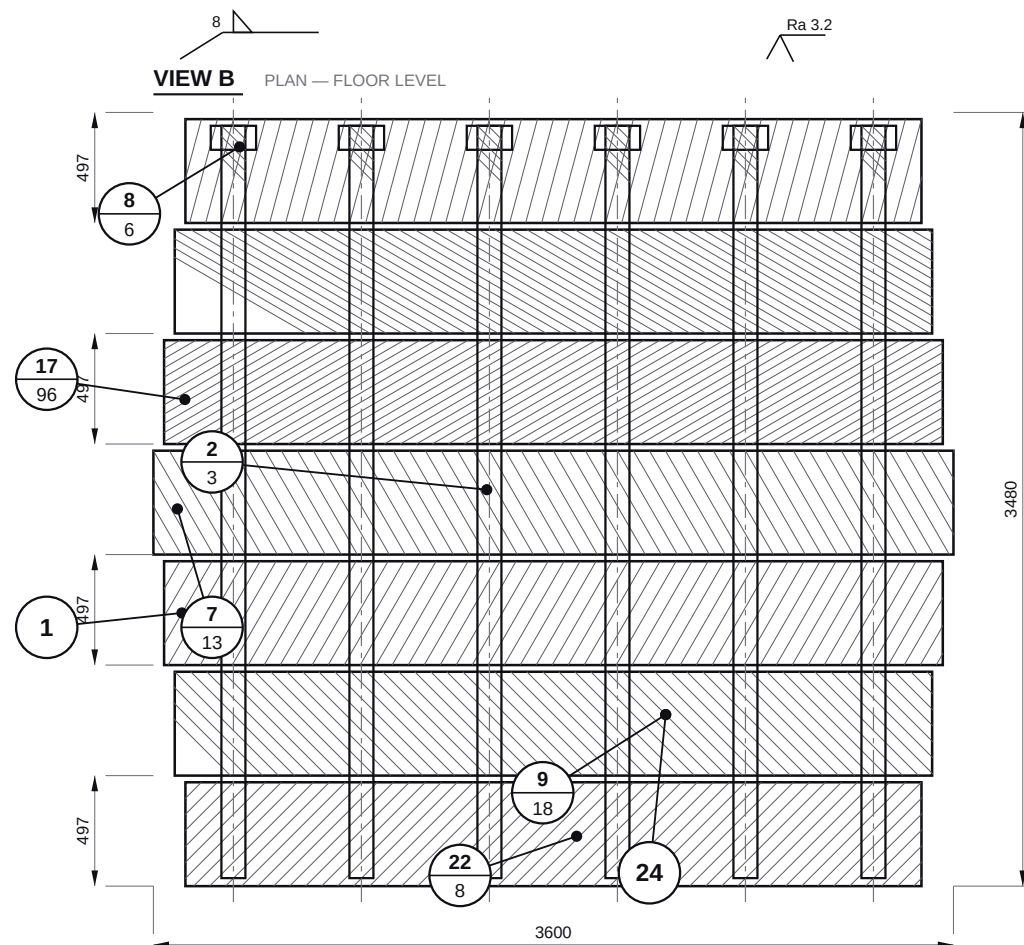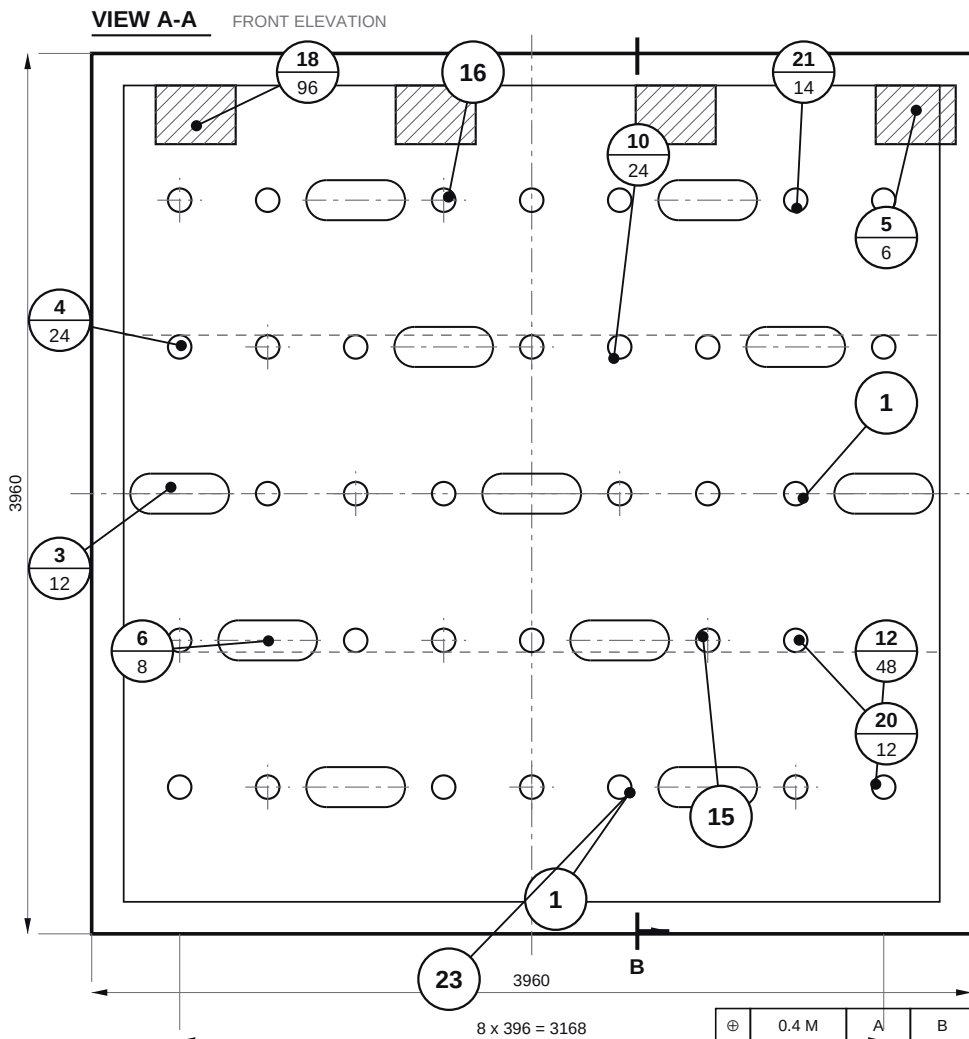

SCALE 4:1

REV	DESCRIPTION	DATE	BY
A	ISSUED FOR INTERNAL REVIEW	2026-05-22	AP
B	BOM RESTRUCTURED PER ERP LOAD	2026-07-03	AP
C	BALLOONING UPDATED, QTY REVISED	2026-08-14	AP

BILL OF MATERIAL — READ BOTTOM UP

ITEM	PART NUMBER	DESCRIPTION	MATERIAL / SPEC	QTY
22	BUS-1500-022	EARTH CONTINUITY BOND, 70mm ²	H07V-K / GN-YE	8
21	BUS-1500-021	FIRE STOP PILLOW, 200x100	EI120 / EN 1366-3	14
20	BUS-1500-020	PHASE / POLARITY MARKER SET	PVC ADHESIVE	12
19	BUS-1500-019	TORQUE SEAL MARKER, YELLOW	LACQUER / 30 Nm	1
18	BUS-1500-018	BELLEVILLE WASHER M12	DIN 6796 / A4	96
17	BUS-1500-017	BOLT HHCS M12 x 45, A4-80	ISO 4014 / A4-80	96
16	BUS-1500-016	DC SHUNT, 2500A / 60mV	CLASS 0.2	2
15	BUS-1500-015	INSULATION MONITOR DEVICE	IEC 61557-8	1
14	BUS-1500-014	SURGE ARRESTER, DC 1500V 40kA	IEC 61643-31 T2	4
13	BUS-1500-013	CABLE CLEAT, TREFOIL 3x240	AL / LSF POLYMER	16
12	BUS-1500-012	HEAT SHRINK BOOT, 240mm ²	XLPO ADHESIVE LINED	48
11	BUS-1500-011	CABLE LUG, 240mm ² M12 TINNED	CU TUBE LUG / DIN 46...	48
10	BUS-1500-010	DC CABLE, 1x240mm ² 1.8kV	XLPE / EN 50618	24
9	BUS-1500-009	LADDER SUPPORT BRACKET, 300	HDG 4mm	18
8	BUS-1500-008	CABLE LADDER BEND, 90 DEG	HDG / EN ISO 1461	6
7	BUS-1500-007	CABLE LADDER, 300mm HDG	HDG / EN ISO 1461	10
6	BUS-1500-006	IP2X SHROUD, POLYCARBONATE	PC UL94 V-0 3mm	8
5	BUS-1500-005	FLEXIBLE BUS LINK, 100x10 CU	LAMINATED CU FOIL	6
4	BUS-1500-004	EPOXY INSULATOR, 1500V 120mm	CYCLOALIPHATIC EP...	24
3	BUS-1500-003	BUSBAR SUPPORT BRACKET	S275JR 6mm HDG	12
2	BUS-1500-002	MAIN BUSBAR, CU 100x10, NEG	CU-ETP / EN 13601	3
1	BUS-1500-001	MAIN BUSBAR, CU 100x10, POS	CU-ETP / EN 13601	3

NOTES:

1. MAINTAIN 25 mm MINIMUM CLEARANCE POS TO NEG THROUGHOUT.
2. BUSBAR JOINTS TO BE ABRADED AND COMPOUND APPLIED BEFORE BOLTING.
3. ALL CABLE ENTRIES FIRE STOPPED TO EI120.
4. INSULATION RESISTANCE > 100 MOhm AT 1000 Vdc BEFORE ENERGISATION.


GENERAL TOLERANCES ISO 2768-mK

LINEAR 0.5 - 6 : ± 0.1 6 - 30 : ± 0.2 30 - 120 : ± 0.3
ANGULAR $\pm 0^{\circ}30'$ WELD PROFILE PER ISO 5817 CLASS B
SURFACE Ra 6.3 UNLESS OTHERWISE STATED
DO NOT SCALE DRAWING — REFER LATEST REV ONLY

DRAWN	A. PATIL	2026-08-14
CHECKED	R. MEHTA	2026-08-14
APPROVED	S. IYER	2026-08-14

L&T TECHNOLOGY SERVICES

ENERGY — GRID & STORAGE ENGINEERING / VADODARA




DRAWING TITLE

DC BUSBAR & CABLE MANAGEMENT — ASSEMBLY


1500 Vdc MAIN BUS / 2500 A CONTINUOUS / IP2X SHROUDED

DRAWING NUMBER		REV	SHEET
LTS-BESS-2400-SA-003		C	3 OF 6
SCALE	MASS (kg)	SIZE	UNITS
1:12	1 180	A3	mm


VIEW A-A FRONT ELEVATION

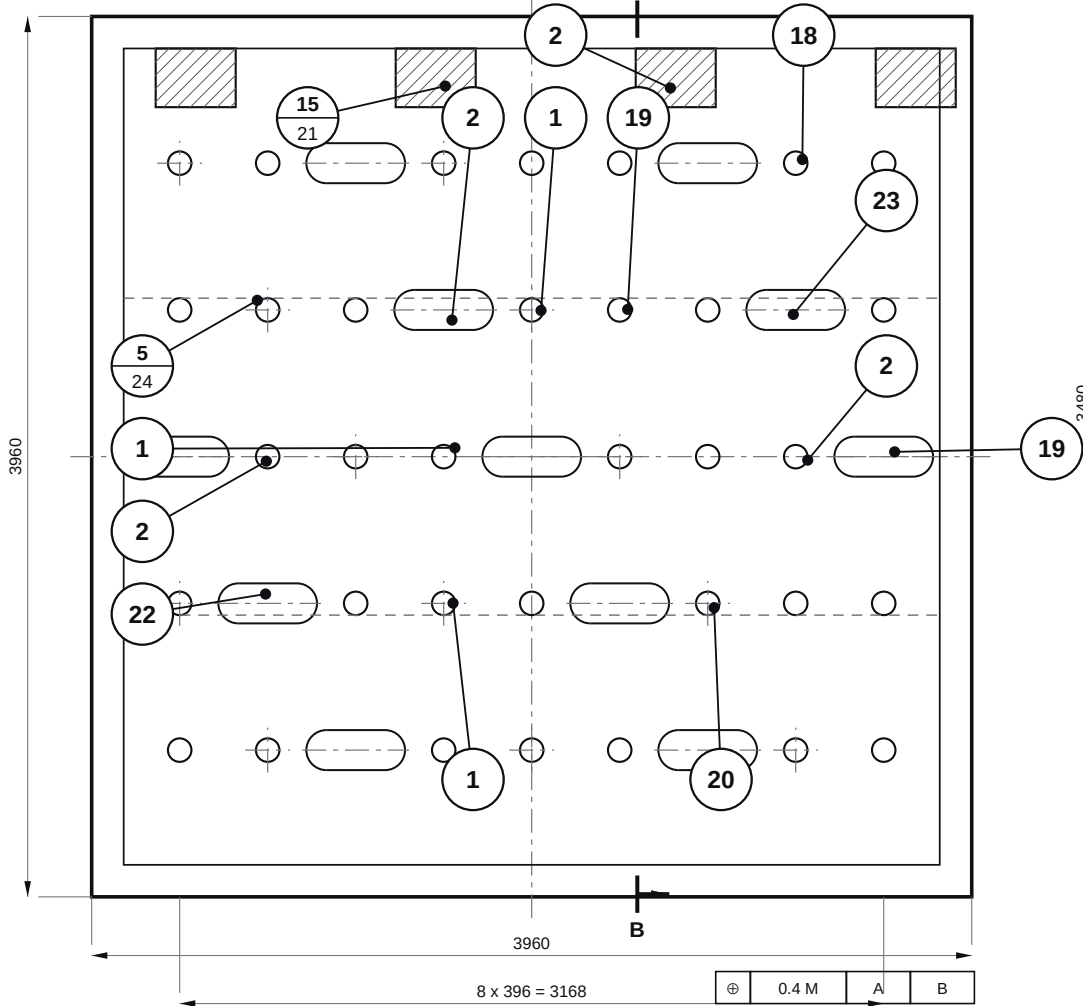

VIEW B PLAN — FLOOR LEVEL

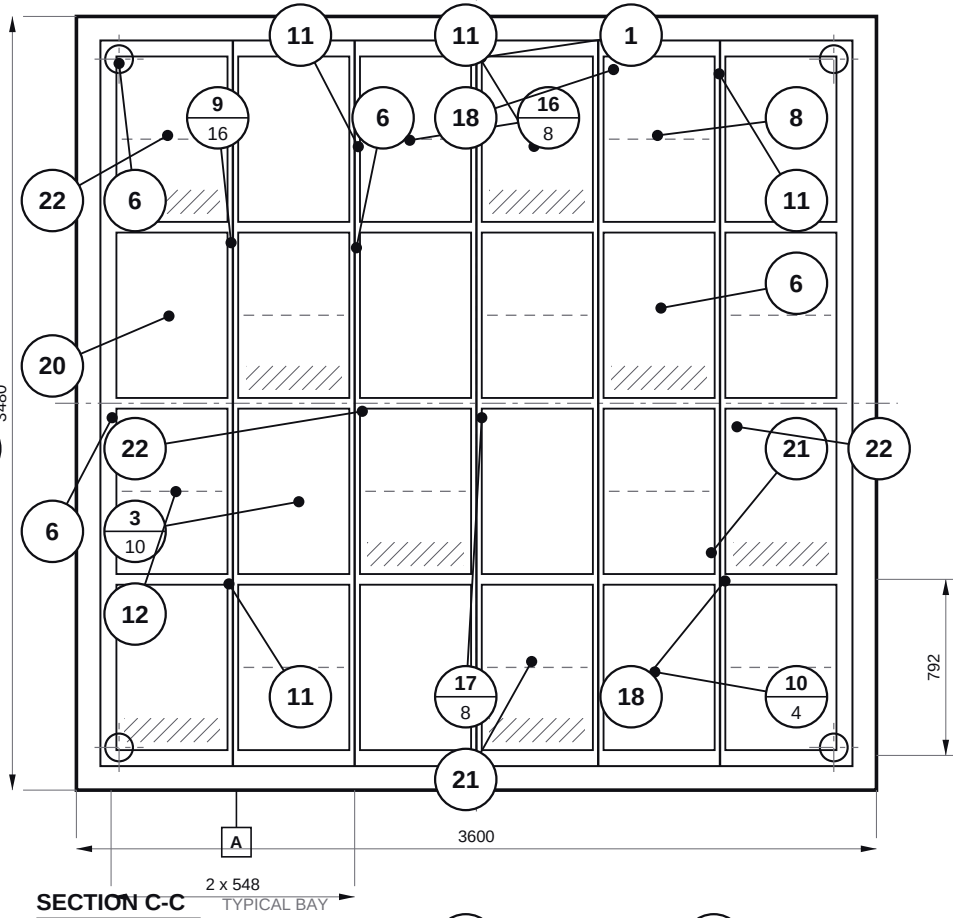

SECTION C-C

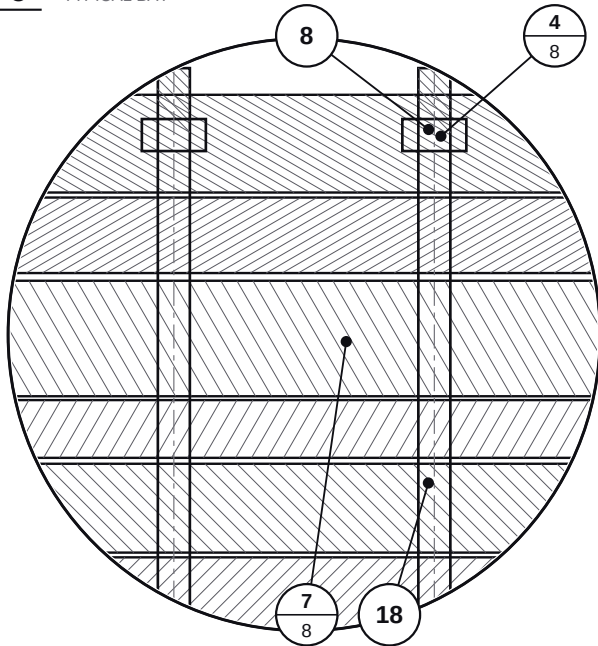

SCALE 4:1

NOTES:

1. DUCTWORK SEALED TO CLASS C PER EN 12237.
2. AEROSOL DISCHARGE INHIBITED WHILE ABORT SWITCH HELD.
3. SAMPLING PIPE TRANSPORT TIME < 60 s TO FURTHEST POINT.
4. CONDENSATE DRAINS TRAPPED AND ROUTED TO CONTAINER SUMP.

GENERAL TOLERANCES ISO 2768-mK

LINEAR 0.5 - 6 : ±0.1 6 - 30 : ±0.2 30 - 120 : ±0.3
ANGULAR ±0°30' WELD PROFILE PER ISO 5817 CLASS B
SURFACE Ra 6.3 UNLESS OTHERWISE STATED
DO NOT SCALE DRAWING — REFER LATEST REV ONLY

DRAWN	A. PATIL	2026-08-14
CHECKED	R. MEHTA	2026-08-14
APPROVED	S. IYER	2026-08-14

REV	DESCRIPTION	DATE	BY
A	ISSUED FOR INTERNAL REVIEW	2026-05-22	AP
B	BOM RESTRUCTURED PER ERP LOAD	2026-07-03	AP
C	BALLOONING UPDATED, QTY REVISED	2026-08-14	AP

BILL OF MATERIAL — READ BOTTOM UP

ITEM	PART NUMBER	DESCRIPTION	MATERIAL / SPEC	QTY
23	HVC-048-023	HVAC CONTROL PANEL, IP54	IEC 61439-1	1
22	HVC-048-022	THERMOSTAT / HUMIDISTAT	IP54 / MODBUS RTU	4
21	HVC-048-021	DOOR HOLD-OPEN MAGNET	EN 1155	2
20	HVC-048-020	ABORT / HOLD SWITCH	IP66 / EN 12094-3	2
19	HVC-048-019	MANUAL RELEASE CALL POINT	EN 54-11	2
18	HVC-048-018	FIRE ALARM SOUNDER / BEACON	EN 54-3 / EN 54-23	4
17	HVC-048-017	CANISTER MOUNTING BRACKET	SS304 3mm	8
16	HVC-048-016	AEROSOL CANISTER, 5000 g	NFPA 2010 / EN 15276	8
15	HVC-048-015	SAMPLING POINT, CALIBRATED	2.2mm ORIFICE	20
13	HVC-048-013	SAMPLING PIPE, 25mm ABS	ABS / RED	12
12	HVC-048-012	VESDA ASPIRATING DETECTOR	IEC 62599-1	1
11	HVC-048-011	CONDENSATE DRAIN, 32mm PVC	PVC-U / EN 1329	4
10	HVC-048-010	REFRIGERANT LINE SET, 5/8+3/8	CU EN 12735-1	4
9	HVC-048-009	DUCT SUPPORT HANGER	GALV THREADED M10	16
8	HVC-048-008	AXIAL EXTRACT FAN, 2200 m3/h	IP55 / ERP 2015	2
7	HVC-048-007	AIR FILTER, G4 / F7 CASSETTE	EN ISO 16890	8
6	HVC-048-006	FIRE DAMPER, 400x250, EI120	EN 1366-2	4
5	HVC-048-005	DUCT FLANGE, TDF 400x250	GALV Z275	24
4	HVC-048-00X	RETURN AIR DUCT, 400x250 G (ALT SUP...	GALV Z275 0.8mm	7
4	HVC-048-004	RETURN AIR DUCT, 400x250 GALV	GALV Z275 0.8mm	8
3	HVC-048-003	SUPPLY AIR DUCT, 400x250 GALV	GALV Z275 0.8mm	8
2	HVC-048-002	EVAPORATOR COIL ASSY	CU / AL FIN, EPOXY C...	4
1	HVC-048-001	HVAC CONDENSING UNIT, 12kW	IP55 / EN 14511	4

L&T TECHNOLOGY SERVICES

ENERGY — GRID & STORAGE ENGINEERING / VADODARA

DRAWING TITLE
HVAC & FIRE SUPPRESSION — ASSEMBLY
48 kW COOLING / VESDA ASPIRATING / AEROSOL FLOODING

DRAWING NUMBER		REV	SHEET
LTS-BESS-2400-SA-004		C	4 OF 6
SCALE	MASS (kg)	SIZE	UNITS
1:15	1 640	A3	mm

