Performance | Total system

Costs of use energy in €/kWh	0.12
COCHP in %	119.4
Self-generation level in %	37.0
Downtime in min	3.0
Mean standard deviation in K	2.4

Downtimes | Supply systems

	Downtime in min	Standard deviation in K
HNHT	0.0	2.82
HNLT	3.0	2.93
CN	0.0	1.46

Utilization | Single systems

Storage temperatures

Temperature in °C

Time (UTC+1)

Legend:
- BS_HNHT
- BS_HNLT
- BS_CN
- ST_HNHT
- ST_HNLT
- ST_CN

System temperatures

Temperature in °C

Time (UTC+1)

Legend:
- Heizung
- DLK
- IFA
- HD
- DLRA
- FBH
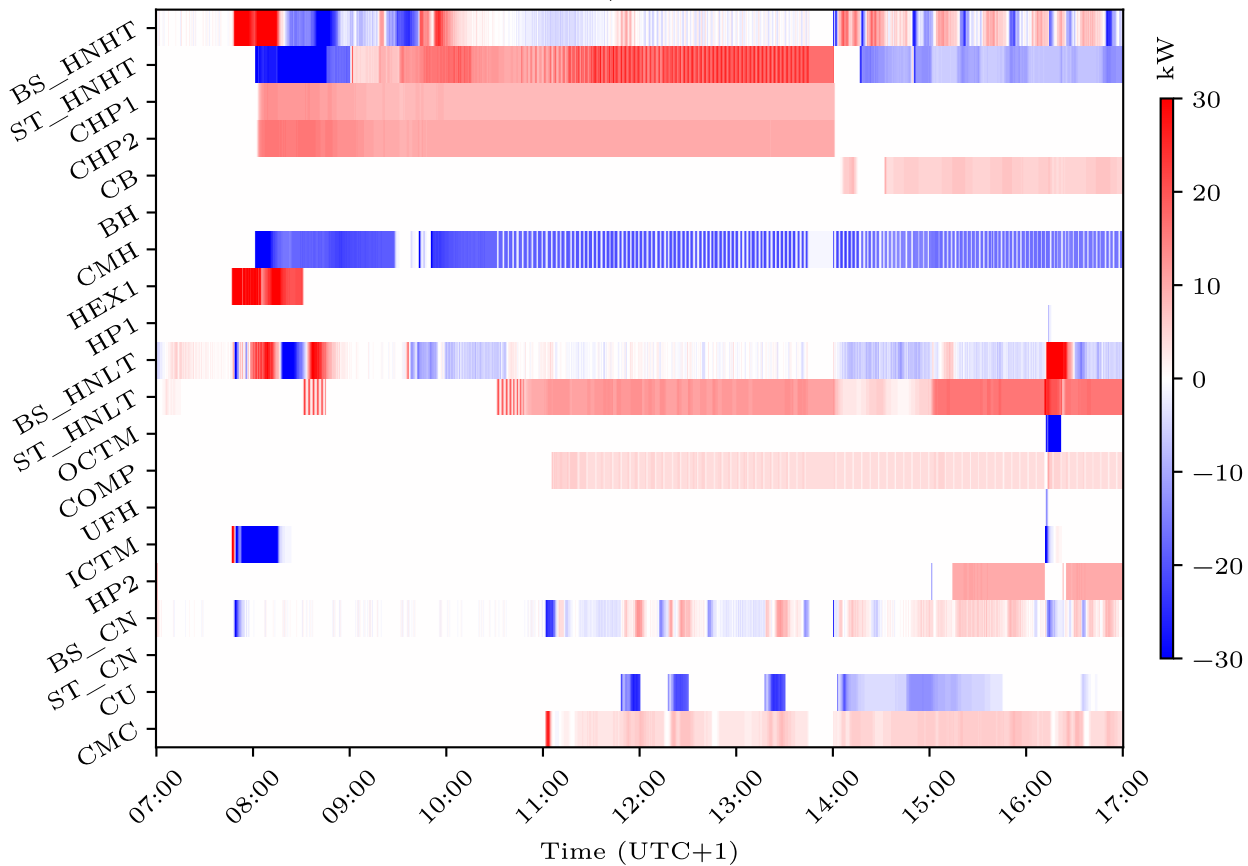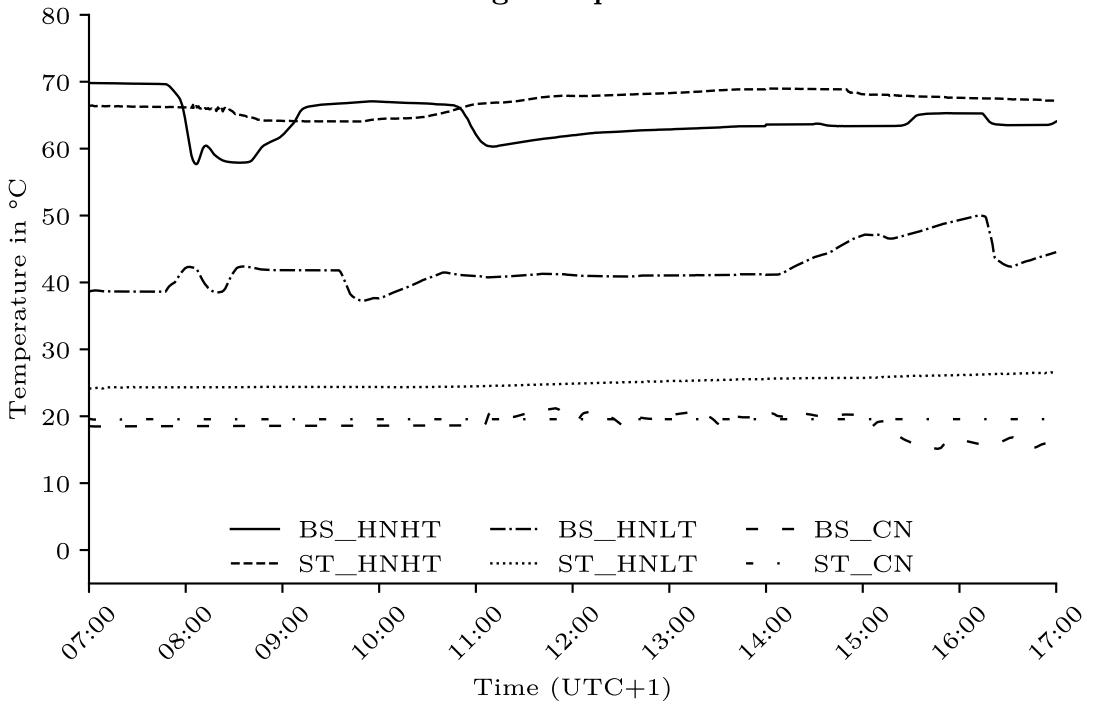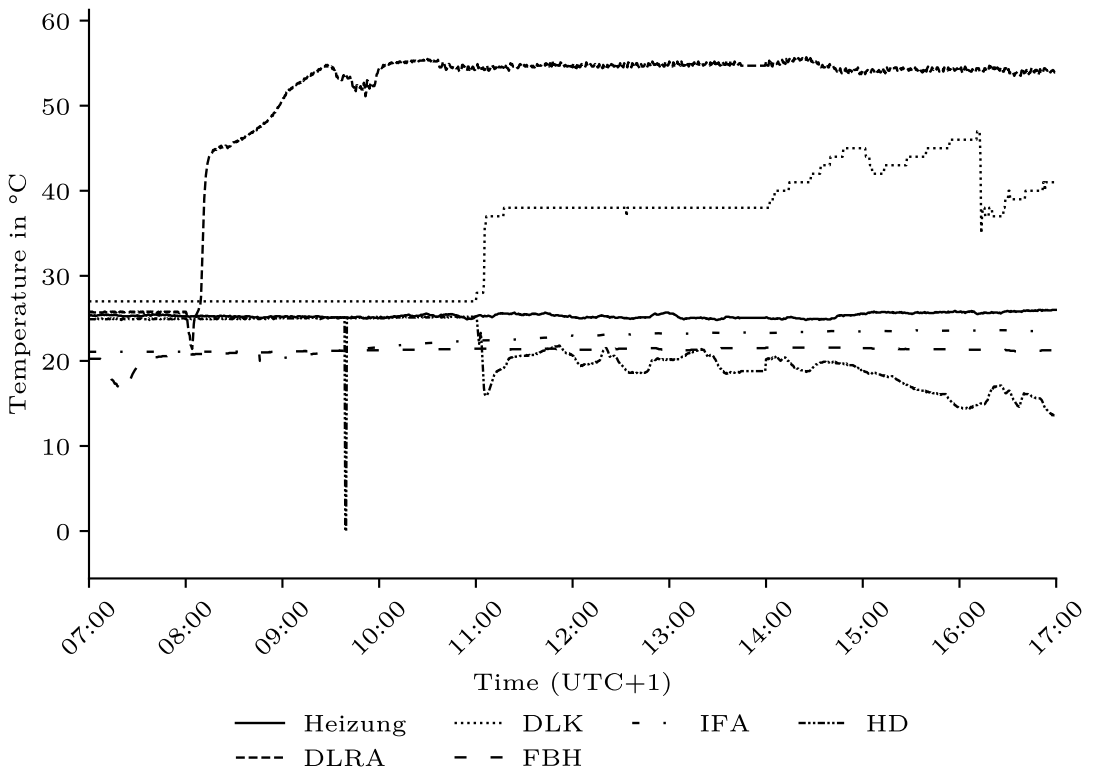
HNHT | Single systems

	ST | kWh	LT | kWh	BE | kWh	ST | €/kWh	LT | €/kWh	BE | €/kWh
BS_HNHT	90.1	0	0	0.04	0	0
CHP1	0	77.9	25.9	0	0.06	0.32
CHP2	0	102.2	40.2	0	0.08	0.32
CB	0	20	7.0	0	0.21	0.35
BH	0	0	0	0	0	0
CMH	2.0	87.5	42.9	0.02	0.12	0.32
ST_HNHT	92.1	114.6	102.5	0.04	0.06	0.32
HEX1	0	0	24.0	0	0	0.45
HP1	0	0	0	0	0	0

HNLT | Single systems

	ST | kWh	LT | kWh	BE | kWh	ST | €/kWh	LT | €/kWh	BE | €/kWh
BS_HNLT	69.0	0	0	0.05	0	0
COMP	0	34.5	11.5	0	-0.07	0.32
ST_HNLT	48.2	126.8	33.7	0.12	0.06	0.32
OCTM	0	0	8.0	0	0	0.3
UFH	2.8	0	0	0.17	0	0
ICTM	27.9	0	0	0.3	0	0
HEX1	28.6	0	4.7	0.3	0	0.4
HP1	26.4	0	0	-0.12	0	0
HP2	0	92.3	80.7	0	0.11	0.37

CN | Single systems

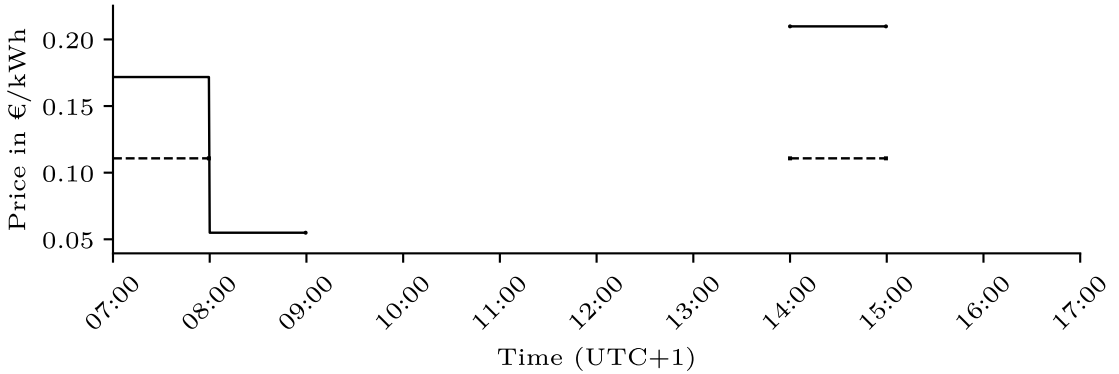|	ST | kWh	LT | kWh	BE | kWh	ST | €/kWh	LT | €/kWh	BE | €/kWh
BS_CN	29.7	0	0	-0.05	0	0
UFH	0	0	0	0	0	0
ICTM	0	0	0	0	0	0
CU	29.0	12.8	41.9	-0.06	-0.16	0.3
CMC	6.2	13.8	49.0	-0.07	-0.16	0.3
HP2	6.9	0.9	4.8	-0.04	-0.16	0.3

Market clearing price | 0.25 h - Execution in: 0.0 h
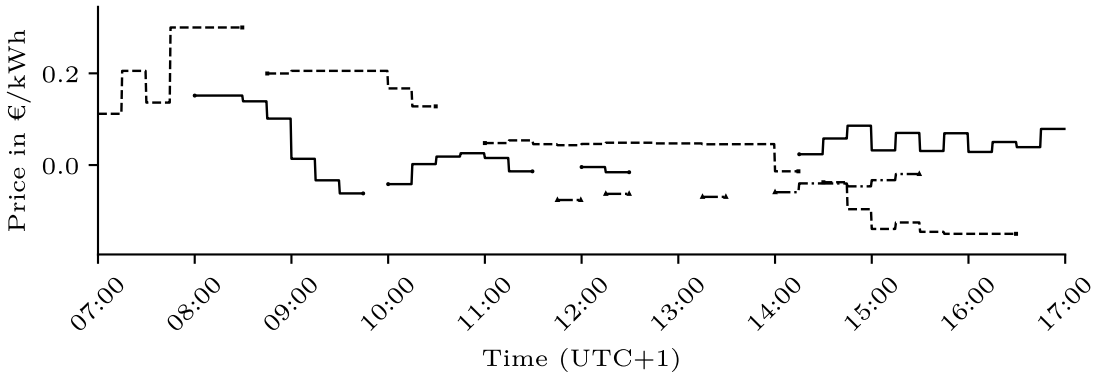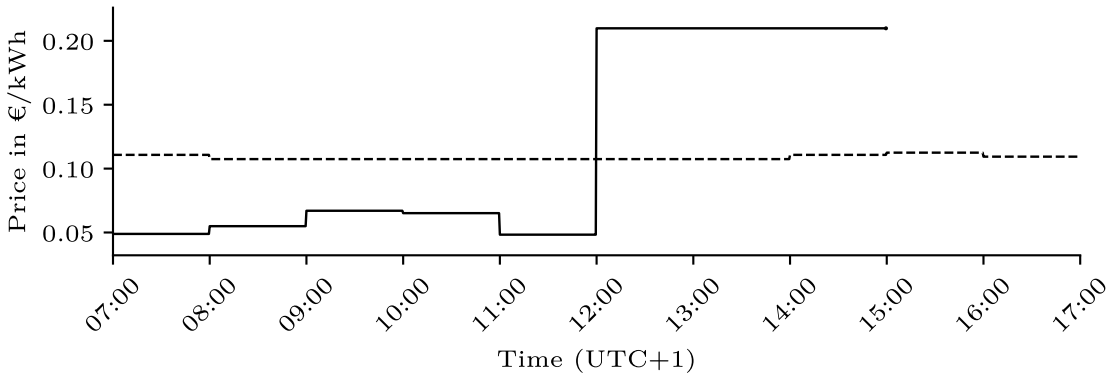
Market clearing price | 1.0 h - Execution in: 0.0 h
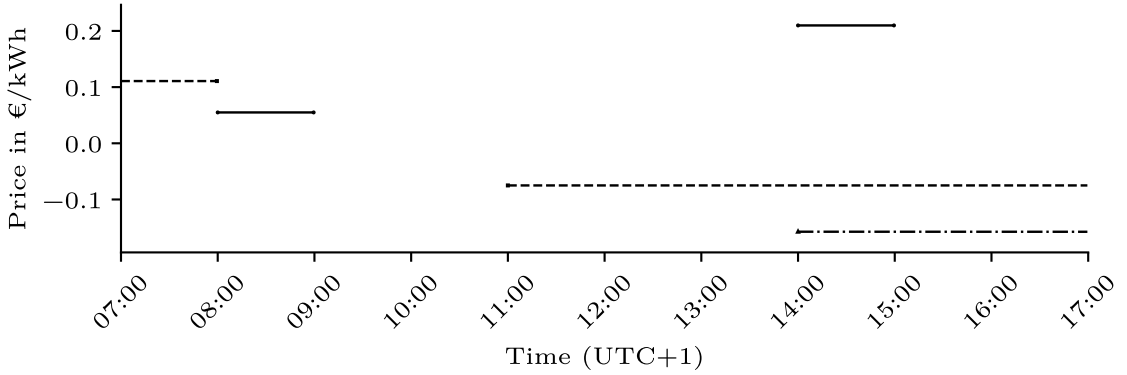
Market clearing price | 1.0 h - Execution in: 1.0 h

Market clearing price | 1.0 h - Execution in: 2.0 h

——— HNHT   - - - HNLT   ·—·— CN