


Performance | Total system

Costs of use energy in €/kWh	0.092
COCHP in %	173.4
Self-generation level in %	7.9
Downtime in min	0.0
Mean standard deviation in K	1.64


Downtimes | Supply systems

	Downtime in min	Standard deviation in K
HNHT	0.0	1.1
HNLT	0.0	2.34
CN	0.0	1.48


Utilization | Single systems

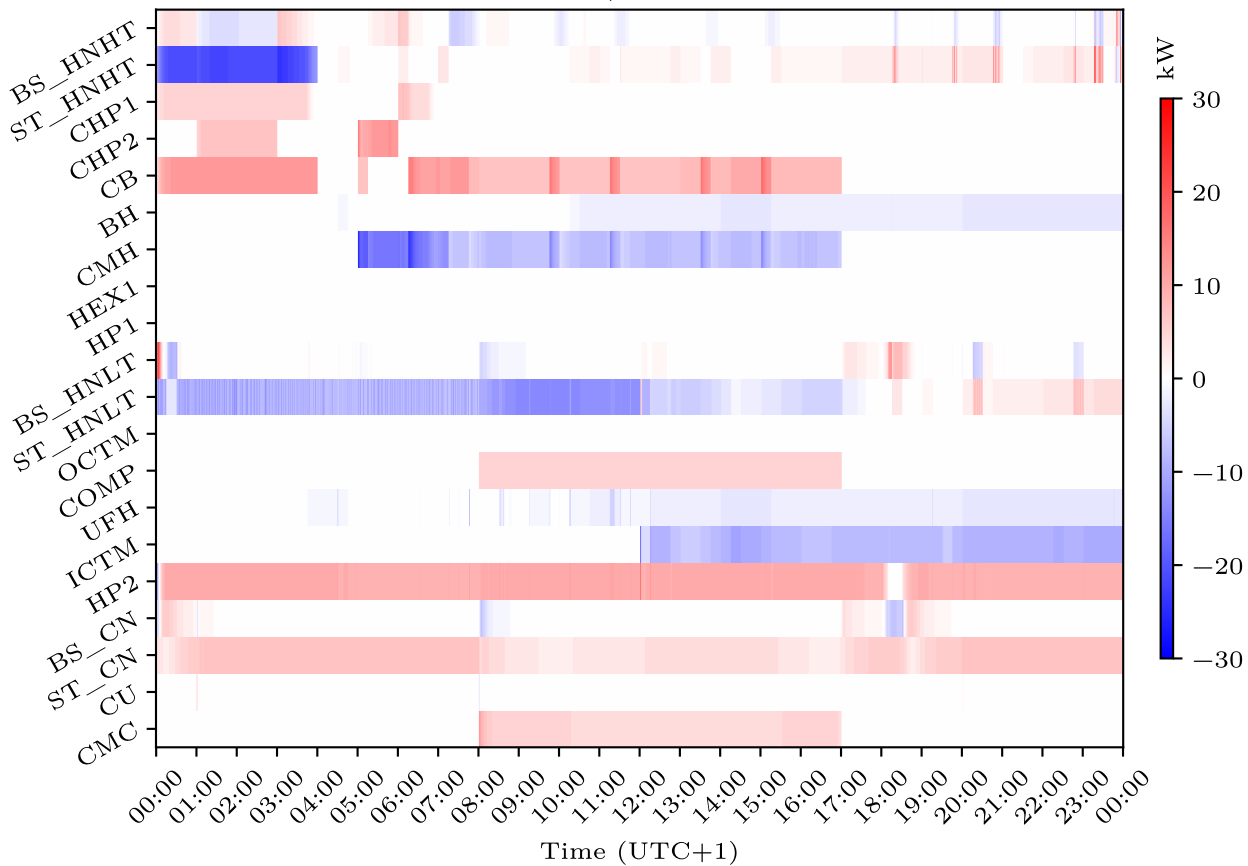

Storage temperatures

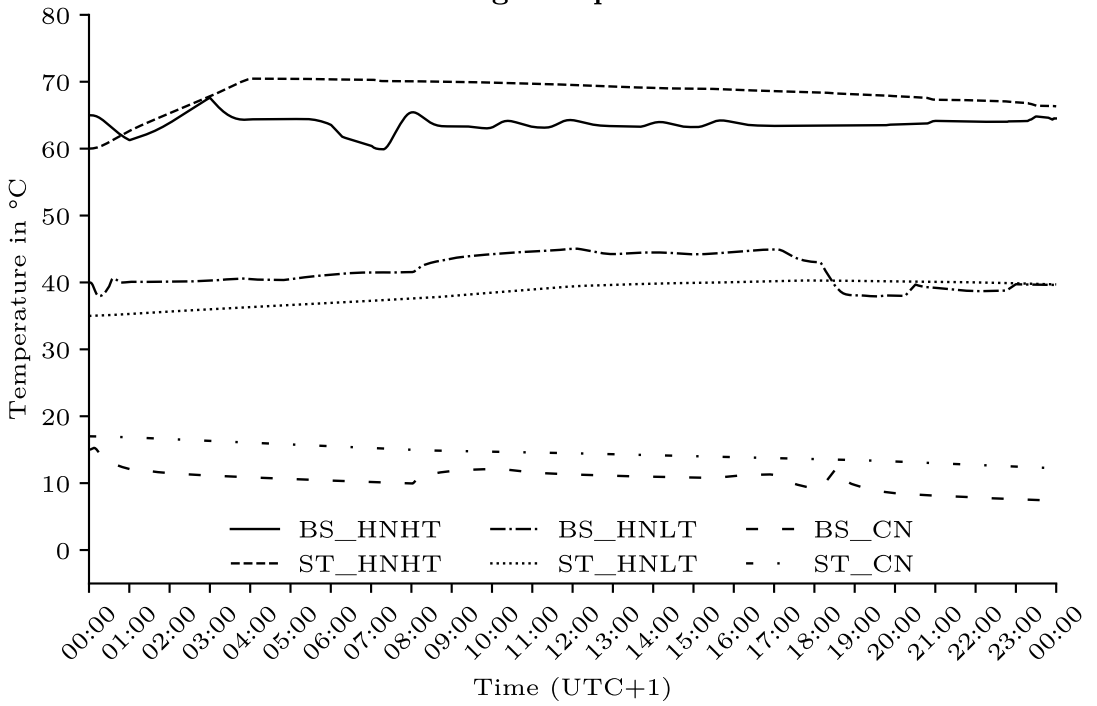

System temperatures

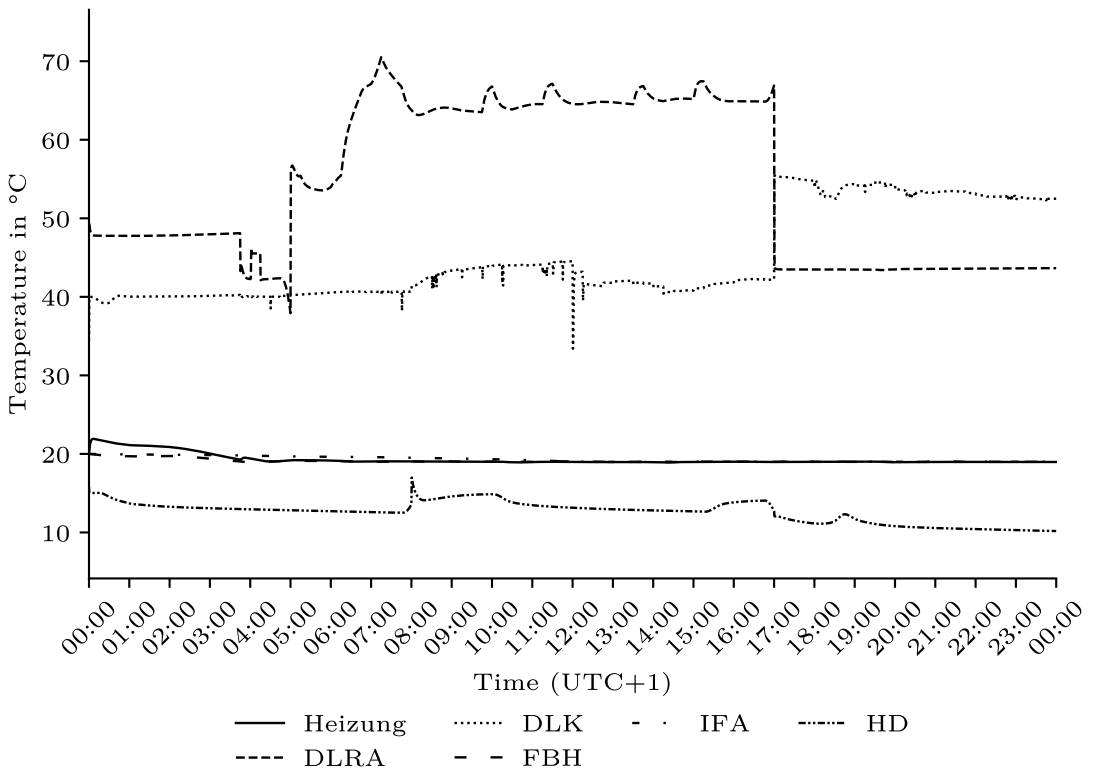

HNHT | Single systems

	ST kWh	LT kWh	BE kWh	ST €/kWh	LT €/kWh	BE €/kWh
BS_HNHT	44.7	0	0	0.19	0	0
CHP1	0	59.5	34.4	0	0.13	0.36
CHP2	0	49.0	22.4	0	0.13	0.31
CB	37.5	184.5	77.0	0.17	0.18	0.33
BH	36.8	4.5	2.4	0.24	0.2	0.35
CMH	4.5	109.2	13.6	0.24	0.2	0.31
ST_HNHT	40.7	179.3	102.3	0.25	0.11	0.32
HEX1	0	0	0.0	0	0	0
HP1	0	0	0	0	0	0


HNLT | Single systems

	ST kWh	LT kWh	BE kWh	ST €/kWh	LT €/kWh	BE €/kWh
BS_HNLT	159.4	0	0	-0.01	0	0
COMP	0	54.0	4.2	0	-0.11	0.3
ST_HNLT	62.1	277.8	88.9	0.17	0.06	0.32
OCTM	0	0	0.0	0	0	0
UFH	35.6	5.9	0	0.03	0.04	0
ICTM	103.5	0	0.0	0.05	0	0
HEX1	0	0	0.0	0	0	0
HP1	79.3	0	0	-0.13	0	0
HP2	5.0	229.7	13.5	0.19	0.09	0.3


CN | Single systems

	ST kWh	LT kWh	BE kWh	ST €/kWh	LT €/kWh	BE €/kWh
BS_CN	0.4	0	0	-0.03	0	0
UFH	0	0	0	0	0	0
ICTM	0	0	0.0	0	0	0
CU	0	394.0	394.4	0	-0.06	0.3
ST_CN	0	607.3	474.3	0	-0.06	0.3
CMC	0.4	44.1	8.9	-0.03	-0.06	0.3
HP2	0	257.4	10.2	0	-0.05	0.3


Market clearing price | 0.25 h - Execution in: 0.0 h

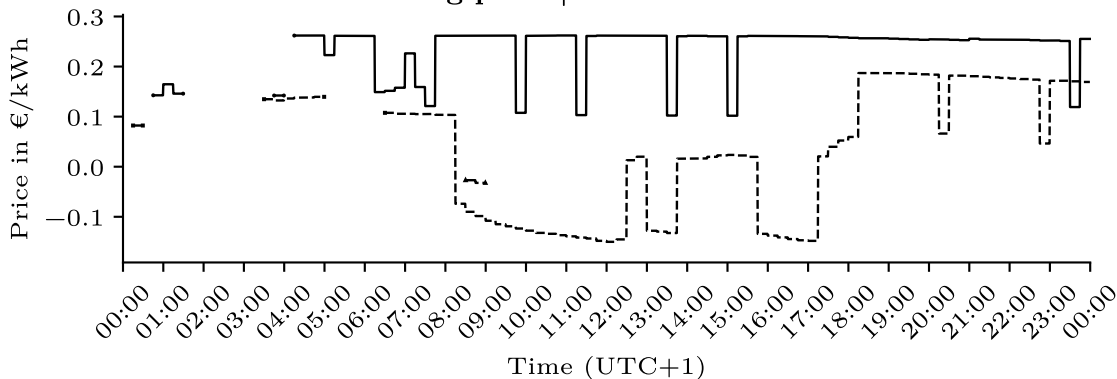


Market clearing price | 1.0 h - Execution in: 0.0 h

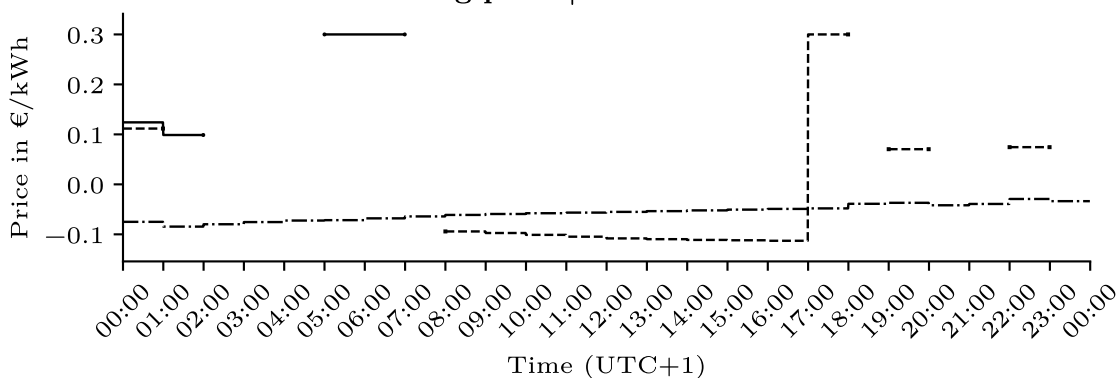

Market clearing price | 1.0 h - Execution in: 1.0 h

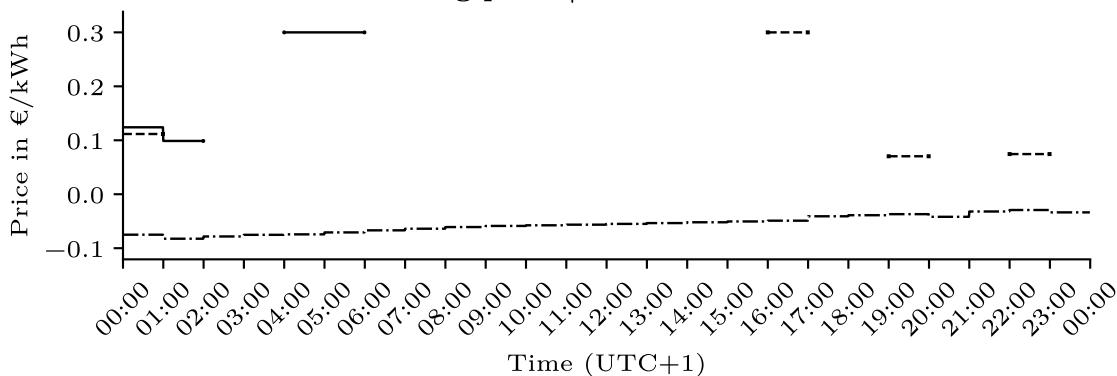

Market clearing price | 1.0 h - Execution in: 2.0 h

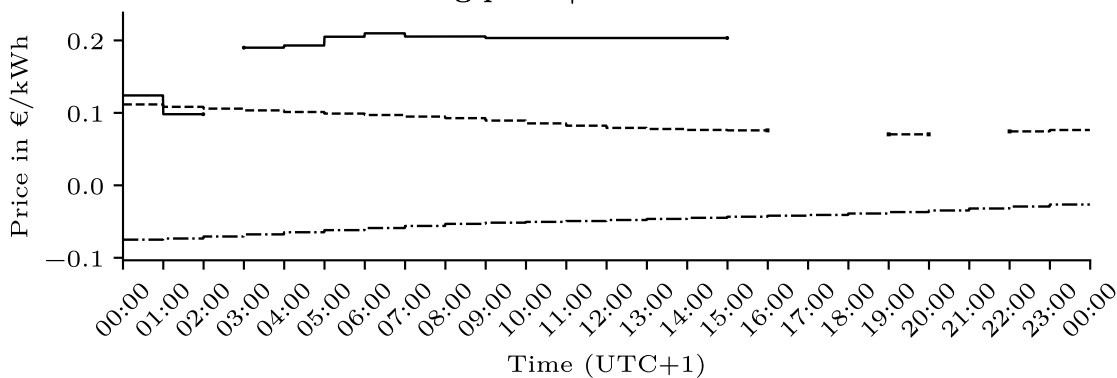

— HNHT ---- HNLT -.- CN