## Performance | Total system

| Costs of use energy in €/kWh | 0.094 |
|---|---|
| COCHP in % | 169.0 |
| Self-generation level in % | 5.4 |
| Downtime in min | 0.0 |
| Mean standard deviation in K | 1.99 |

## Downtimes | Supply systems

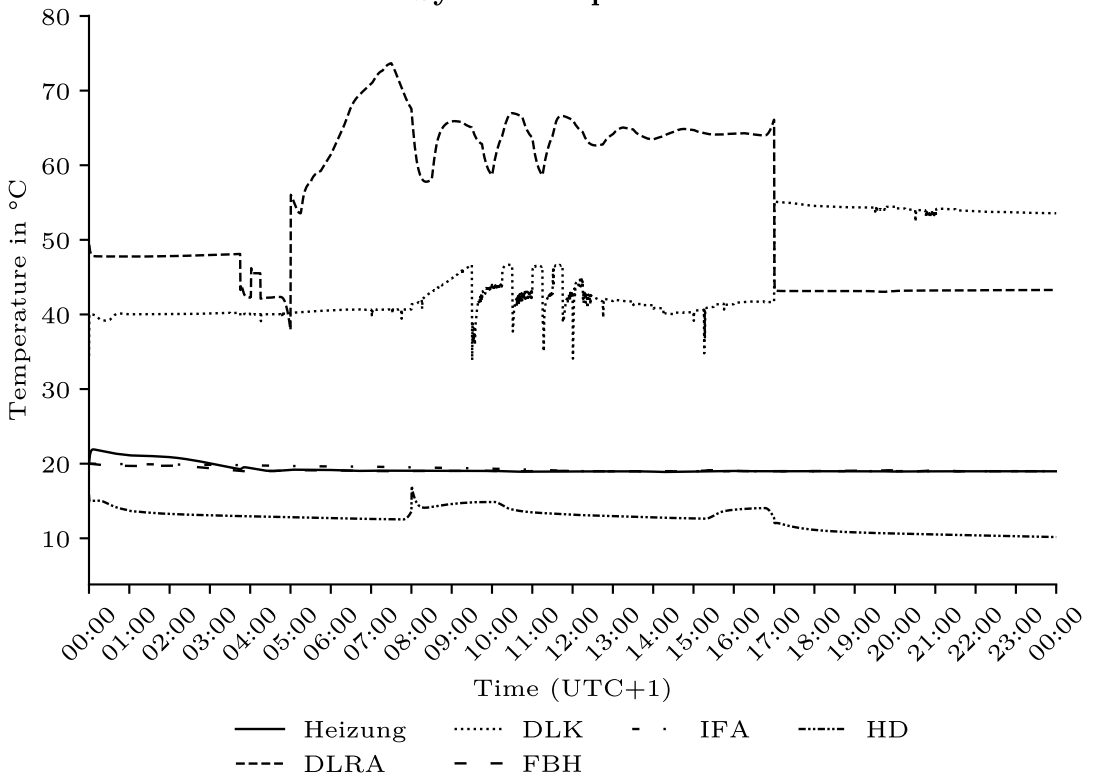|  | Downtime in min | Standard deviation in K |
|---|---|---|
| HNHT | 0.0 | 2.07 |
| HNLT | 0.0 | 2.37 |
| CN | 0.0 | 1.54 |

## Utilization | Single systems
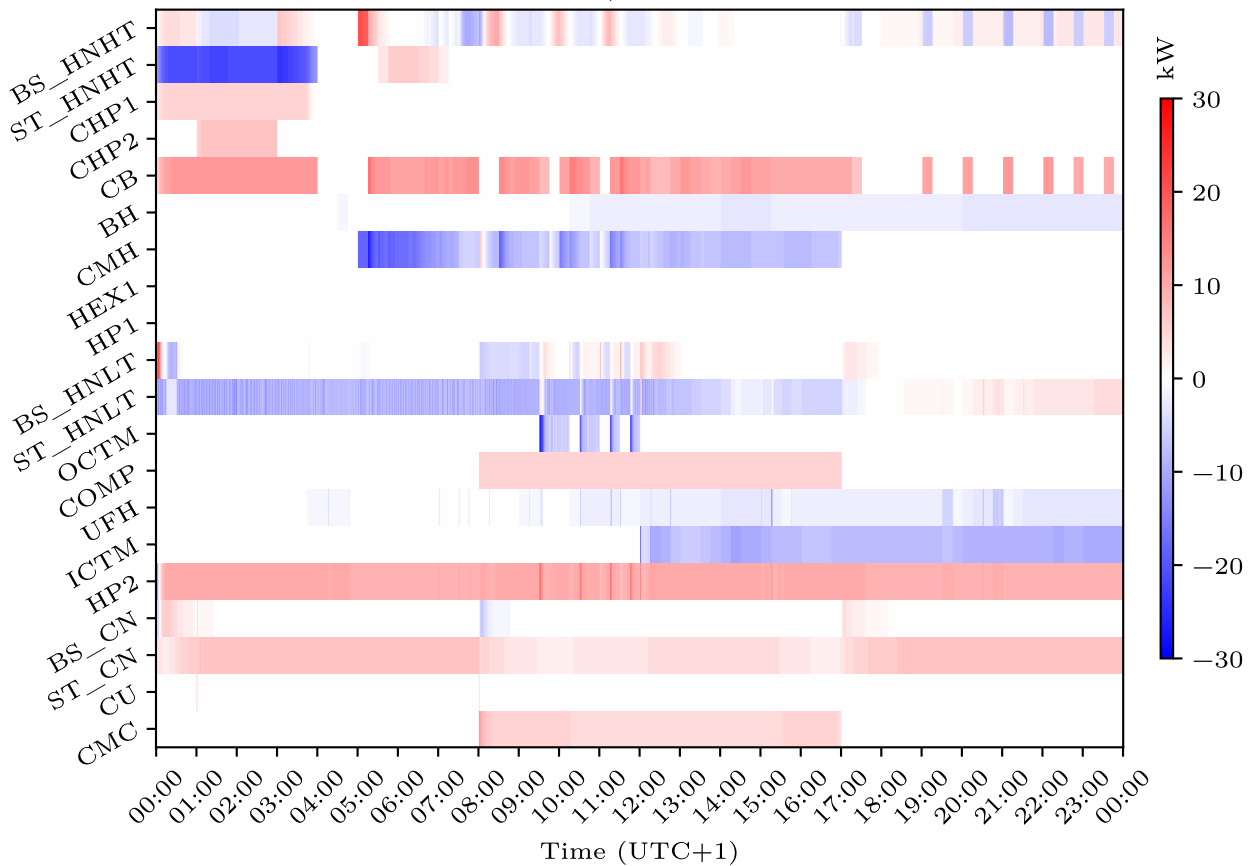
## Storage temperatures
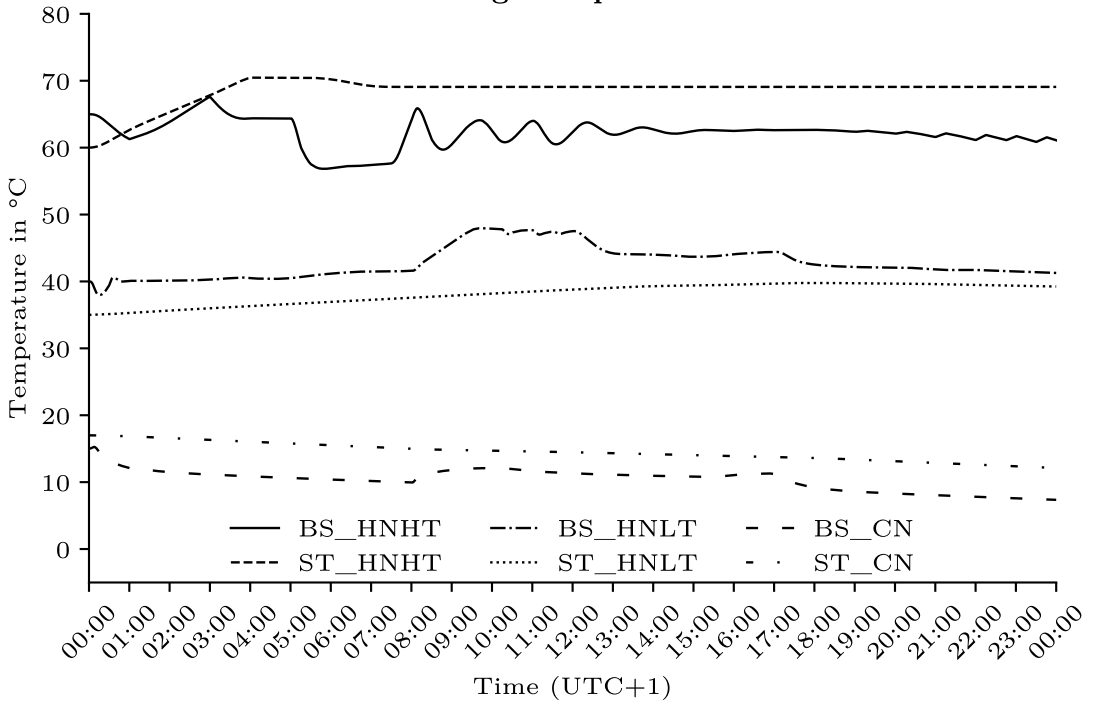


## System temperatures

## HNHT | Single systems

| | ST | kWh | LT | kWh | BE | kWh | ST | €/kWh | LT | €/kWh | BE | €/kWh |
|---|---|---|---|---|---|---|
| BS_HNHT | 205.1 | 0 | 0 | 0.15 | 0 | 0 |
| CHP1 | 0 | 47.5 | 26.9 | 0 | 0.12 | 0.33 |
| CHP2 | 0 | 33.0 | 18.2 | 0 | 0.1 | 0.32 |
| CB | 186.5 | 98.8 | 99.6 | 0.15 | 0.12 | 0.39 |
| BH | 0 | 0 | 38.9 | 0 | 0 | 0.39 |
| CMH | 0 | 0 | 110.4 | 0 | 0 | 0.44 |
| ST_HNHT | 18.6 | 179.3 | 90.6 | 0.23 | 0.11 | 0.33 |
| HEX1 | 0 | 0 | 0.0 | 0 | 0 | 0 |
| HP1 | 0 | 0 | 0 | 0 | 0 | 0 |

## HNLT | Single systems

| | ST | kWh | LT | kWh | BE | kWh | ST | €/kWh | LT | €/kWh | BE | €/kWh |
|---|---|---|---|---|---|---|
| BS_HNLT | 175.0 | 0 | 0 | -0.12 | 0 | 0 |
| COMP | 0 | 0 | 49.8 | 0 | 0 | 0.3 |
| ST_HNLT | 1.9 | 238.5 | 117.8 | 0.08 | 0.09 | 0.3 |
| OCTM | 39.2 | 0 | 54.6 | -0.15 | 0 | 0.3 |
| UFH | 0 | 0 | 0 | 0 | 0 | 0 |
| ICTM | 0 | 0 | 0.0 | 0 | 0 | 0 |
| HEX1 | 0 | 0 | 0.0 | 0 | 0 | 0 |
| HP1 | 133.9 | 0 | 0 | -0.13 | 0 | 0 |
| HP2 | 0 | 238.5 | 12.6 | 0 | 0.09 | 0.3 |

## CN | Single systems

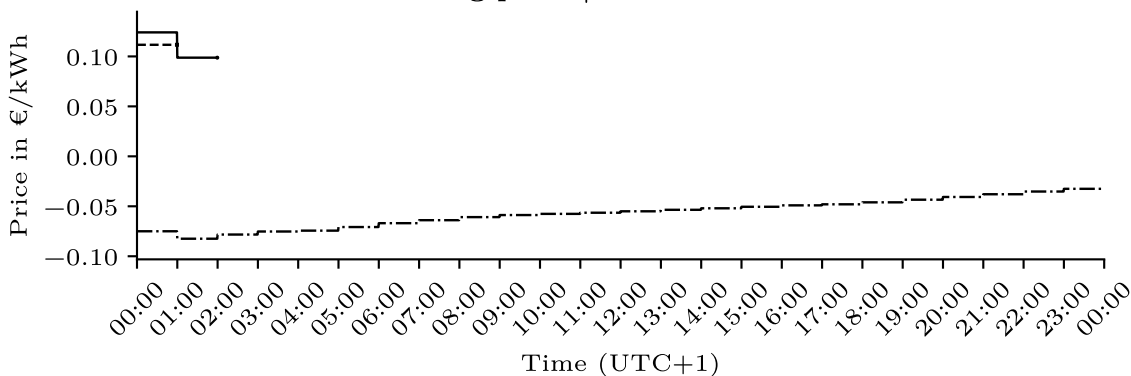| | ST | kWh | LT | kWh | BE | kWh | ST | €/kWh | LT | €/kWh | BE | €/kWh |
|---|---|---|---|---|---|---|
| BS_CN | 0 | 0 | 0 | 0 | 0 | 0 |
| UFH | 0 | 0 | 0 | 0 | 0 | 0 |
| ICTM | 0 | 0 | 0.0 | 0 | 0 | 0 |
| CU | 0 | 424.4 | 424.8 | 0 | -0.06 | 0.3 |
| ST_CN | 0 | 618.8 | 483.0 | 0 | -0.06 | 0.3 |
| CMC | 0 | 0 | 42.5 | 0 | 0 | 0.3 |
| HP2 | 0 | 194.5 | 10.3 | 0 | -0.05 | 0.3 |

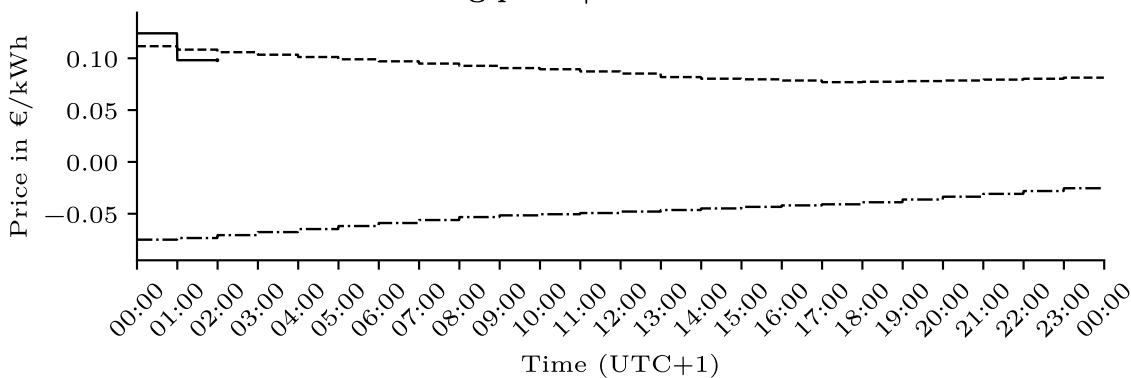**Market clearing price | 0.25 h - Execution in: 0.0 h**
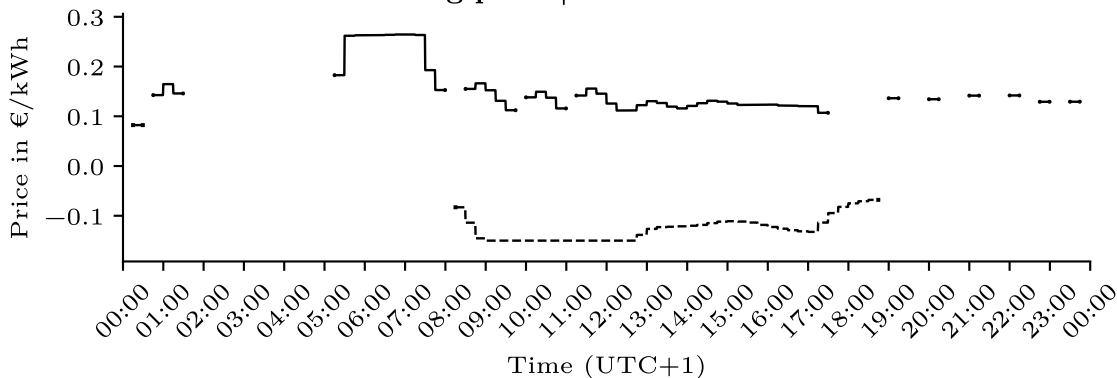
**Market clearing price | 1.0 h - Execution in: 0.0 h**
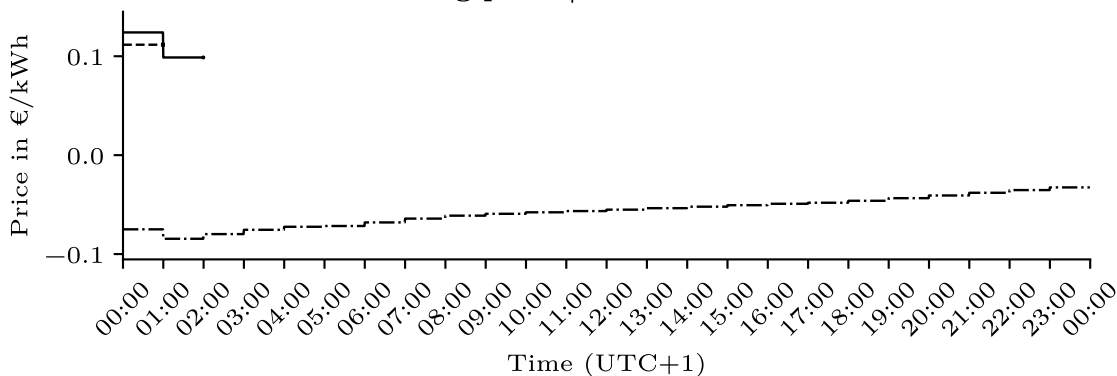
**Market clearing price | 1.0 h - Execution in: 1.0 h**

**Market clearing price | 1.0 h - Execution in: 2.0 h**

— HNHT --- HNLT -·- CN