


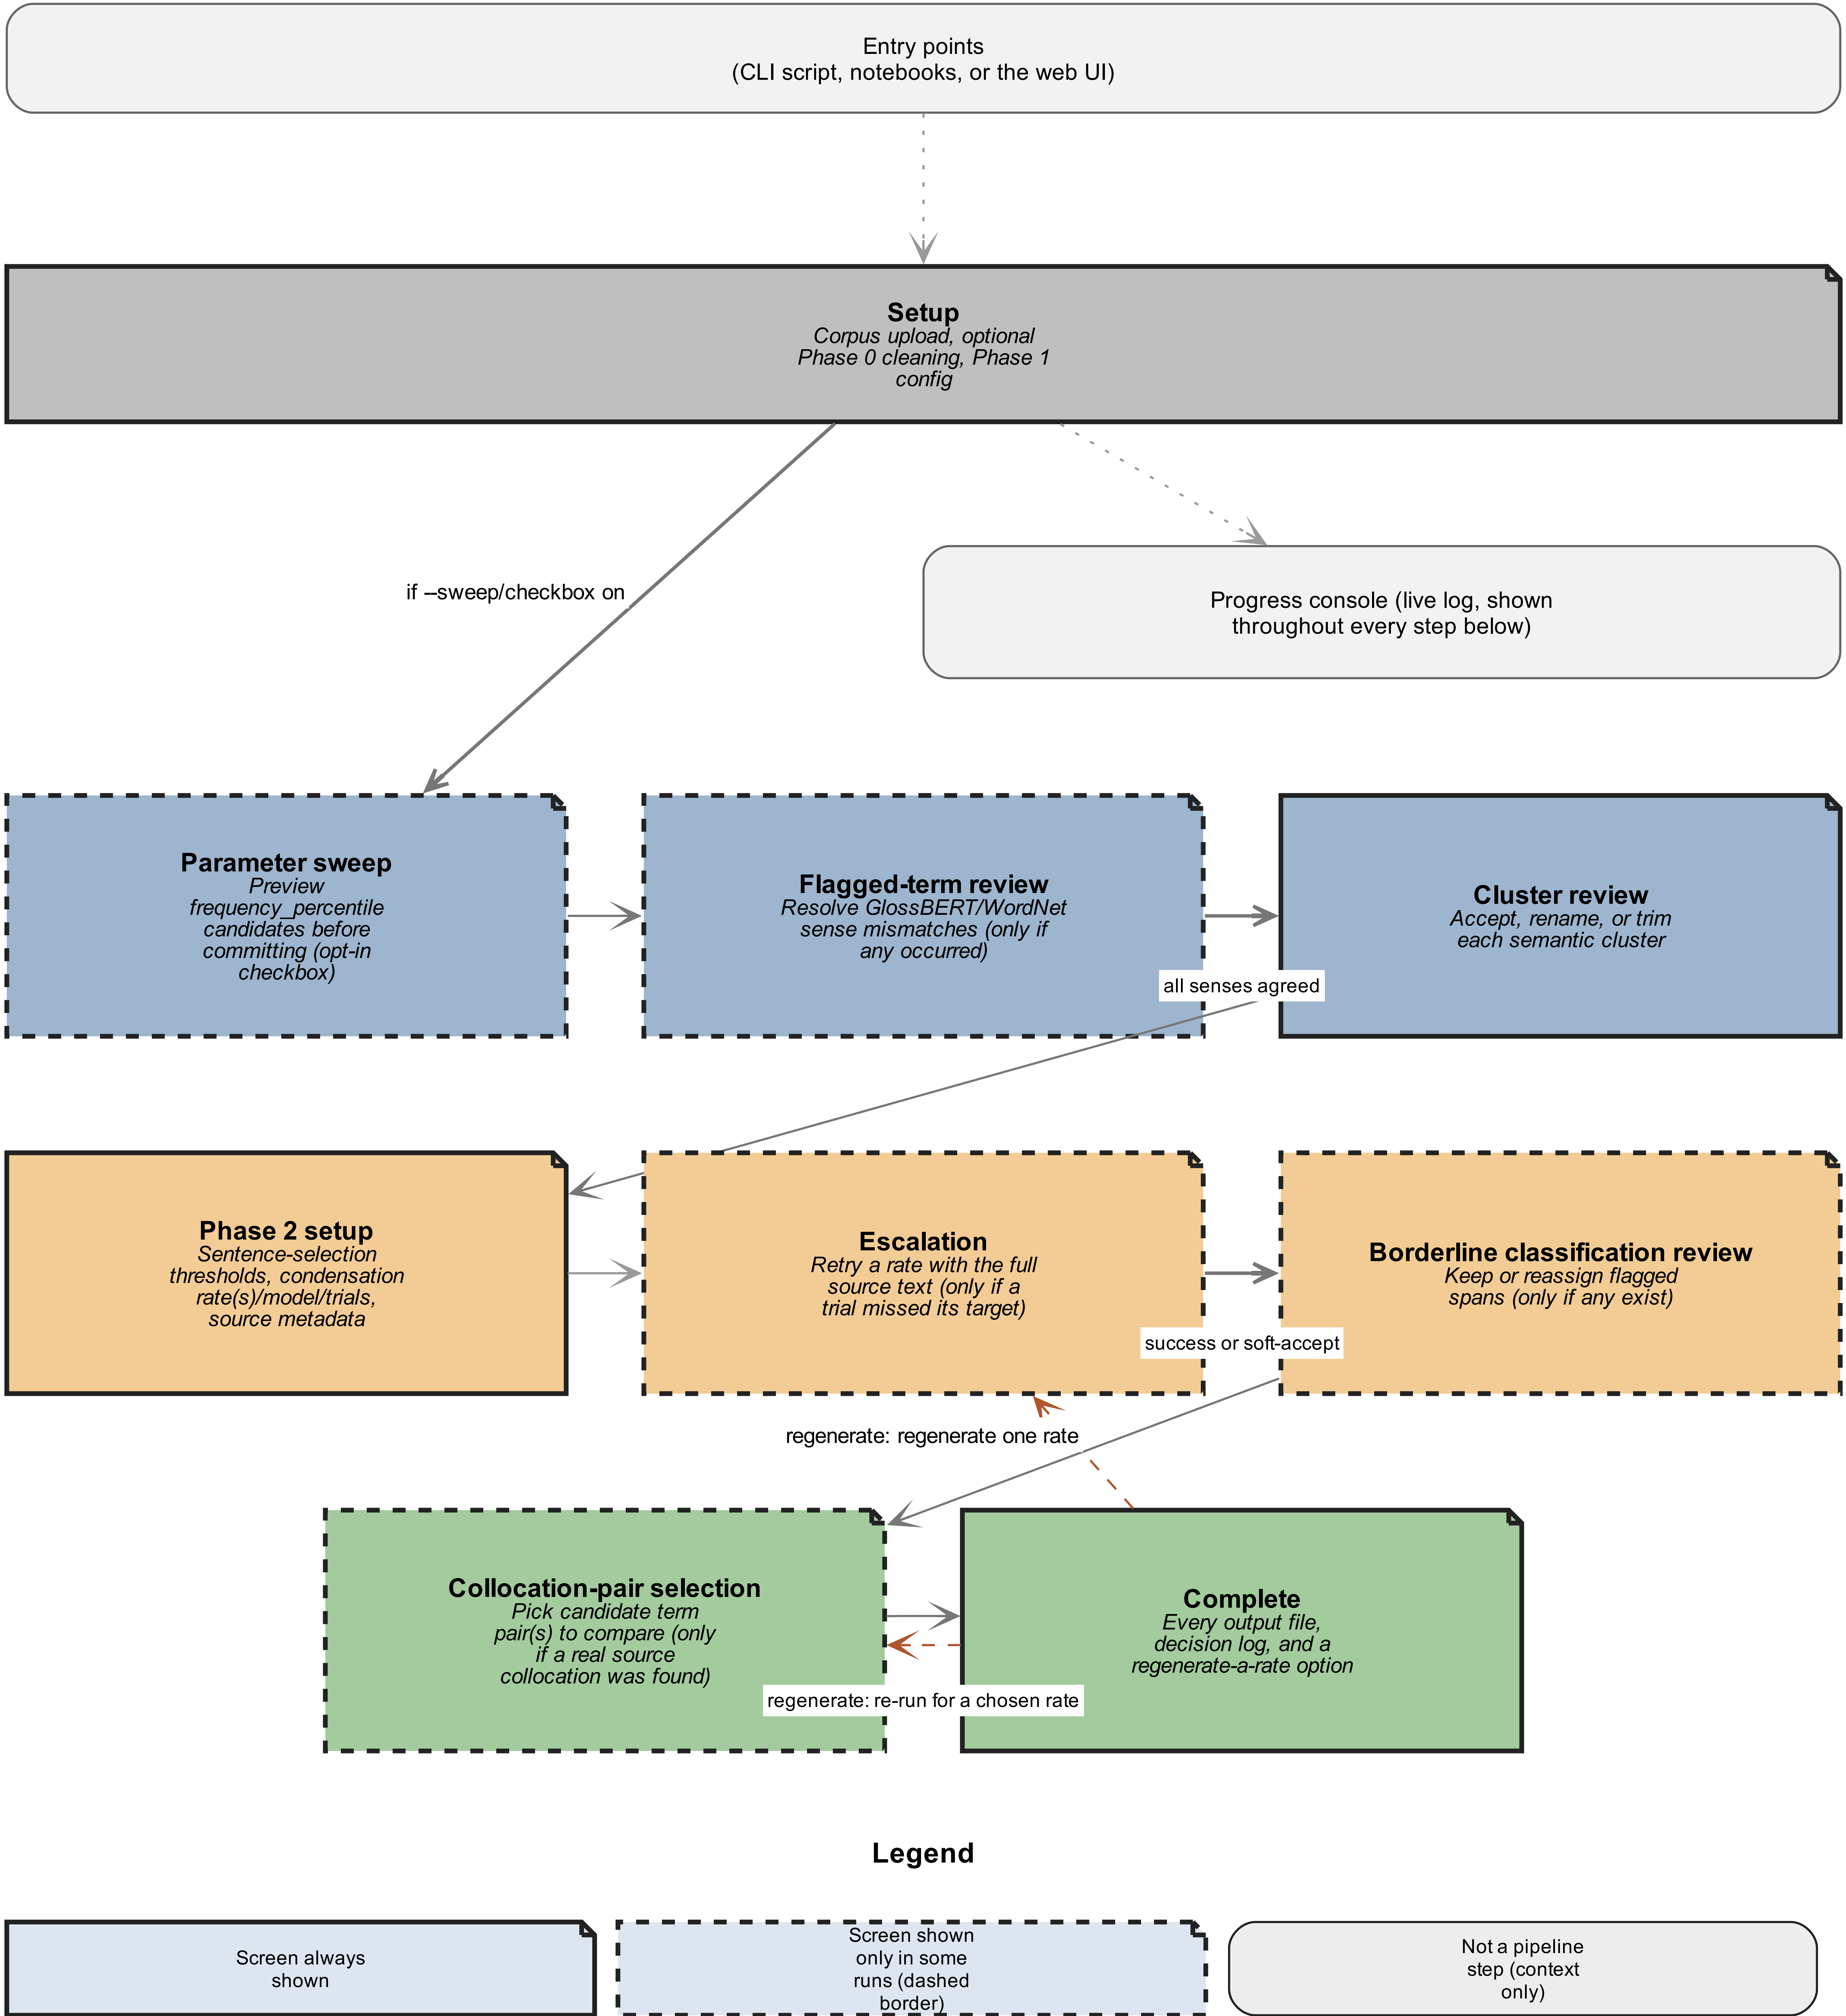

Italic text under each screen's name describes what runs automatically, in the background, before that screen appears.

Orange dashed arrows: from the Complete screen, a researcher can re-run one condensation rate (the 'Regenerate' option) -- this is the only step that goes backward through the diagram instead of forward.