
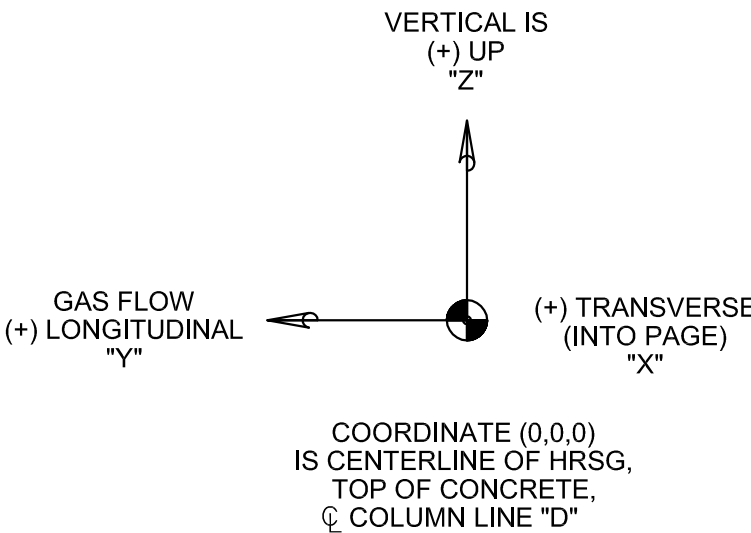


D

C

B

A

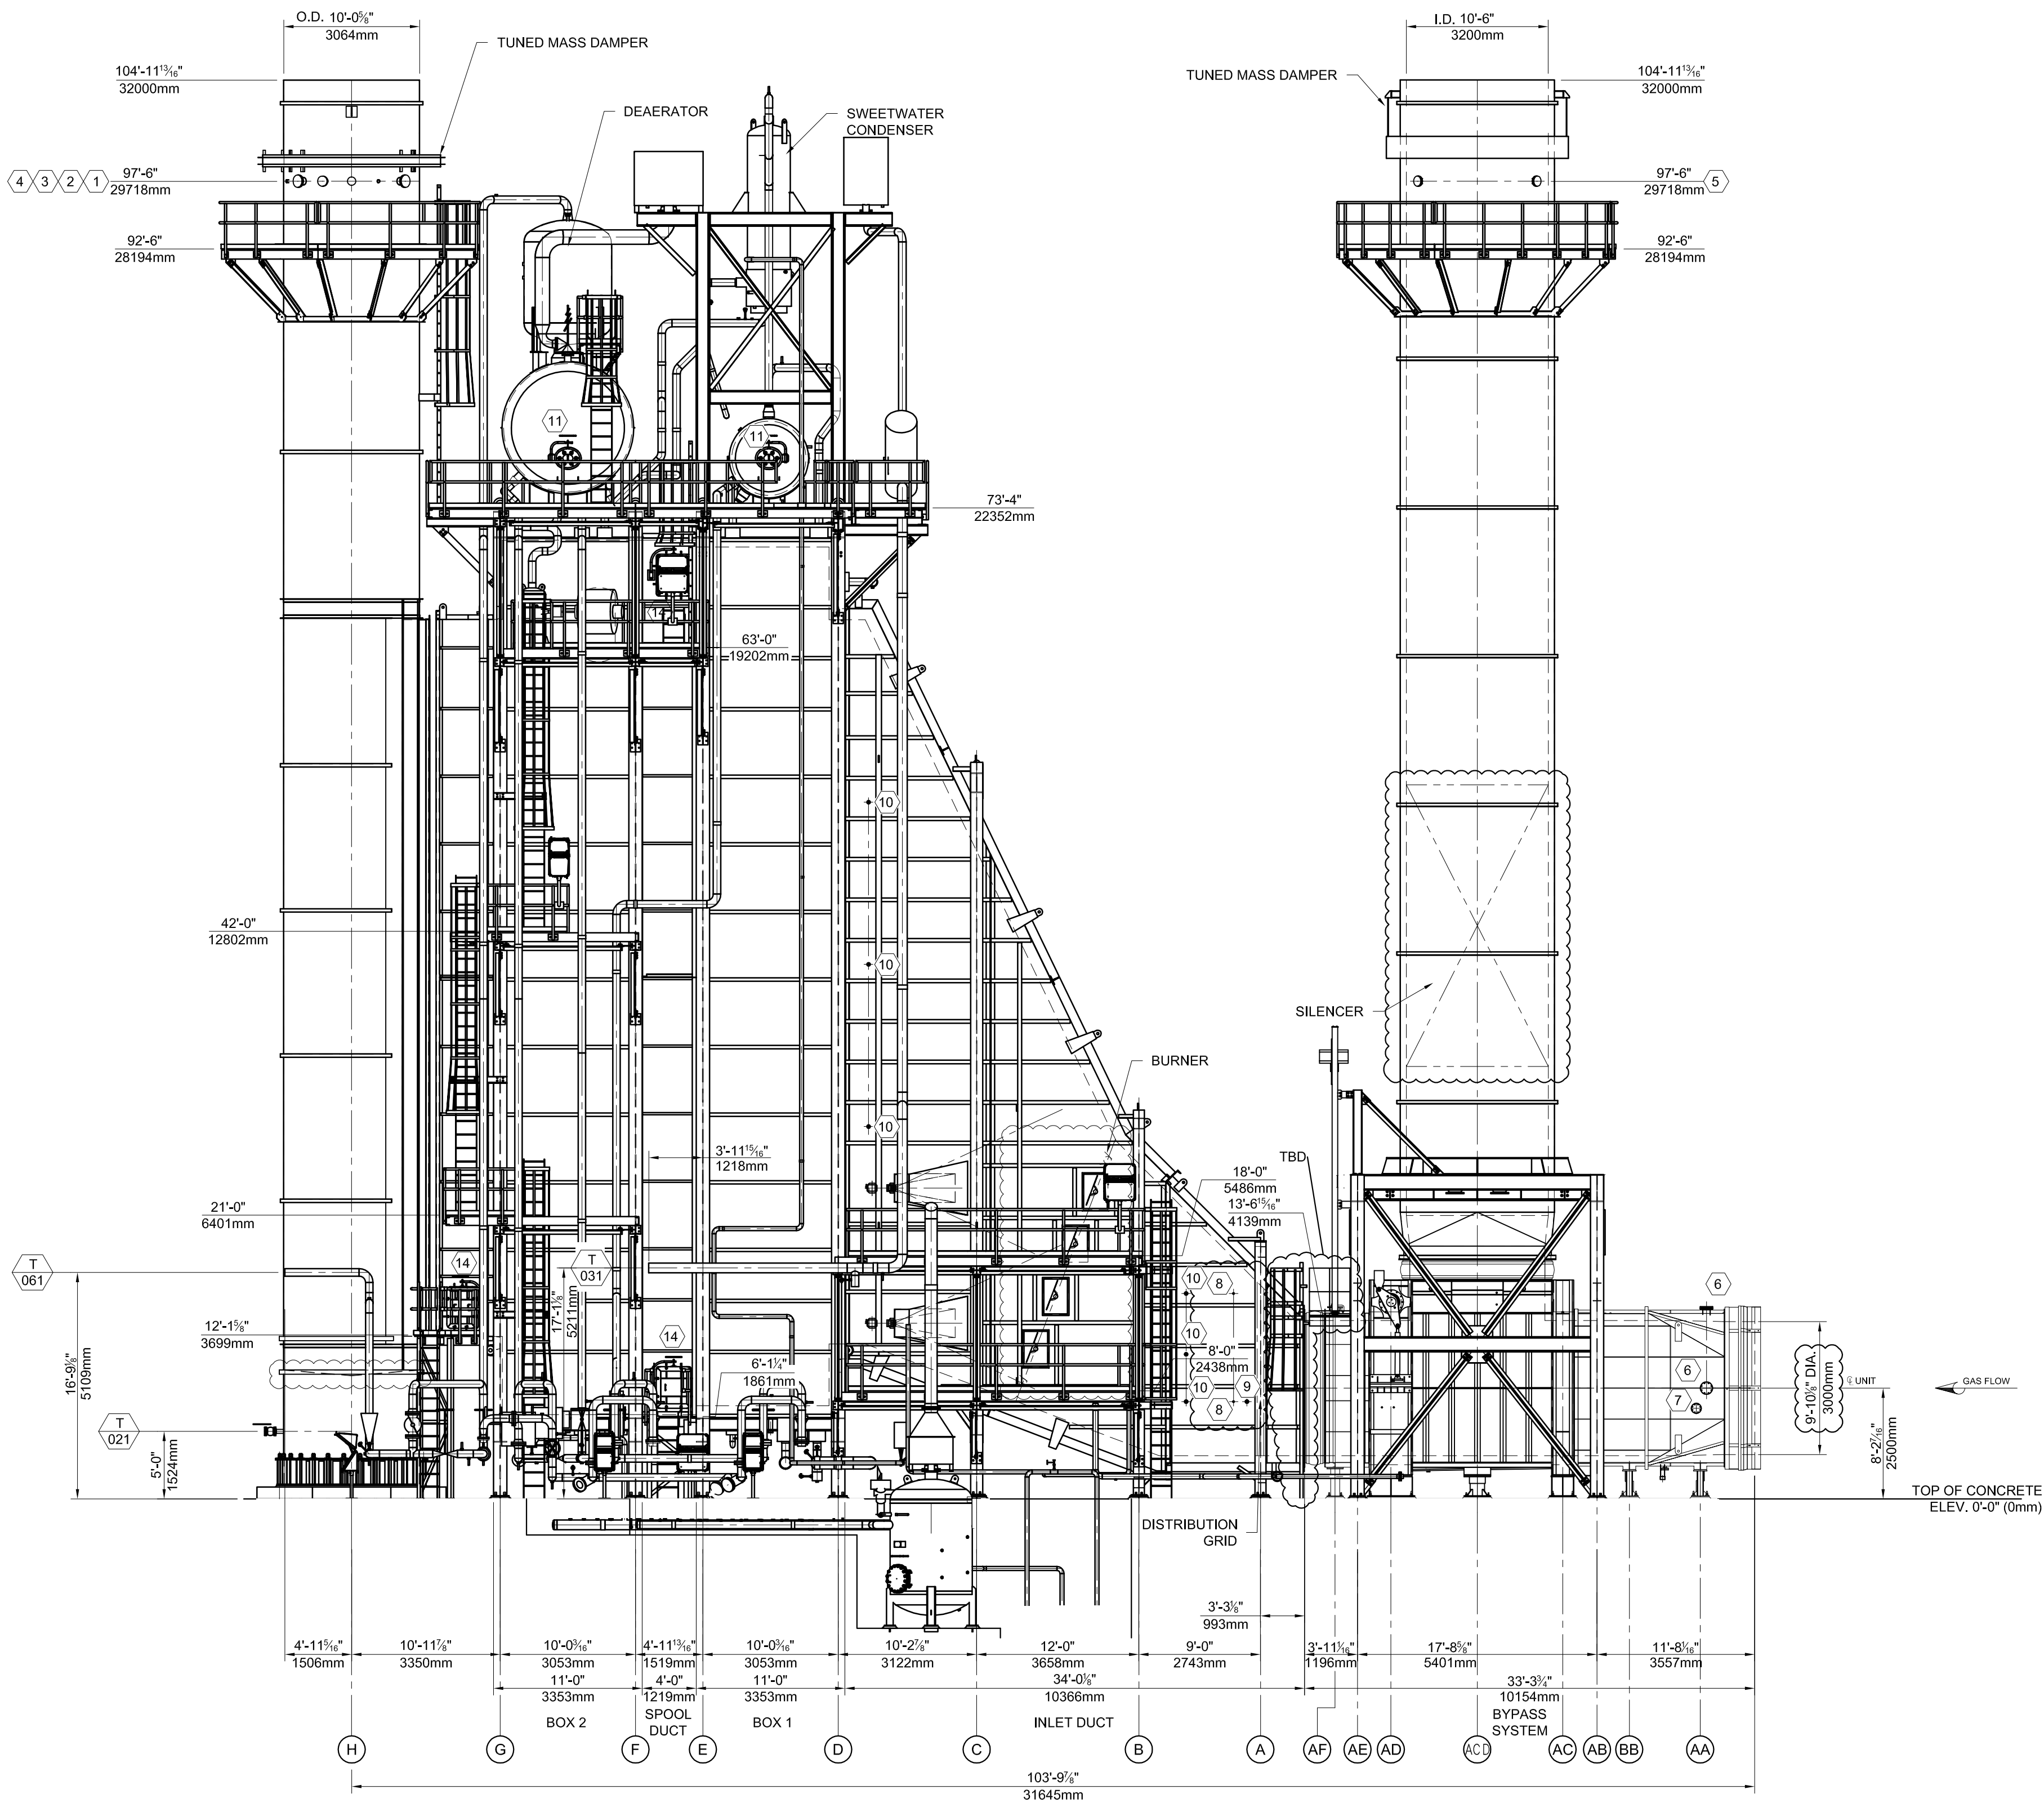

NOTES:
1. SEE V17511-GAND-0001 FOR GENERAL NOTES.

REFERENCE DRAWINGS:
V17511-GAND-0001 THRU 0003 : GENERAL ARRANGEMENTS
V17511-SEND-0001 THRU 0003 : BOILER SETTINGS
V17511-ICND-0001 THRU 0012 : P&ID'S
V17511-FLND-0001 : FOUNDATION DIAGRAM
V17511-SENF-0001 : GENERAL NOTES AND DATA

03	13-July-18	General Revision & Customer Comments	WSP	D.K.	DP
02	13-Apr-18	General Revision & Customer Comments	WSP	D.K.	DP
01	9-Mar-18	General Revision & Customer Comments	WSP	D.K.	DP
00	6-Feb-18	First Issue	WSP	D.K.	DP
REV	FECHA	DESCRIPCION	POR	REVISO	APROBO
This drawing contains Vogt Power International's confidential and proprietary information and cannot be used, duplicated or disclosed in whole or in part, except with the express written permission of Vogt Power International. EXCEPT AS EXPRESSLY STATED IN ANY WRITTEN CONTRACT - ALL WARRANTIES RELATING TO THIS DRAWING, INCLUDING THE WARRANTIES OF MERCHANTABILITY AND FITNESS, ARE DISCLAIMED. © Vogt Power International, Inc. All rights reserved as an unpublished work.					
<div><div></div><div>Vogt Power International Project V17511</div></div>					
PROYECTO CENTRAL TERMOLÉCTRICA ARROYO SECO - CTAS					
N° DOCUMENTO INTERNO V17511-GAND-0002					
EMPRESA GENERACIÓN CENTRO S.A.					
GENERAL ARRANGEMENT LEFT SIDE ELEVATION					
ESCALA	AREA	FECHA 6-Feb-18	HOJA	REV.	
N° DOCUMENTO AR1013-M-LB_-DWG-37086					
03					