



Representative day-ahead supply curves by technology, 2025-12-17 hour 16 quarter 4 (evening-ramp critical hour)


CCGT --- LARES2 (7 tranches)

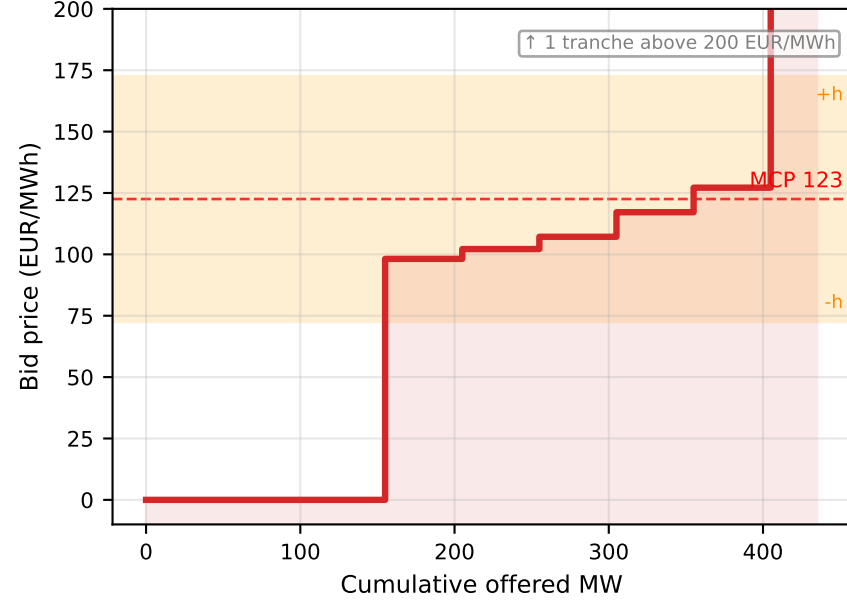


Nuclear --- ASC2 (1 tranche)

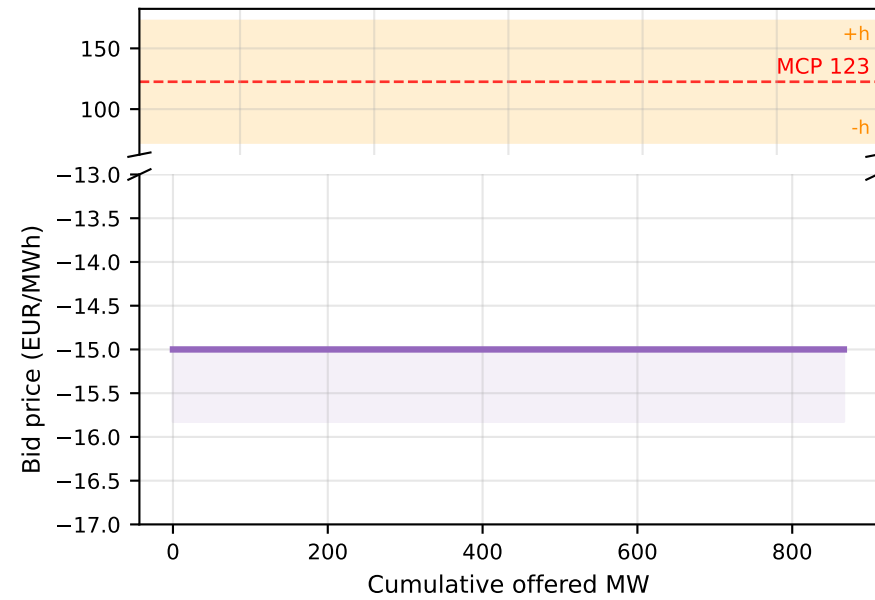


Hydro --- DUER (23 tranches)

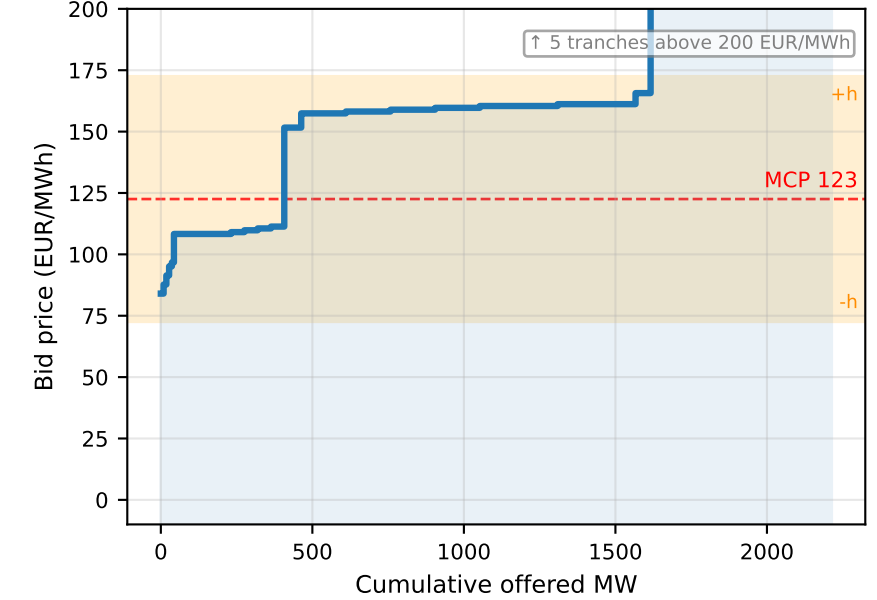

Pump-storage --- MUEL (14 tranches)

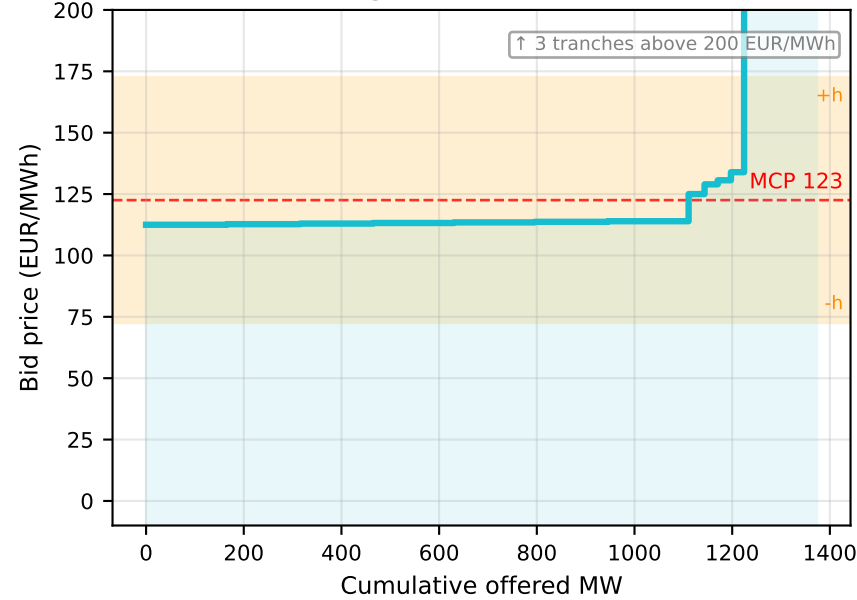

Wind (aggregator) --- EGEDRE1 (1 tranche)

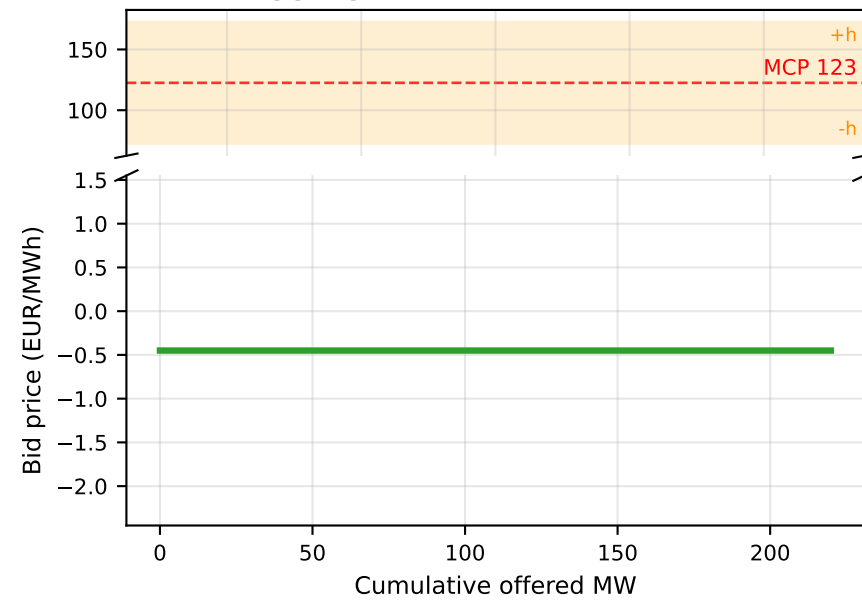

Solar PV (aggregator) --- EGVD503 (1 tranche)

