



Aggregate IDA demand curves by quarter within critical hours (Pump_load, Oct--Dec 2025)

Quarter 1 (00--15 min) Quarter 2 (15--30 min) Quarter 3 (30--45 min) Quarter 4 (45--60 min)


Iberdrola

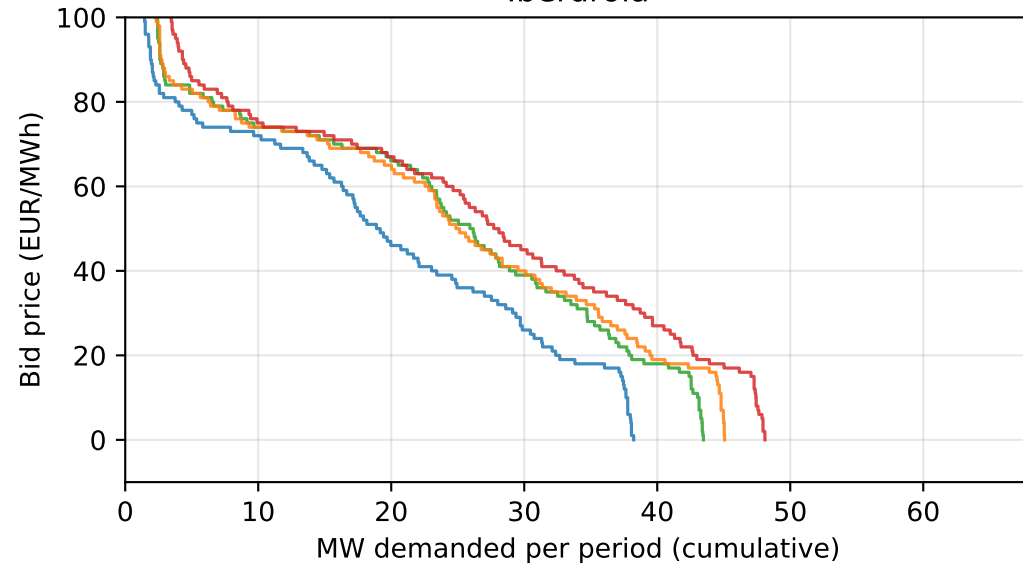

Endesa

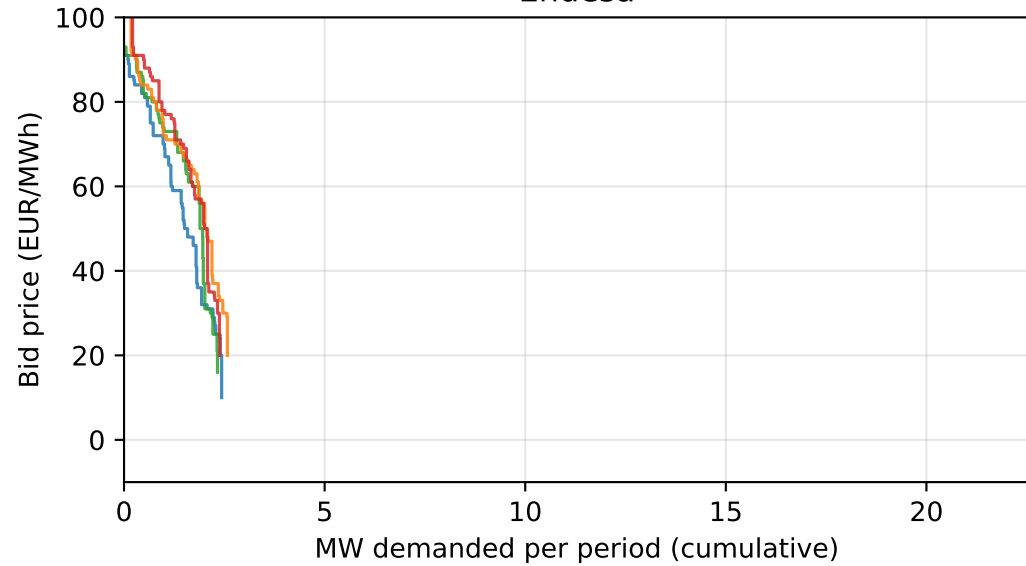

Naturgy

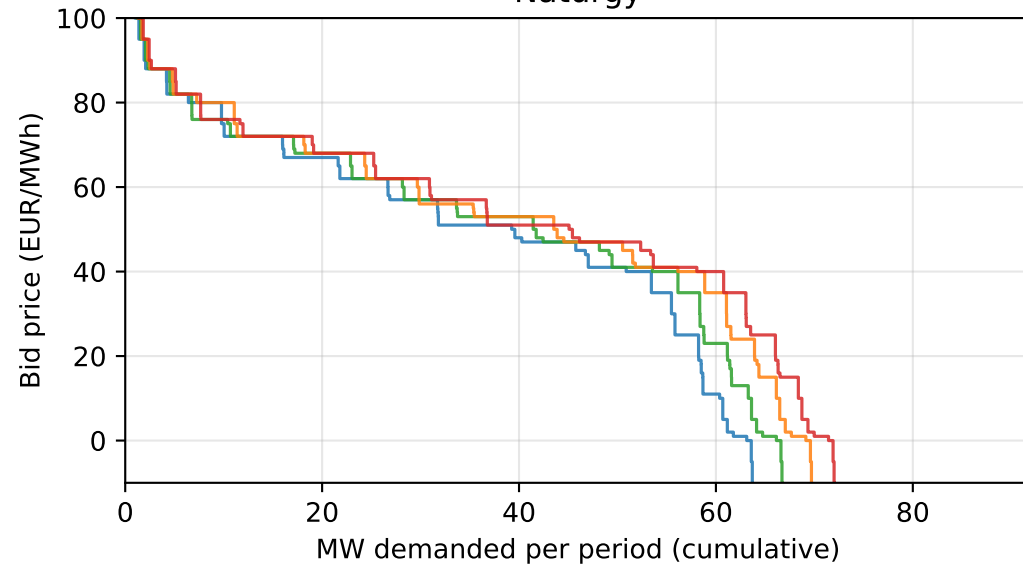

EDP-Spain

