


\\msh\corporate\PS\Projects\01\1543918 - DESIGN\B. DESIGNS\B. DESIGNS\15-BURITI-7B-Z-0-2-50.dwg 9:07:21 10/30/21 AM Abum

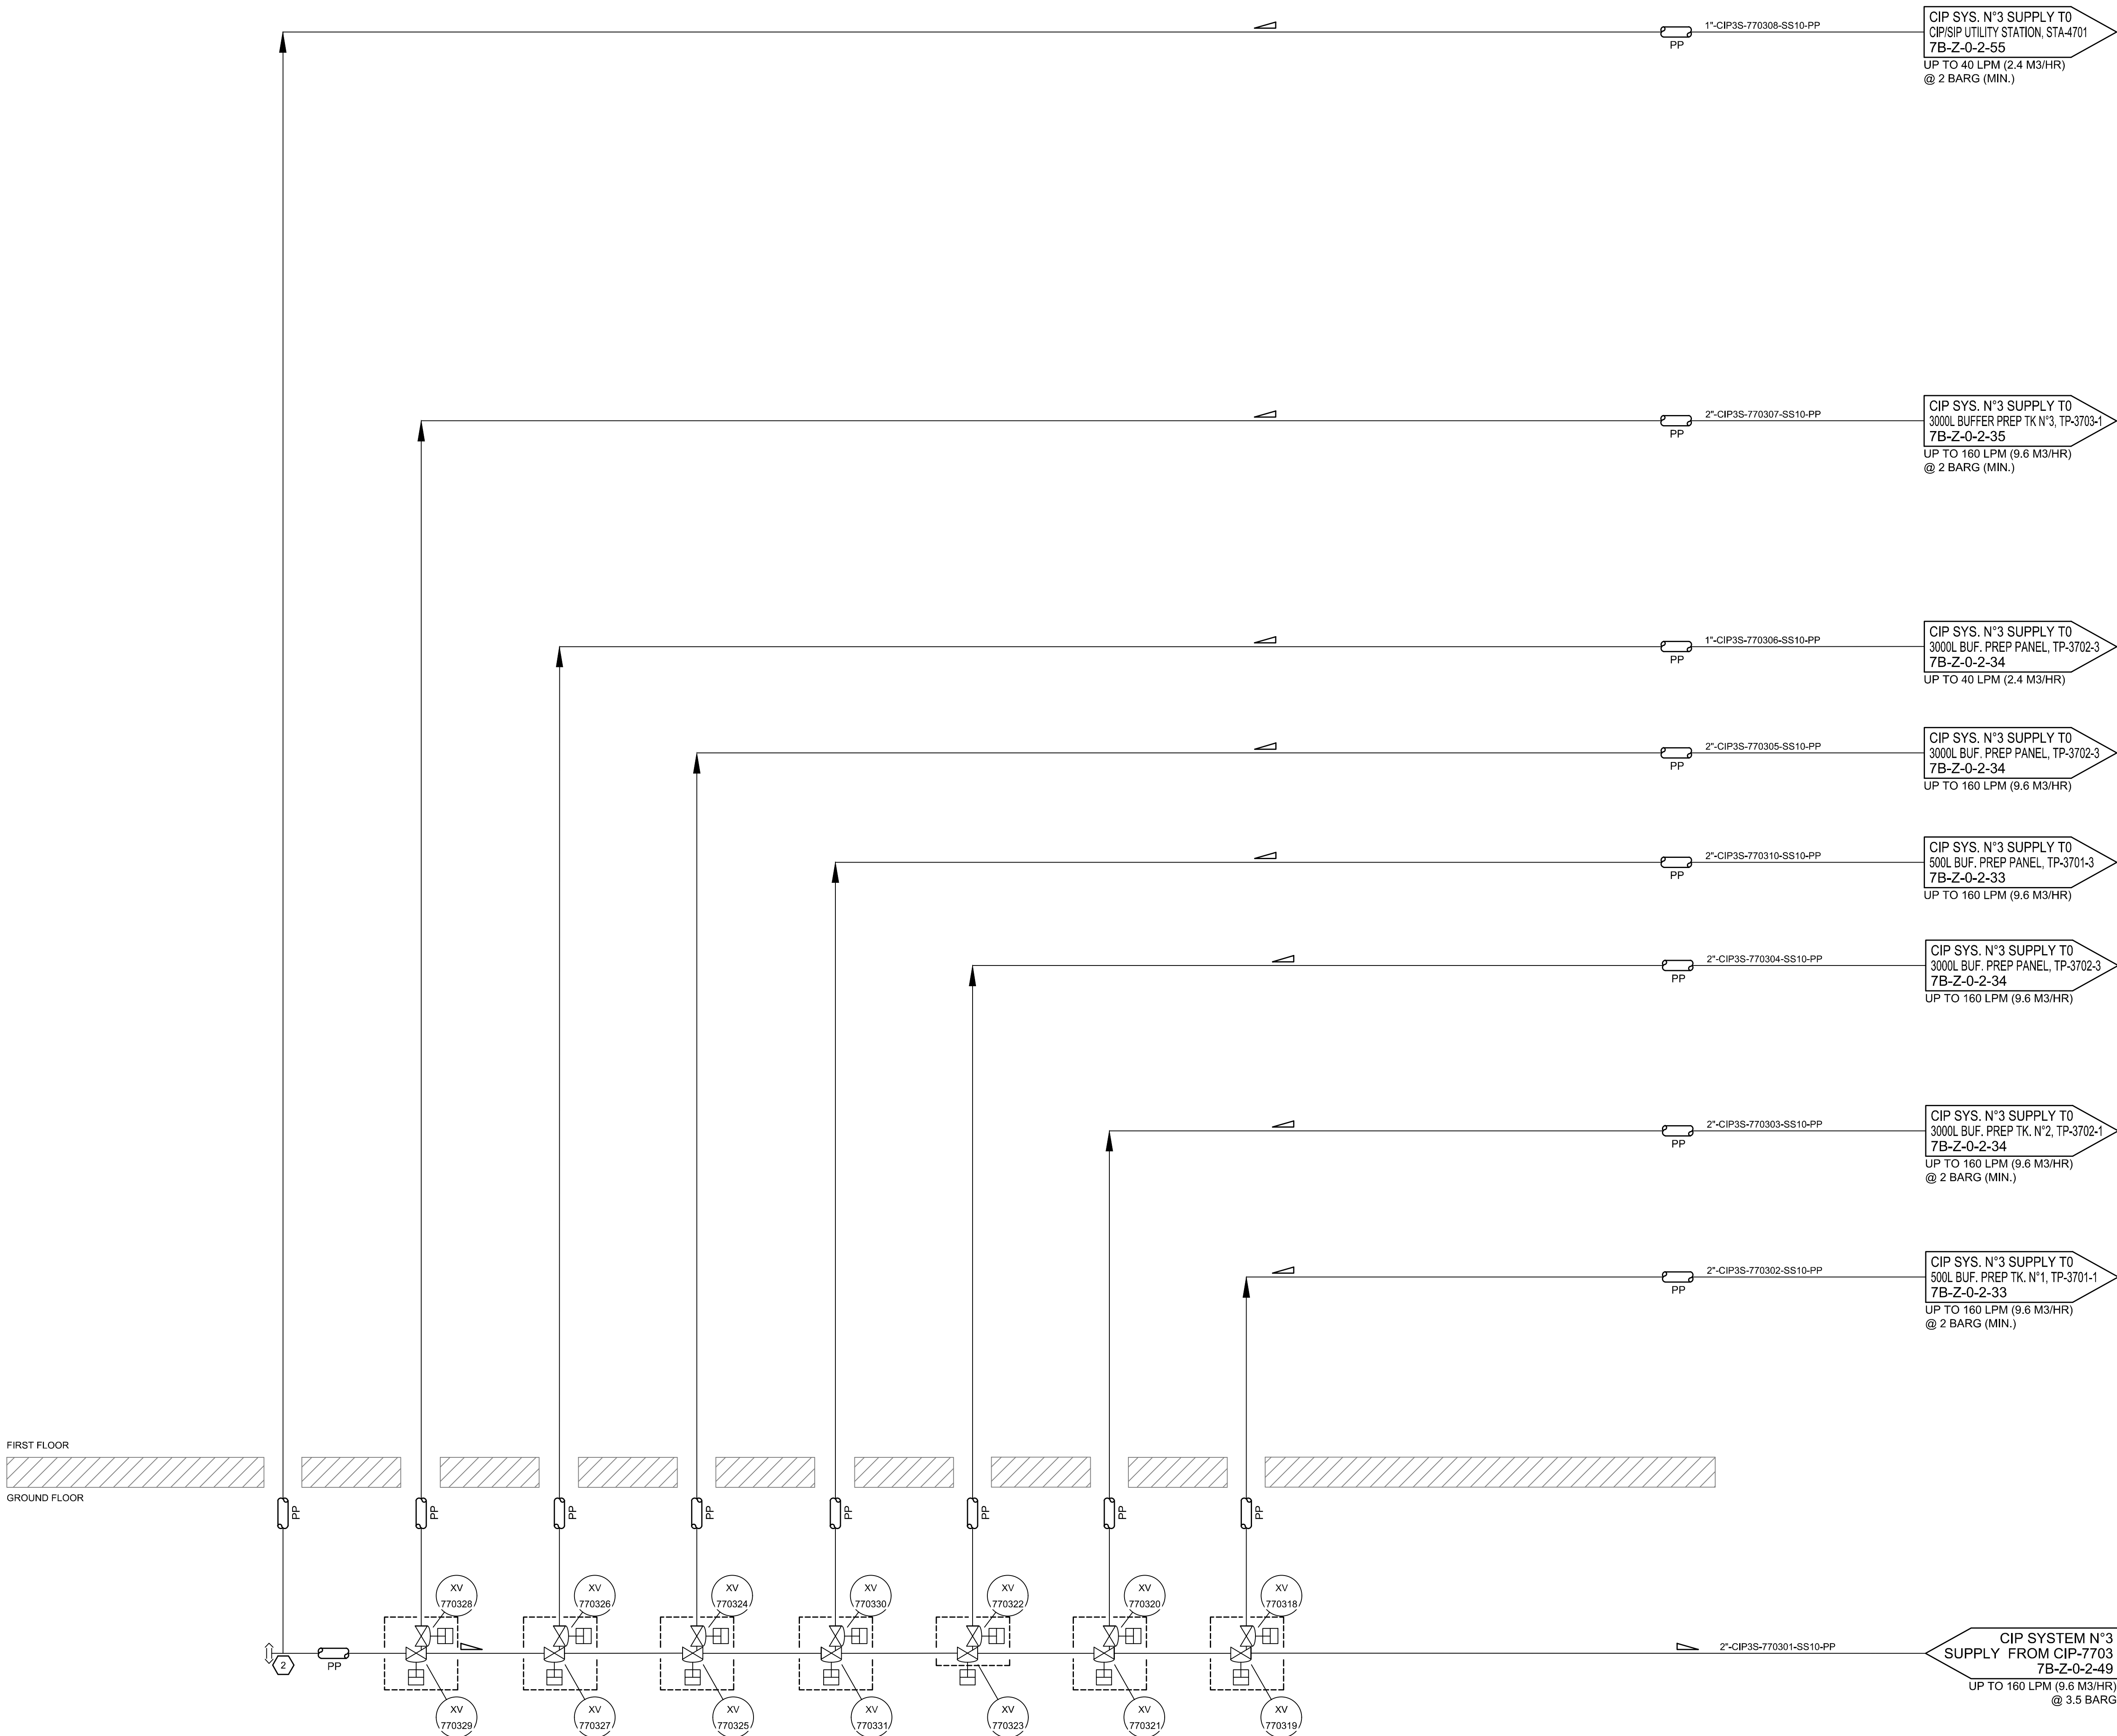

Robert L. De Souza Jr.
**ISSUED FOR
CONSTRUCTION**

SEAL
THIS IS NOT A
SEALED DOCUMENT
DATE: _____

GENERAL NOTES:

1. ALL COMPONENT & EQUIPMENT NUMBERS ARE PRECEDED BY "7B" TO REPRESENT THE BULK DRUG SUBSTANCE (BDS) BUILDING.
2. ALL AUTOMATIC VALVES FAIL CLOSED (F.C.). UNLESS NOTED FAIL OPEN (F.O.).
3. ALL PLC/COMPUTER CONNECTIONS ARE WITHIN THE PCS UNLESS OTHERWISE NOTED.
4. LAST LINE NUMBER: REFER TO DRAWING 7B-Z-0-2-51
5. LINE NUMBER NOT USED: REFER TO DRAWING 7B-Z-0-2-51
6. LAST AUTO VALVE NUMBER: REFER TO DRAWING 7B-Z-0-2-51
7. AUTO VALVE NUMBERS NOT USED: REFER TO DRAWING 7B-Z-0-2-51
8. LAST MANUAL VALVE NUMBER: REFER TO DRAWING 7B-Z-0-2-51
9. MANUAL VALVE NUMBERS NOT USED: REFER TO DRAWING 7B-Z-0-2-51

SHEET NOTES

1. DELETED.
2. CONTRACTOR SHALL PROVIDE A SHORT OUTLET 2" X 1" REDUCING TEE.
3. DELETED.

ips
Integrated Project Services
Engineering
Design/Build
Commissioning
Consulting

721 Arbor Way
Suite 100
BLUE BELL, PA 19422
PHONE: (610) 828-4090
FAX: (610) 828-3656
www.ipsdb.com

IPS Professional Engineers and Architects, LLC.

REVISION	DATE	DESCRIPTION	BY
A	28NOV2020	90% BD ISSUE	JJR
B	27NOV2020	DESIGN ISSUE	JJR
C	12FEB2021	90% DO ISSUE	RLO
D	12NOV2021	90% DO ISSUE	RLO
E	09SEP2021	CONSTRUCTION ISSUE	RLO



R. Dr. Cesário Mota Júnior, 424 - Vila Burques, São Paulo - SP, 01221-020

REVISION HISTORY

- 1 REV. 0 - NONE.

CONFIDENTIAL

THE INFORMATION CONTAINED HEREIN MAY NOT BE USED OR REPRODUCED IN ANY MANNER WITHOUT WRITTEN PERMISSION OF INTEGRATED PROJECT SERVICES.

CLIENT



BURITI EPCMV

DRAWING TITLE

**P&I DIAGRAM
DRUG SUBSTANCE
CIP SYSTEM N°3, CIP-7703
SUPPLY - BUFFER AREA**

ENGINEER	ARCHITECT	DESIGNER	IPS PROJECT #
JJR	BJE	JJR	ITD19439.01
DRAWN BY	REVIEWED BY	SCALE	CADD FILE NAME
LG	GJC	NONE	7B-Z-0-2-50

XREF FILE(S)

DRAWING NUMBER

7B-Z-0-2-50