


\\msh\corporate\PS\Projects\01\184518 - DESIGNS\8 - Project Drawings\Process\7B-BURITI-Z-0-2-51.dwg 9-07-21 10:36:02 AM Adam



GENERAL NOTES:

1. ALL COMPONENT & EQUIPMENT NUMBERS ARE PRECEDED BY "7B" TO REPRESENT THE BULK DRUG SUBSTANCE (BDS) BUILDING.
2. ALL AUTOMATIC VALVES FAIL CLOSED (F.C.) UNLESS NOTED FAIL OPEN (F.O.).
3. ALL PLC/COMPUTER CONNECTIONS ARE WITHIN THE PCS UNLESS OTHERWISE NOTED.
4. LAST LINE NUMBER: 770327
5. LINE NUMBER NOT USED: 770314 - 18
6. LAST AUTO VALVE NUMBER: XV-770363
7. AUTO VALVE NUMBERS NOT USED: XV-770366, 06, 12, 17, 31 - 39
8. LAST MANUAL VALVE NUMBER: HV-770313
9. MANUAL VALVE NUMBERS NOT USED: NONE

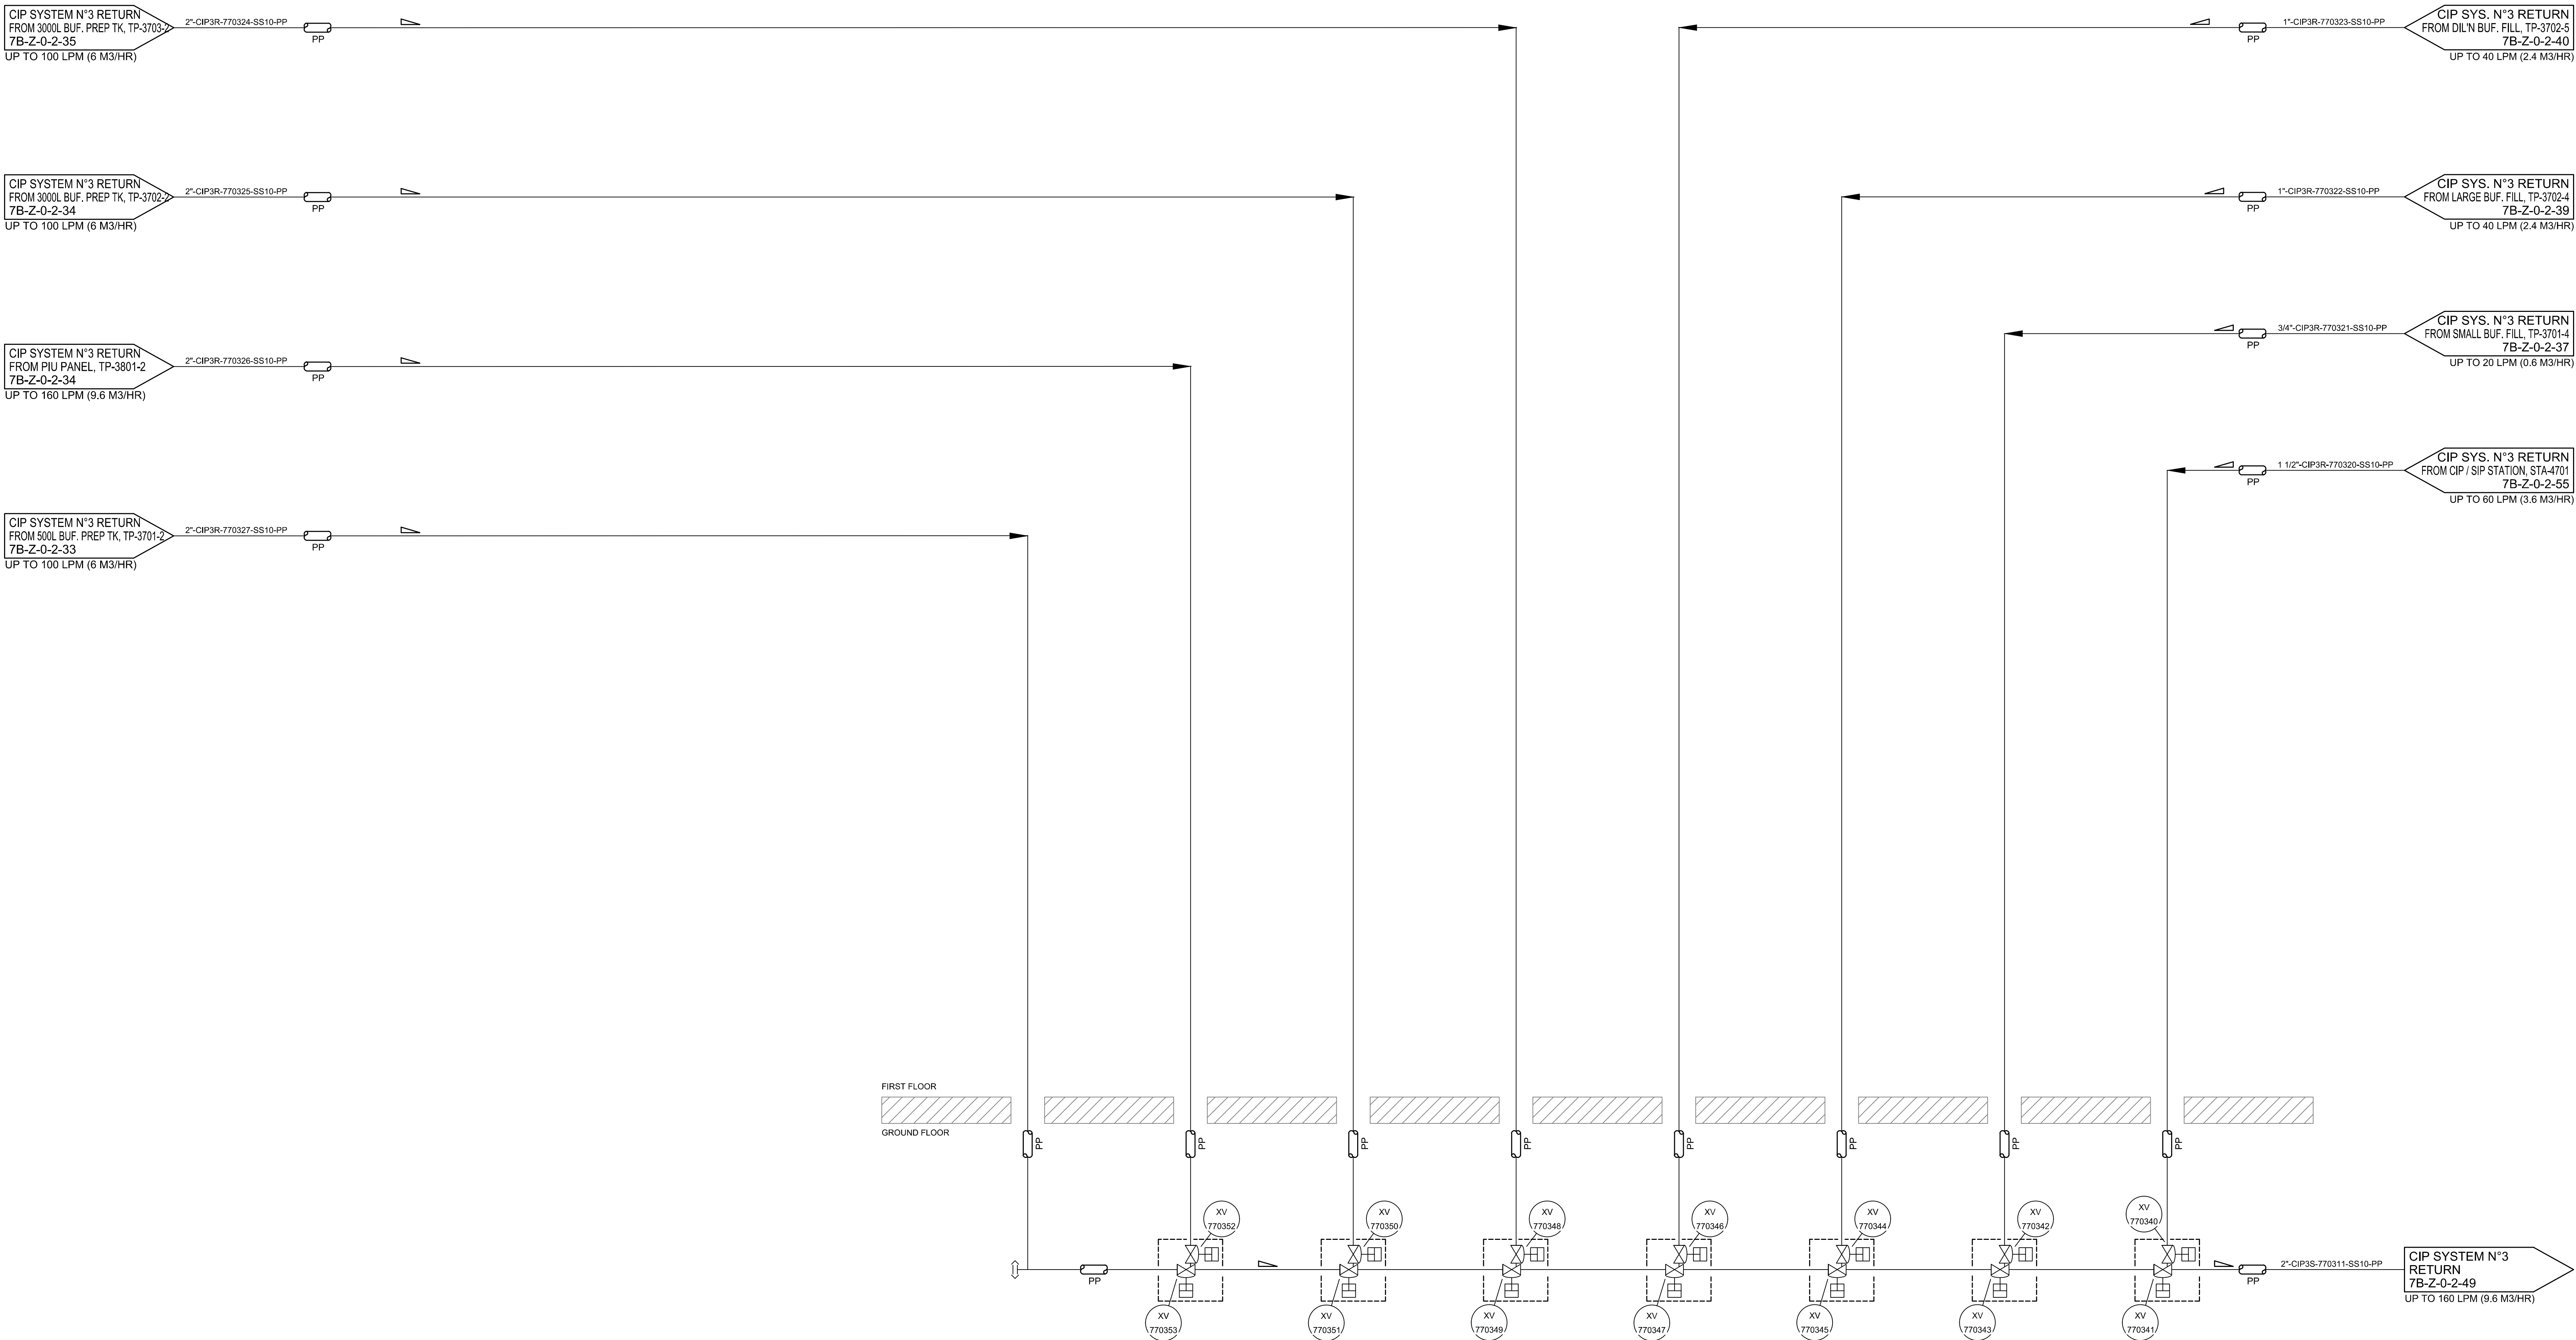

Integrated Project Services

Engineering
Design/Build
Commissioning
Consulting

721 Arbor Way
Suite 100
BLUE BELL, PA 19422
PHONE: (610) 828-4090
FAX: (610) 828-3656
www.ipsdb.com

IPS Professional Engineers and Architects, LLC.

REVISION	DATE	DESCRIPTION	BY
A	28NOV2020	90% BD ISSUE	JJR
B	27NOV2020	DESIGN ISSUE	JJR
C	12FEB2021	90% DO ISSUE	RLD
D	12MAY2021	90% DO ISSUE	RLD
E	06SEP2021	CONSTRUCTION ISSUE	RLD



R. Dr. Cesário Mota Júnior, 424 - Vila Buarque, São Paulo - SP, 01221-020

REVISION HISTORY

1 REV. 0 - NONE.

CONFIDENTIAL

THE INFORMATION CONTAINED HEREIN MAY NOT BE USED OR REPRODUCED IN ANY MANNER WITHOUT WRITTEN PERMISSION OF INTEGRATED PROJECT SERVICES.

CLIENT



BURITI EPCMV

DRAWING TITLE

P&I DIAGRAM
DRUG SUBSTANCE
CIP SYSTEM N°3, CIP-7703
RETURN - BUFFER AREA

ENGINEER	ARCHITECT	DESIGNER	IPS PROJECT #
JJR	BJE	JJR	ITD19439.01
DRAWN BY	REVIEWED BY	SCALE	CADD FILE NAME
LG	GJC	NONE	7B-Z-0-2-51

XREF FILE(S)

DRAWING NUMBER

7B-Z-0-2-51

SEAL

THIS IS NOT A
SEALED DOCUMENT

DATE: _____

Robert L. De Souza Jr.

ISSUED FOR
CONSTRUCTION