




 **TESSLER**
engenharia

1 REV. 0 - NONE

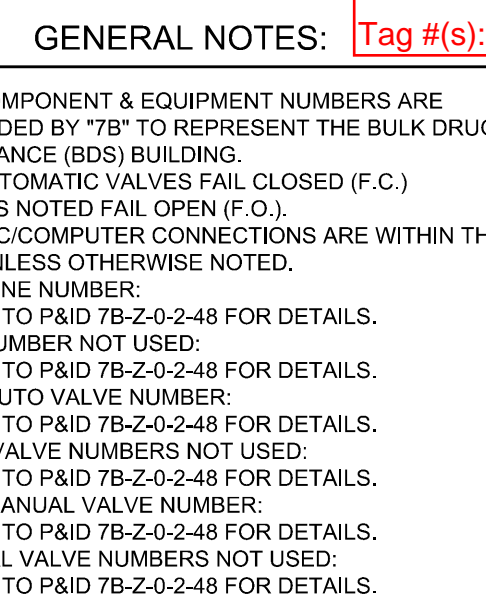

- 1 VENDOR IS ENCOURAGED TO SUPPLY THEIR STANDARD CP SYSTEM DESIGN AS LONG AS IT MEETS THE INTENT OF THE DESIGN SHOWN. REFERENCE THE PURCHASING SPECIFICATION AND DATA SHEET FOR MATERIALS OF CONSTRUCTION AND ADDITIONAL INFORMATION.
- 2 **VENDOR SHALL SUPPLY SECONDARY CONTAINER FOR CLEANING CHEMICAL DAY TANK**
- 3 APPROXIMATE FEED RATE = 60 LPM.
- 4 VENDOR SHALL SUPPLY MKS SERIES 48 NEMA 4X FILTER HOUSING HEATER WITH TEMPERATURE CONTROLLER ACCESSIBLE FROM GRADE LEVEL.
- 5 TO 150 MM ABOVE FINISHED FLOOR AND SAFE LOCATION.
- 6 OPEN/CLOSE CPW HWFI FEED VALVES XV-630204 A XV-640104 BY THE LEVEL CONTROL.

1 INTERLOCK TO XV-770206, 07, 08 PREVENTING
XV-770206 AND 07; XV-770206 AND 08; AND XV-770206
07, AND 08 FROM OPENING AT THE SAME TIME.

SEAL

THIS IS NOT A
SEALED DOCUMENT

DATE:

ISSUED FOR
CONSTRUCTION

LA