

REVISION D NOTES / NOTAS REVISÃO D ADDED IT TAG NUMBER, ADICIONADO TAG NUMÉRICA NO IT ADDED UTP CABLES FOR IT ADICIONADO CABOS UTP PARA IT RENAMED CABLE TRAY IT CCTV + ACS TO UTP CABLE TRAY
RENOMEADA A ELETROCALHA IT CCTV + ACS PARA
ELETROCALHA UTP

REVISION 0 NOTES / NOTAS REVISÃO 0

UPDATED TP REVISION 0 ATUALIZADO PARA REVISÃO 0

REVISION 1 NOTES / NOTAS REVISÃO 1

TRANSLATED TO PORTUGUESE. TRADUZIDO PARA O PORTUGUÊS.

Project Services 721 ARBOR WAY, SUITE 100 **BLUE BELL** PENNSYLVANIA 19422

Engineering Design/Build PHONE: 610.828.4090 FAX: 610.828.3656 Compliance Consulting www.ipsdb.com IPS Professional Engineers and Architects, PC. 
 REV
 DATE
 DESCRIPTION

 A
 09JUL2020
 50% BD ISSUE


 B
 28AUG2020
 90% BD ISSUE

 C
 16OCT2020
 FINAL BD ISSUE

 D
 27APR2021
 90%DD ISSUE

 0
 11/OCT/21
 ISSUE FOR CONSTRUCTION

 1
 09NOV2021
 ISSUED FOR CONSTRUCTION CONSIDERING COMMENTS

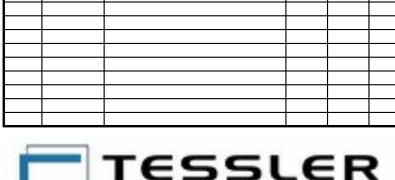

R. Dr. Cesário Mota Júnior, 424 - Vila Buarque, São Paulo - SP, 01221-020

GENERAL NOTES: / NOTAS GERAIS:

. FOR LEGEND, ABBREVIATIONS AND SYMBOL SEE SHEETS 7A-I-0-0-01. PARA LEGENDA, ABREVIATURAS E SÍMBOLOS, VER DES. 7A-I-0-0-01. 2. FOR TELECOMMUNICATIONS VoIP&DATA RISER DIAGRAM, SEE SHEET PARA DIAGRAMA DE TELECOMUNICAÇÕES VoIP E DADOS, VER DESENHO 7A-I-0-7-01. 3. ALL CONDUIT SHALL BE Ø3/4" UNLESS NOTED OTHERWISE. TODOS ELETRODUTOS DEVEM SER Ø3/4", SALVO ONDE INDICADOS. 4. SUPORTES TO CABLE TRAYS AND CONDUITS SHALL BE PROVIDE TO


EACH 2,00 METERS
SUPORTES P/ BANDEJAS, ELETROD. DEVEM SER MONTADOS A CADA 2m 5. ALL TELECOMMUNICATION ETHERNET CABLING BY OWNER'S TELECOMMUNICATION CONTRACTOR. TODOS OS CABOS DE ETHERNET DE TELECOMUNICAÇÕES PELO CONTRATADO DE TELECOMUNICAÇÕES DO PROPRIETÁRIO. 3. ALL DIMENSIONS SHALL BE IN MILLIMETERS UNLESS NOTED OTHERWISE. TODAS DIMENSÕES EM MILÍMETROS, SALVO ONDE INDICADAS. MATERIAL LIST SEE DOCUMENT NUMBER PRD-AIC-LIS-019. PARA LISTA DE MATERIAIS, VER DOCUMENTO № PRD-AIC-LIS-019. 8. FOR TYPICAL DETAILS SEE DOCUMENT 07-I-0-6-01. PARA DETALHES TÍPICOS, VER DES. № 07-I-0-6-01.


. TO DRAWING LIST SEE DOCUMENT 7A-I-0-0-01.


PARA LISTA DE DESENHOS, VER O DOCUMENTO 7A-I-0-0-01.

10. THE CONDUITS OF THE IT CCTV SYSTEM DEDICATED TO OPTICAL FIBER MUST BE SHARED, INCLUDING OPTICAL FIBERS FROM THE ACCESS CONTROL AND DOOR INTERLOCK SYSTEM. OS ELETROD; DO SISTEMA IT\_CCTV DEDICADOS À FIBRA ÓPTICA DEVEM SER COMPARTILHADOS, INCLUINDO FIBRAS ÓPTICAS DO SISTEMA DE CONTROLE DE ACESSO E BLOQUEIO DE PORTA. 11. FOR TECHNICAL SPECIFICATION SEE DOCUMENT PRD-AIC-TSP-013.

PARA ESPECIFICAÇÕES TÉCNICAS DO ACS VER DOCUMENTO
PRD-AIC-TSP-003.

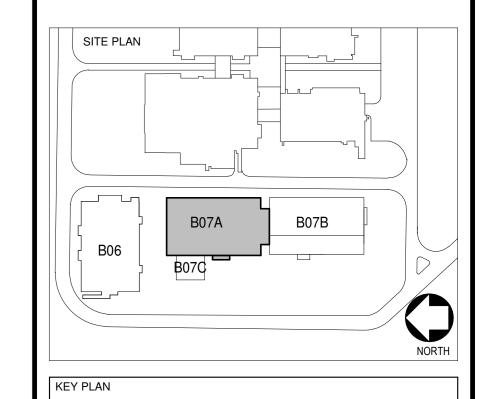

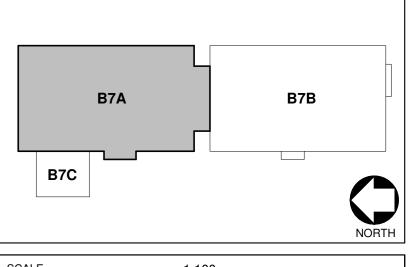



**CONFIDENTIAL** 

THE INFORMATION CONTAINED HEREIN MAY NOT BE USED OR REPRODUCED IN ANY MANNER WITHOUT WRITTEN PERMISSION OF INTEGRATED PROJECT SERVICES.



**BURITI EPCMV PROJECT** 

**DRUG PRODUCT TELECOM VoIP&DATA SECOND FLOOR** 

ENGINEER ARCHITECT DESIGNER IPS PROJECT # FJT ITD19439.01 DRAWN BY REVIEWED BY SCALE AS NOTED XREF FILE(S) DRAWING NUMBER

7A-I-3-3-30