

[illegible]

GENERAL NOTES:




1. FOR LEGEND, ABBREVIATIONS AND SYMBOL SEE SHEETS 7A-I-0-0-0
2. FOR FIRE ALARM OF BUILDING B07B, SEE SHEET 7B-I-0-7-02
3. ALL ROOMS ARE BEING MONITORED WITH SMOKE DETECTOR

REVISION E NOTES

- CANCELLED PRE-ACTION SYSTEM IN ELECTRICAL ROOMS.
- CANCELLED NOVEC SYSTEM IN AUTOMATION ROOM.
- CANCELLED SMOKE DETECTOR IN DUCT FOR AHU EXHAUST.
- UPDATED QUANTITY OF THE FIRE ALARM COMPONENTS.
- ADDED THERMO DETECTOR IN AUTOCLAVE ROOM.

REVISION 0 NOTES

- ADDED B07-NCA-01.
- RELOCATED B07-FACP-01.

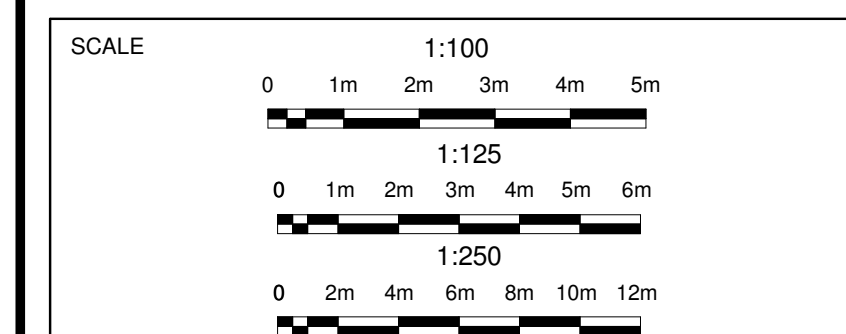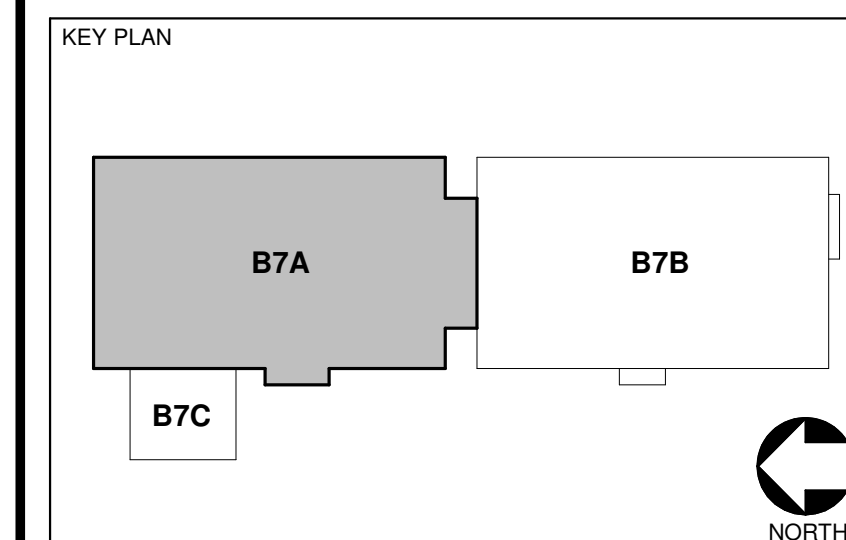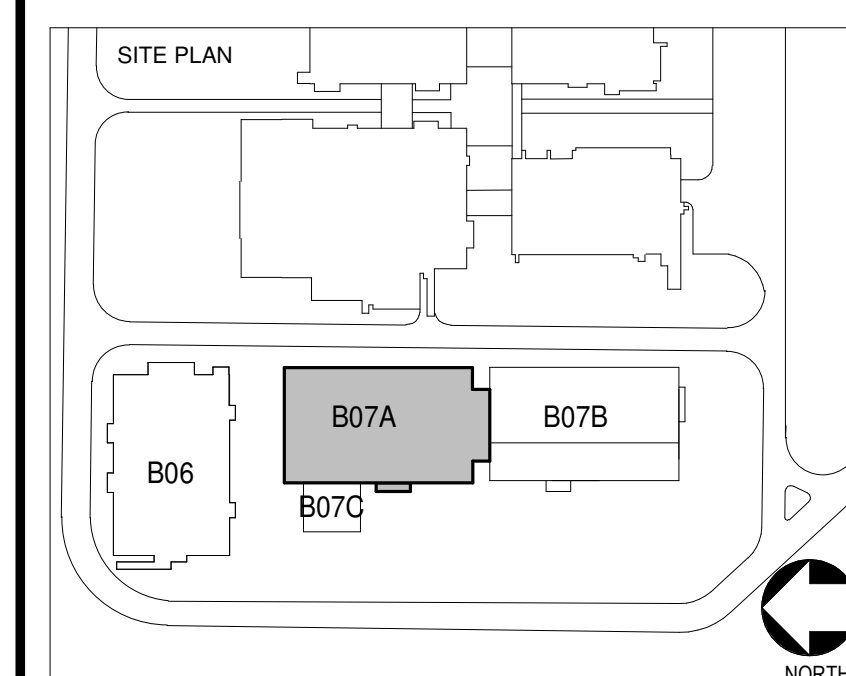

CONFIDENTIAL

THE INFORMATION CONTAINED HEREIN MAY NOT BE USED OR
REPRODUCED IN ANY MANNER WITHOUT WRITTEN PERMISSION OF
INTEGRATED PROJECT SERVICES.

CLIENT



BURITI EPCMV PROJECT

DRAWING TITLE


**DRUG PRODUCT
FIRE ALARM RISER DIAGRAM**

ENGINEER MAF	ARCHITECT BJE	DESIGNER FJT	IPS PROJECT # ITD19439.01
DRAWN BY MAV	REVIEWED BY MSS	SCALE NONE	CADD FILE NAME

XREF FILE(S)

DRAWING NUMBER

7A-I-0-7-02

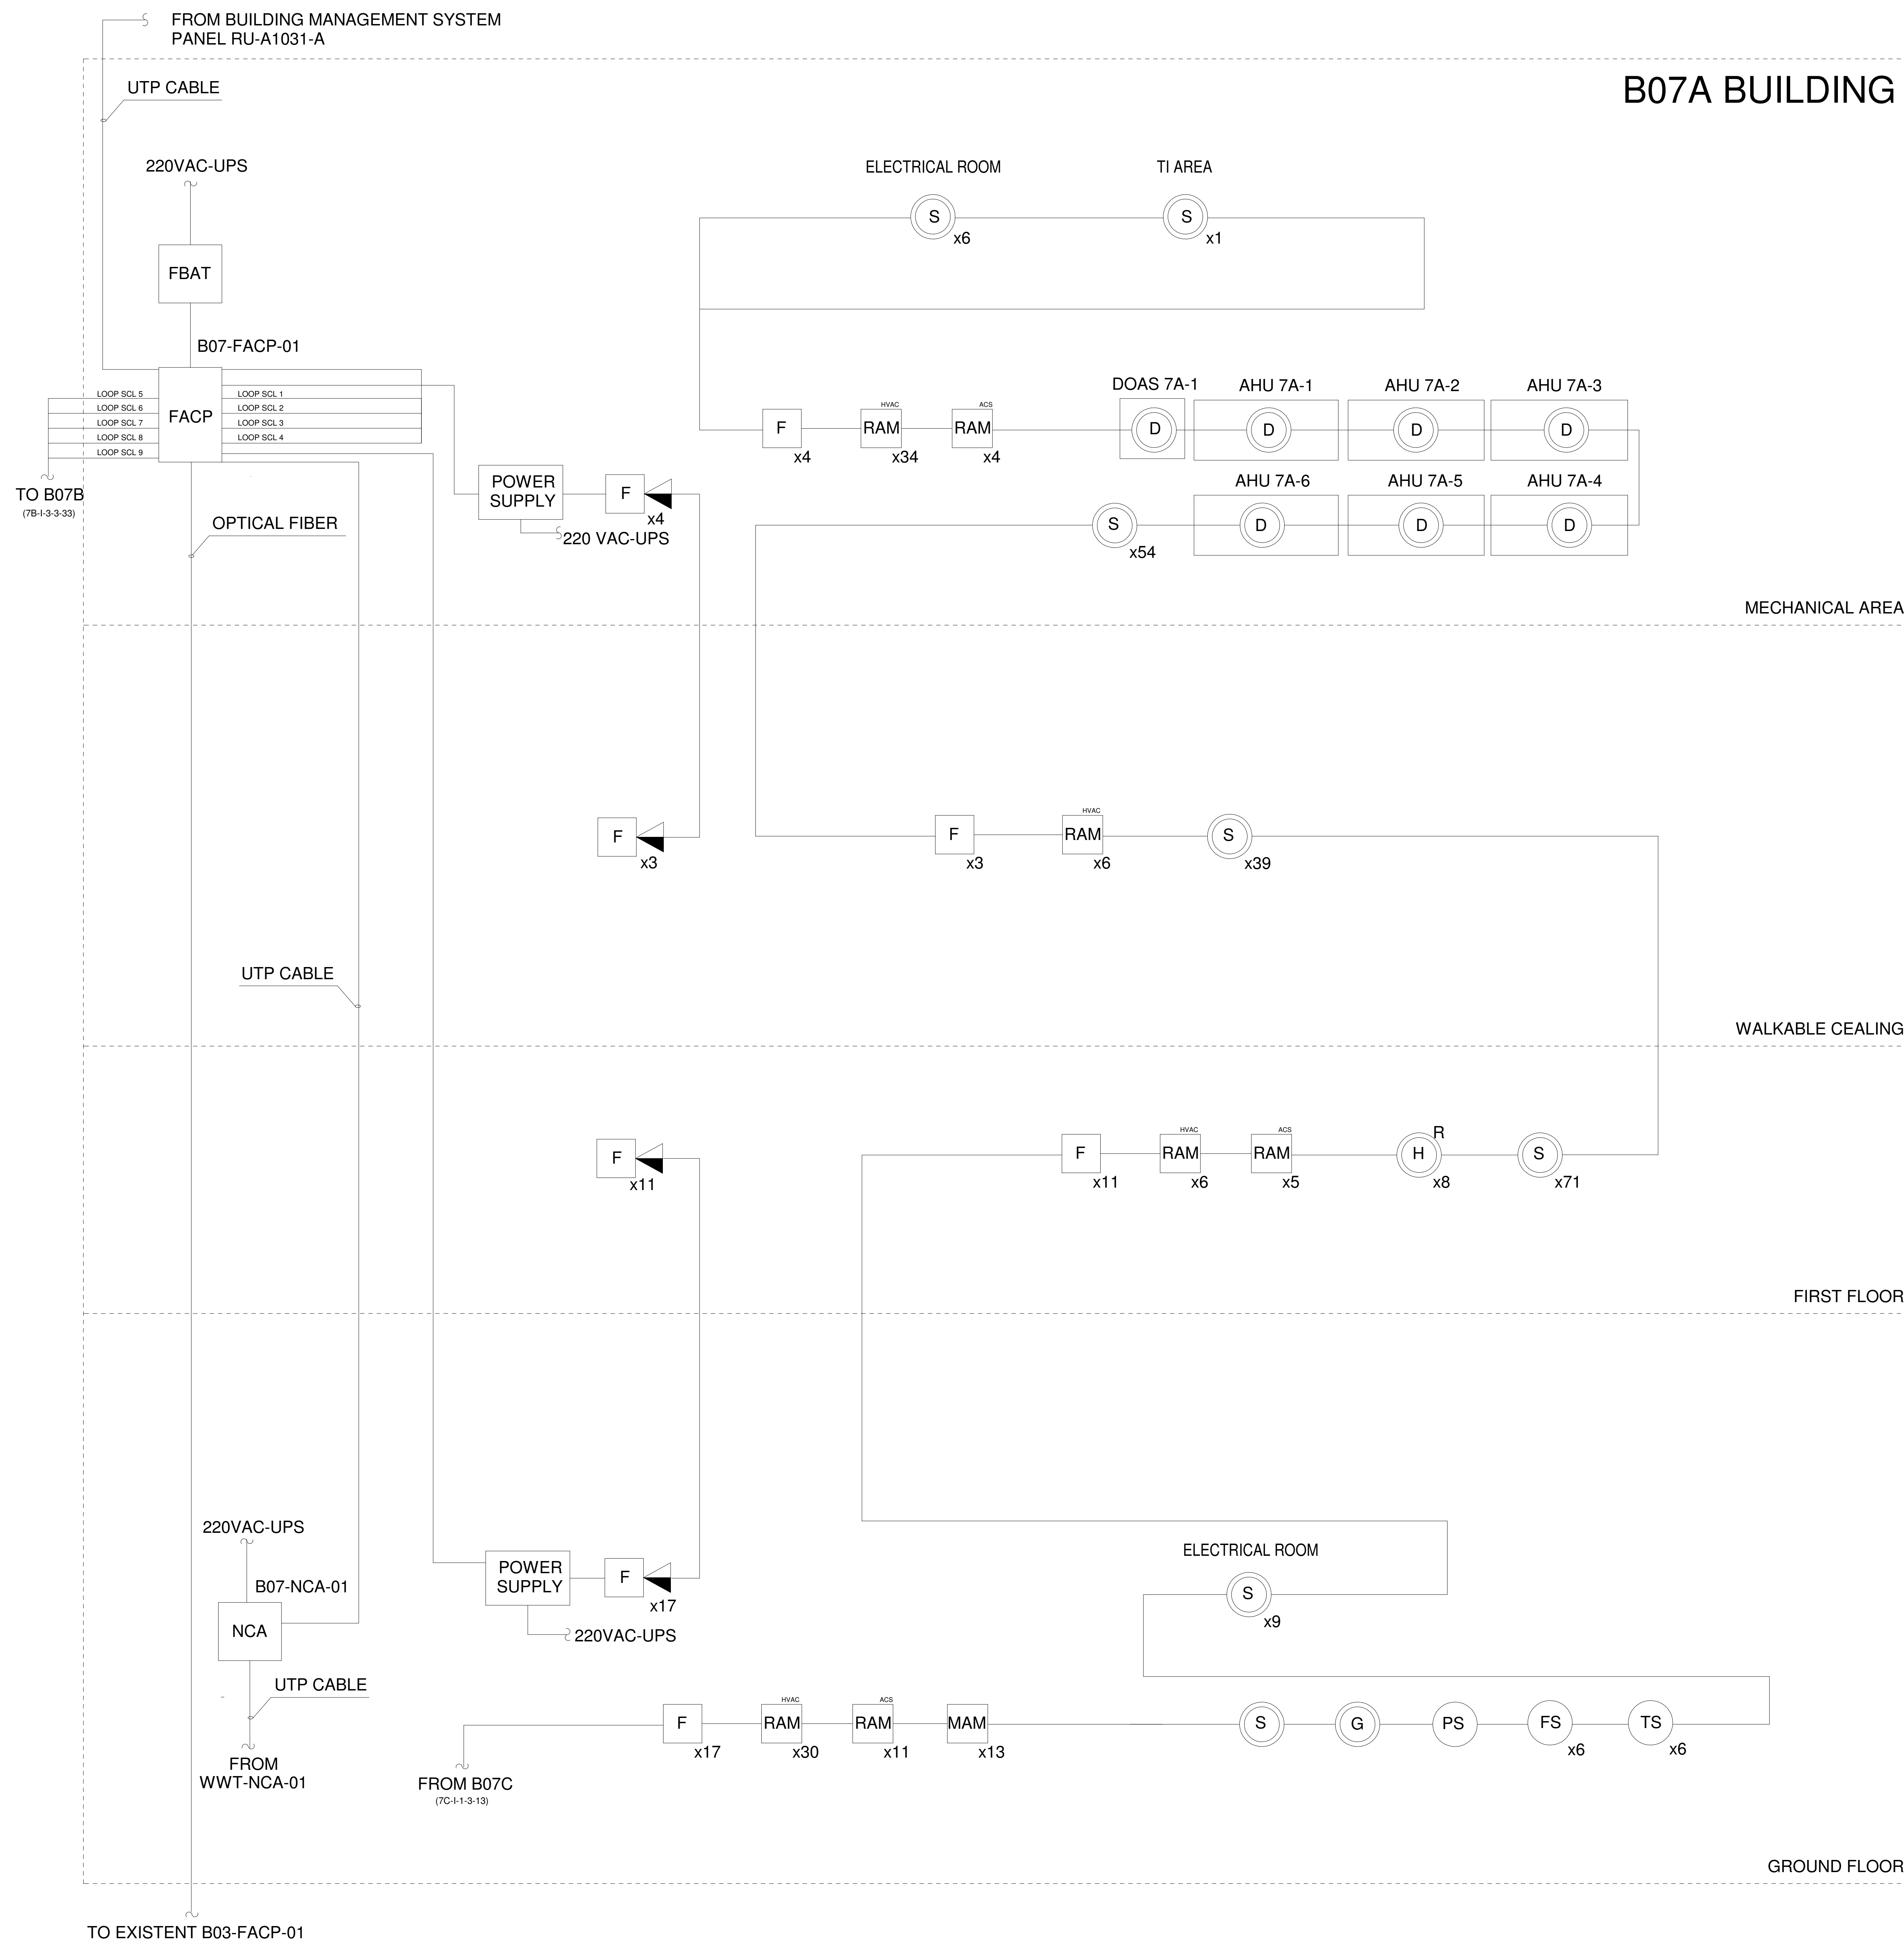

1 Fire Alarm Riser Diagram