

REMOTE RM-AHU-7A-2

REFERENCES

1. SEE DRAWING 7A-I-0-7-04 - DRUG PRODUCT - BMS ARCHITECTURE
2. SEE DRAWING 7A-M-0-5-22 - DRUG PRODUCT - AFD - AHU-7A-2

NOTES



1. POWER SUPPLY (220 VAC @ 60HZ) TO REMOTES PANEL IS SCOPE OF ELECTRIC DISCIPLINE.
2. FOR 220 VAC SHALL USE RED MONOPOLAR CABLE AND BLACK MONOPOLAR CABLE RED, SIZE 2.5 MM2. FOR 24 VDC SHALL USE BLUE MONOPOLAR CABLE FOR 24 VDC(+) AND WHITE MONOPOLAR CABLE FOR VDC (-), SIZE 2.5 MM2.
3. GENERAL GROUNDING (GND) MUST BE CONNECTED TO GROUNDING BUS IN THE CONTROL PANEL INTERIOR AT BOTTOM OF THE CABINET.
4. ELECTRICAL MUST GROUNDING THE FOLLOWING: DOOR, PLATE, AND PANEL.
5. USE A SINGLE CONDUCTOR GREEN OR GREEN-YELLOW INSULATION TO CONNECT THE EQUIPMENTS WHITH THE BAR BUS.
6. EACH CABLE WITHIN THE CONTROL PANEL SHALL BE PERMANENTLY TAGGED AND IDENTIFIED AT BOTH ENDS.
7. FOR ALL TERMINAL BLOCKS NUMBERS AND POINT IDENTIFICATIONS SHALL BE PERMANENTLY MARKED BY MARKING STRIPS ON TERMINAL STRIPS.
8. IDENTIFICATION SHALL BE TERMINAL BLOCK NUMBERS AND POINT NUMBERS SHOWN ON THE WIRING DIAGRAMS.
9. IS THE CONTRACTOR RESPONSIBILITY TO CONSIDER THE MISCELLANEOUS NECESSARY TO GUARANTEE ALL THE CONNECTIONS AND CORRECT INSTALLATION.

REVISION 0 NOTES

1. INCLUSION OF THE MONITORED AND CONTROLS POINTS FOR RECTANGULAR FIRE DAMPERS.
2. UPDATE IN POINTS OF THE SMOKE DETECTOR INSIDE IN DUCTS FOR HVAC SYSTEM (AIR SUPPLY DUCT).
3. UPDATE IN NUMBERS OF THE ALL SHEETS.
4. UPDATE IN ITEM DRAWINGS REFERENCE.


REVISION 1 NOTES

1. ADDED PRESSURE CONTROL IN AHU MIXING BOX.
2. FIXED THE ADDRESSING OF LINES BETWEEN PAGES.

 TESSLER engenharia				
PROJECT				
TAKEDA / BAXALTA				
CLIENT				
BURITI EPCMV PROJECT				
DOC NR				
569-DB7A-AIC-232-005				
DRAWN BY	REVIEWED	ENGINEER	SCALE	DATE
AAS	MAF	RSP	-	22SET2021

		 Empresa brasileira de hemoderivados e biotecnologia	
DRAWING TITLE			
DRUG PRODUCT BMS - WIRING DIAGRAM			
CLIENT NR.			REV.
7A-I-0-3-17			1

1	03FEB2022	ISSUE FOR CONSTRUCTION CONSIDERING COMMENTS	ACC	MAF	RSP	
0	22SET2021	ISSUE FOR CONSTRUCTION	AAS	MAF	RSP	
A	17MAY2021	90% DD ISSUE	AAS	MAF	RSP	
DATE		DESCRIPTION	DRAWING BY	ENGINEER	REVIEWED	

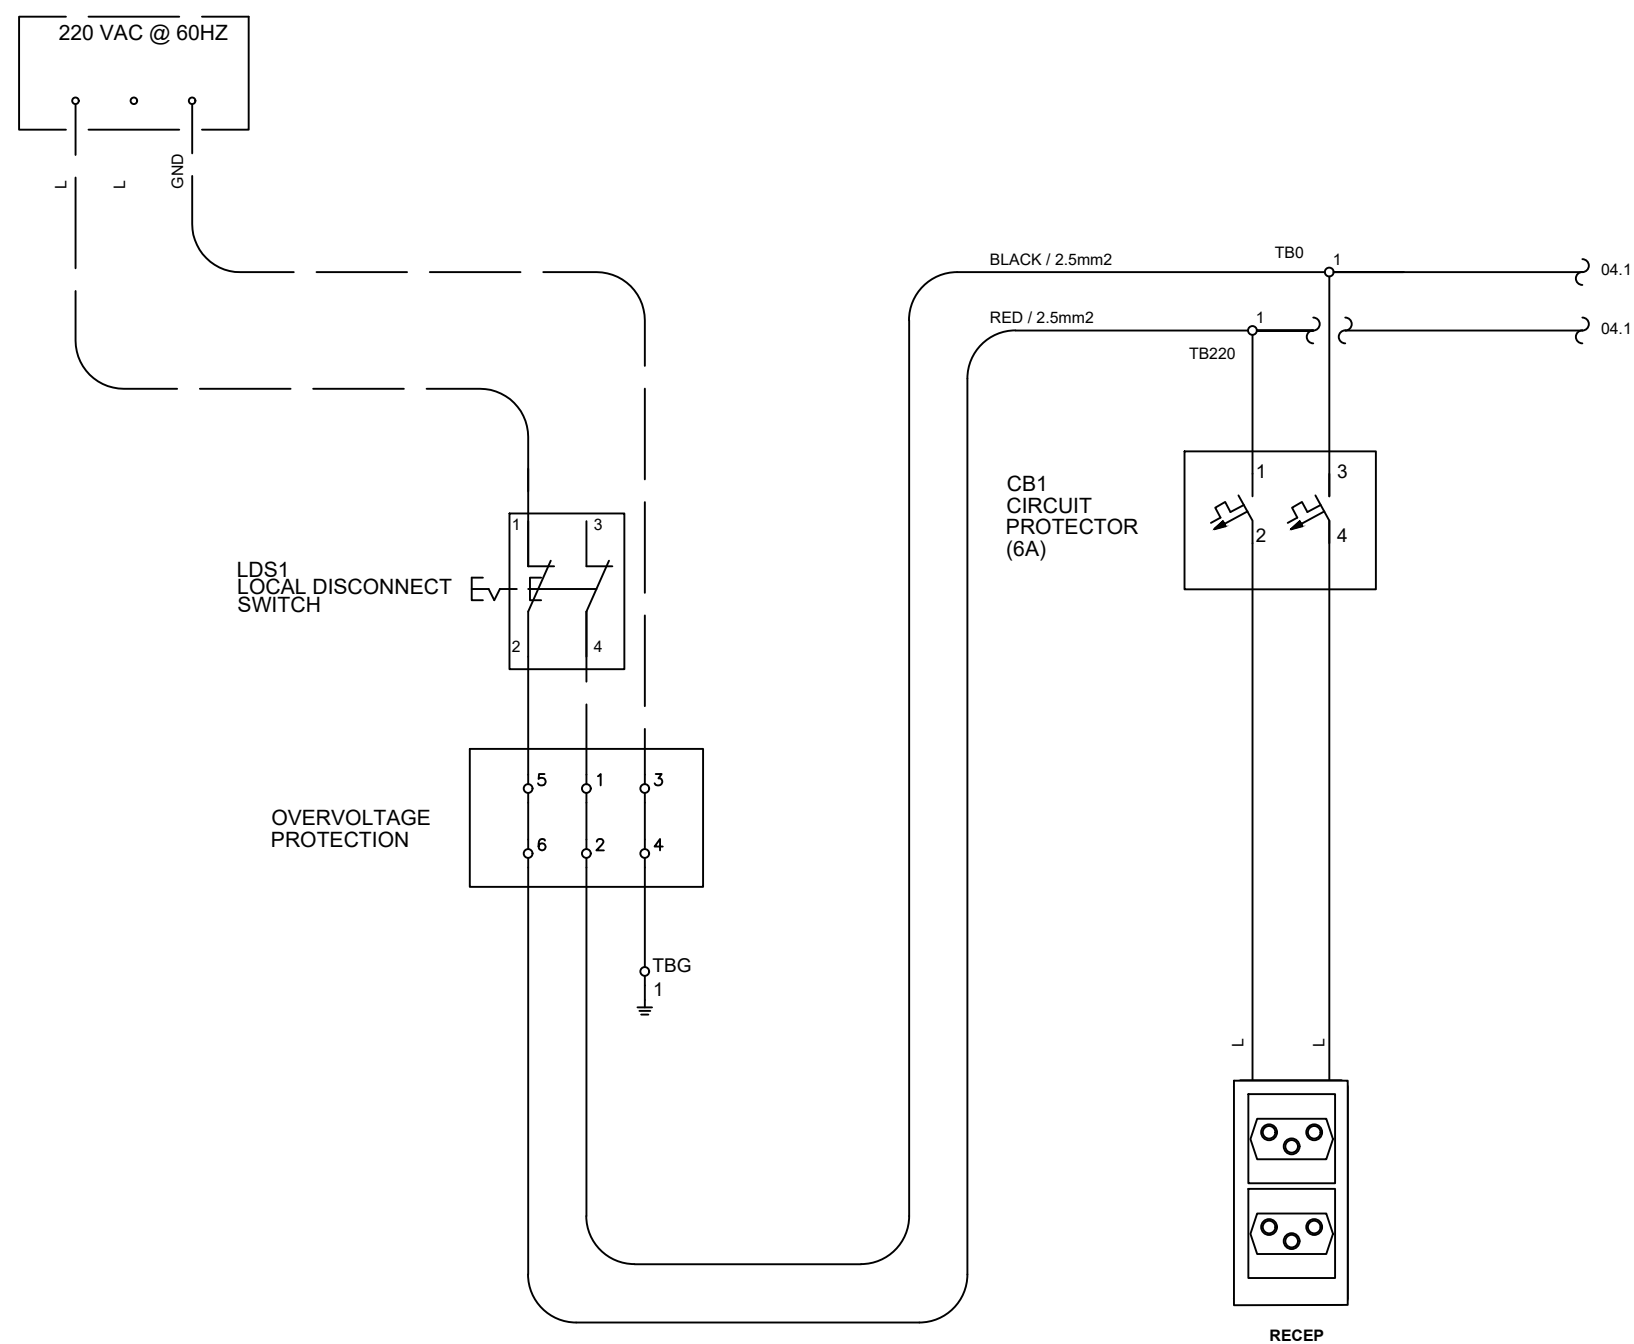


LDS1
LOCAL DISCONNECT
SWITCH

OVERVOLTAGE PROTECTION

CB1
CIRCUIT
PROTECTOR
(6A)

RECEP

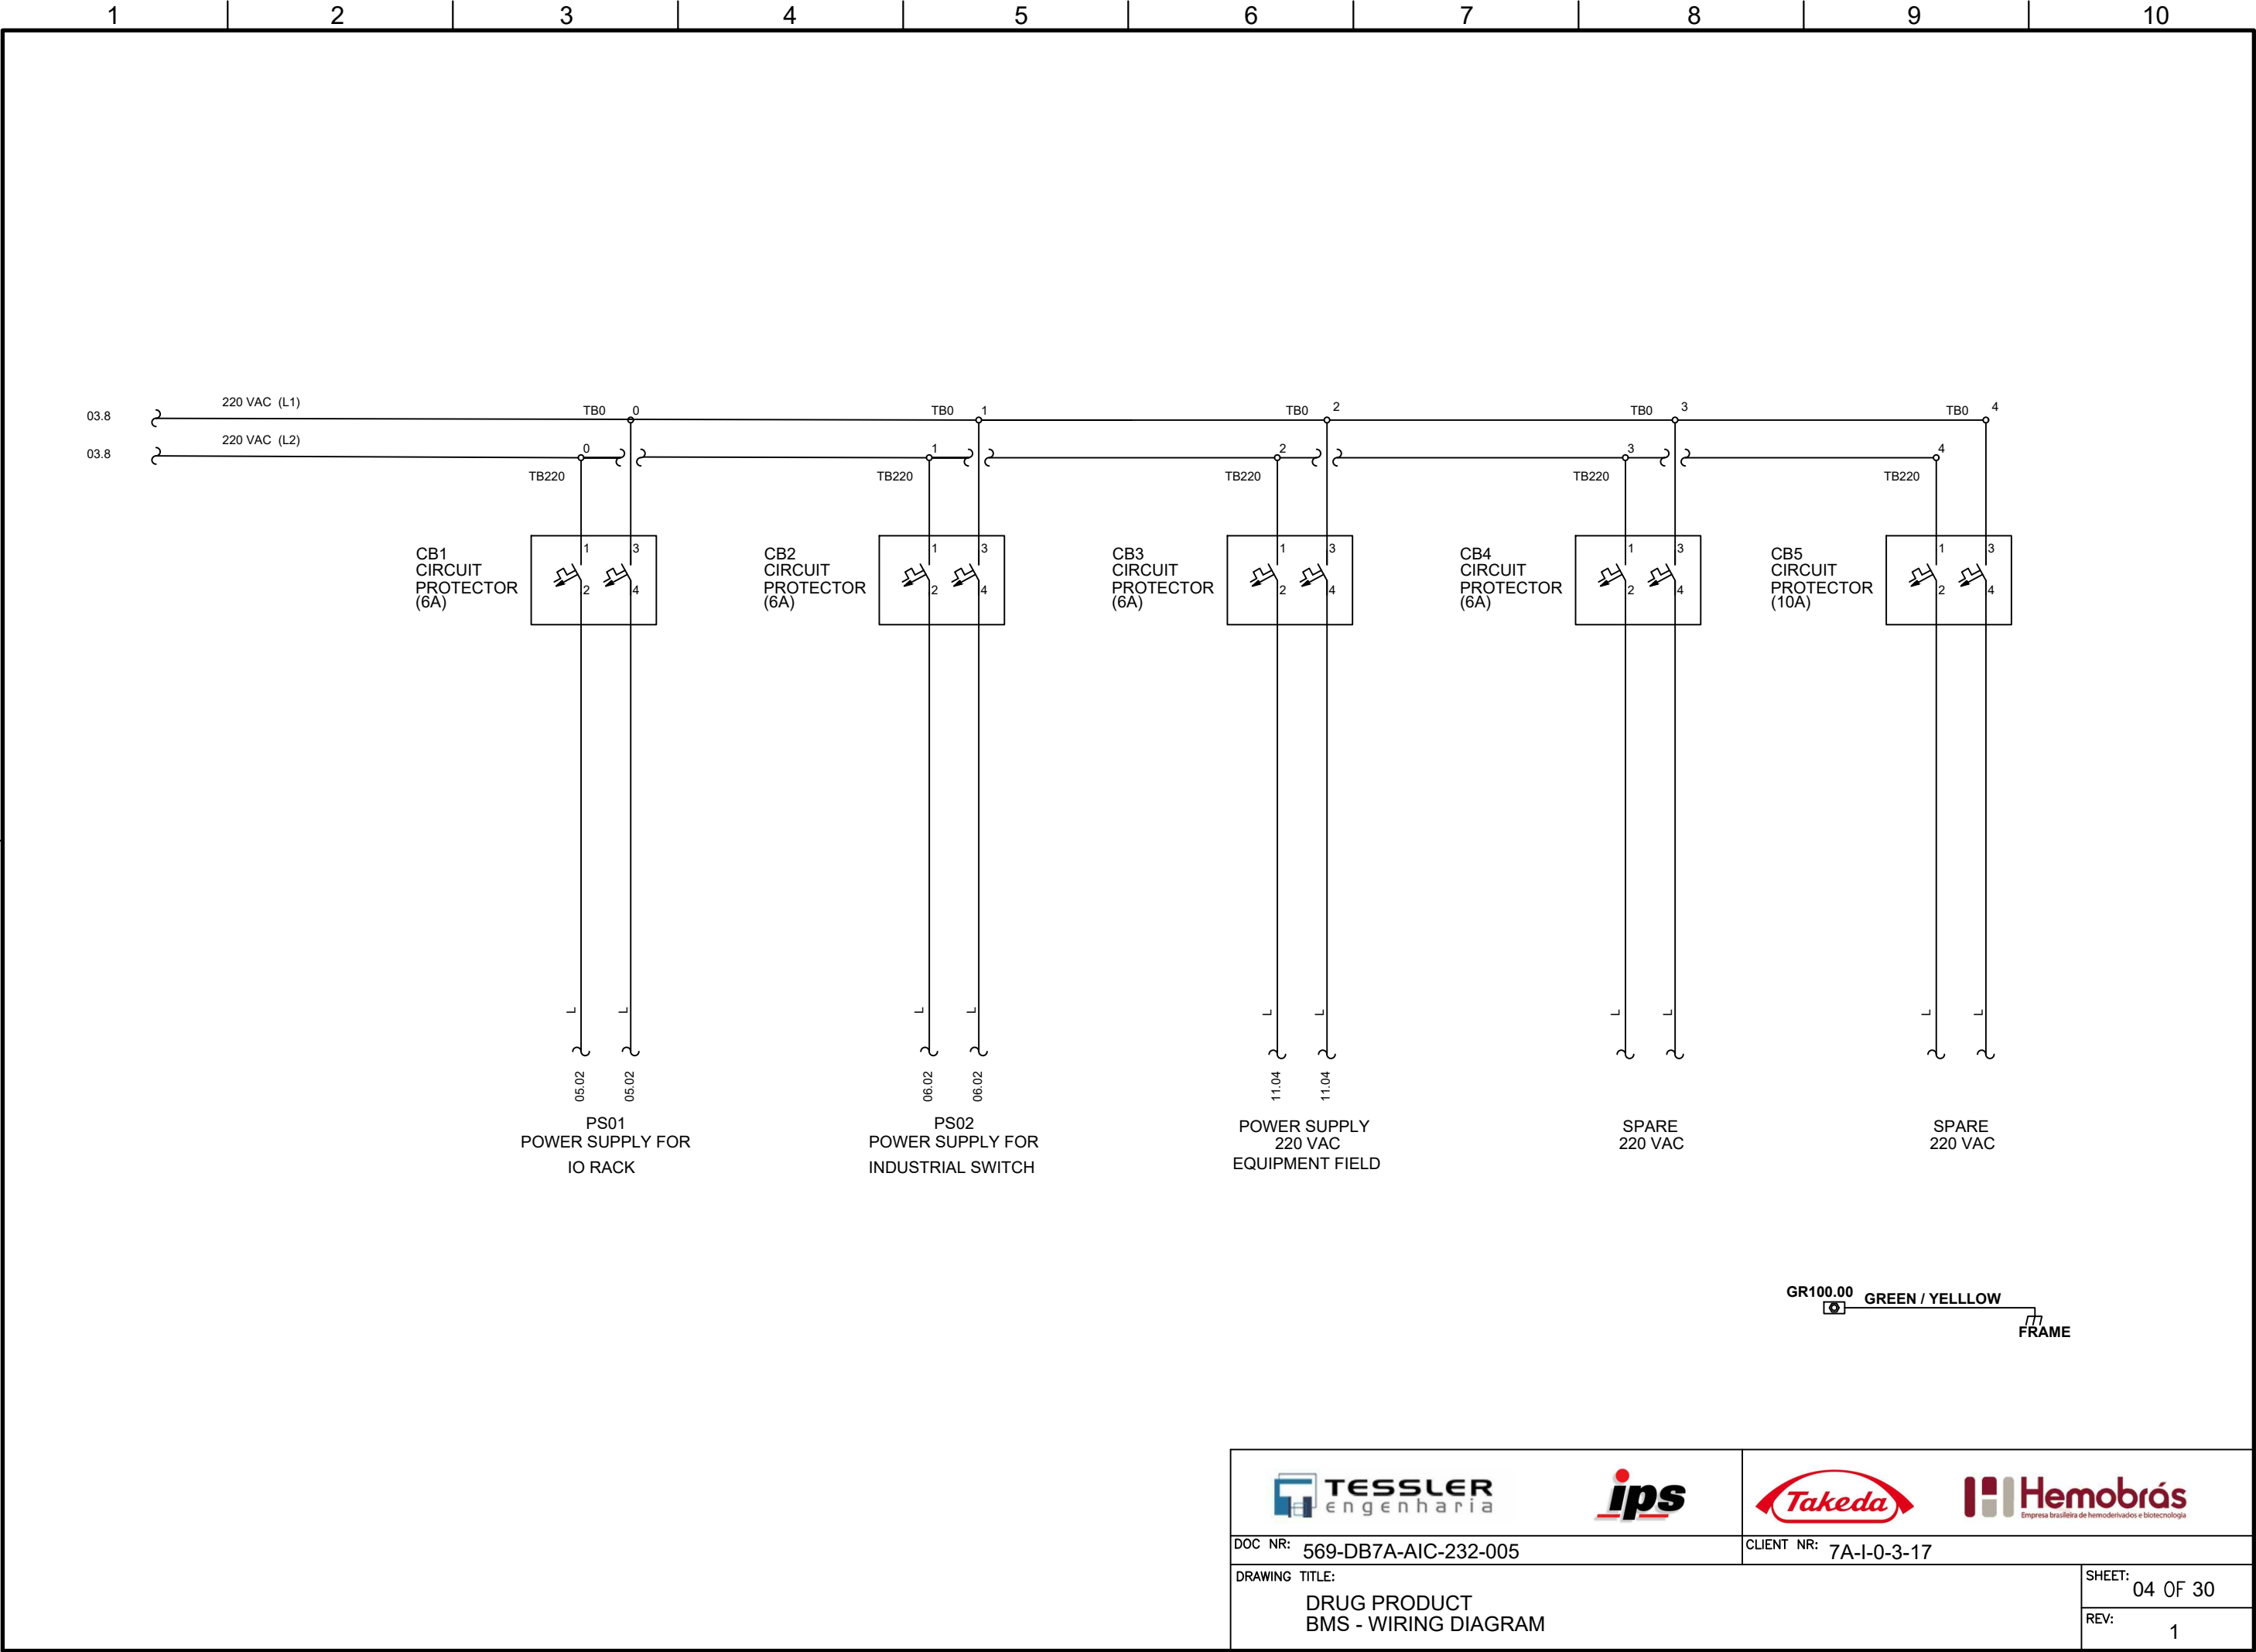

TESSLER

engenharia

ips

Takeda

Hemobrás

Empresa brasileira de hemoderivados e biotecnologia

DOC NR: 569-DB7A-AIC-232-005

CLIENT NR: 7A-I-0-3-17


DRAWING TITLE:


DRUG PRODUCT

BMS - WIRING DIAGRAM

SHEET: 04 OF 30

REV: 1

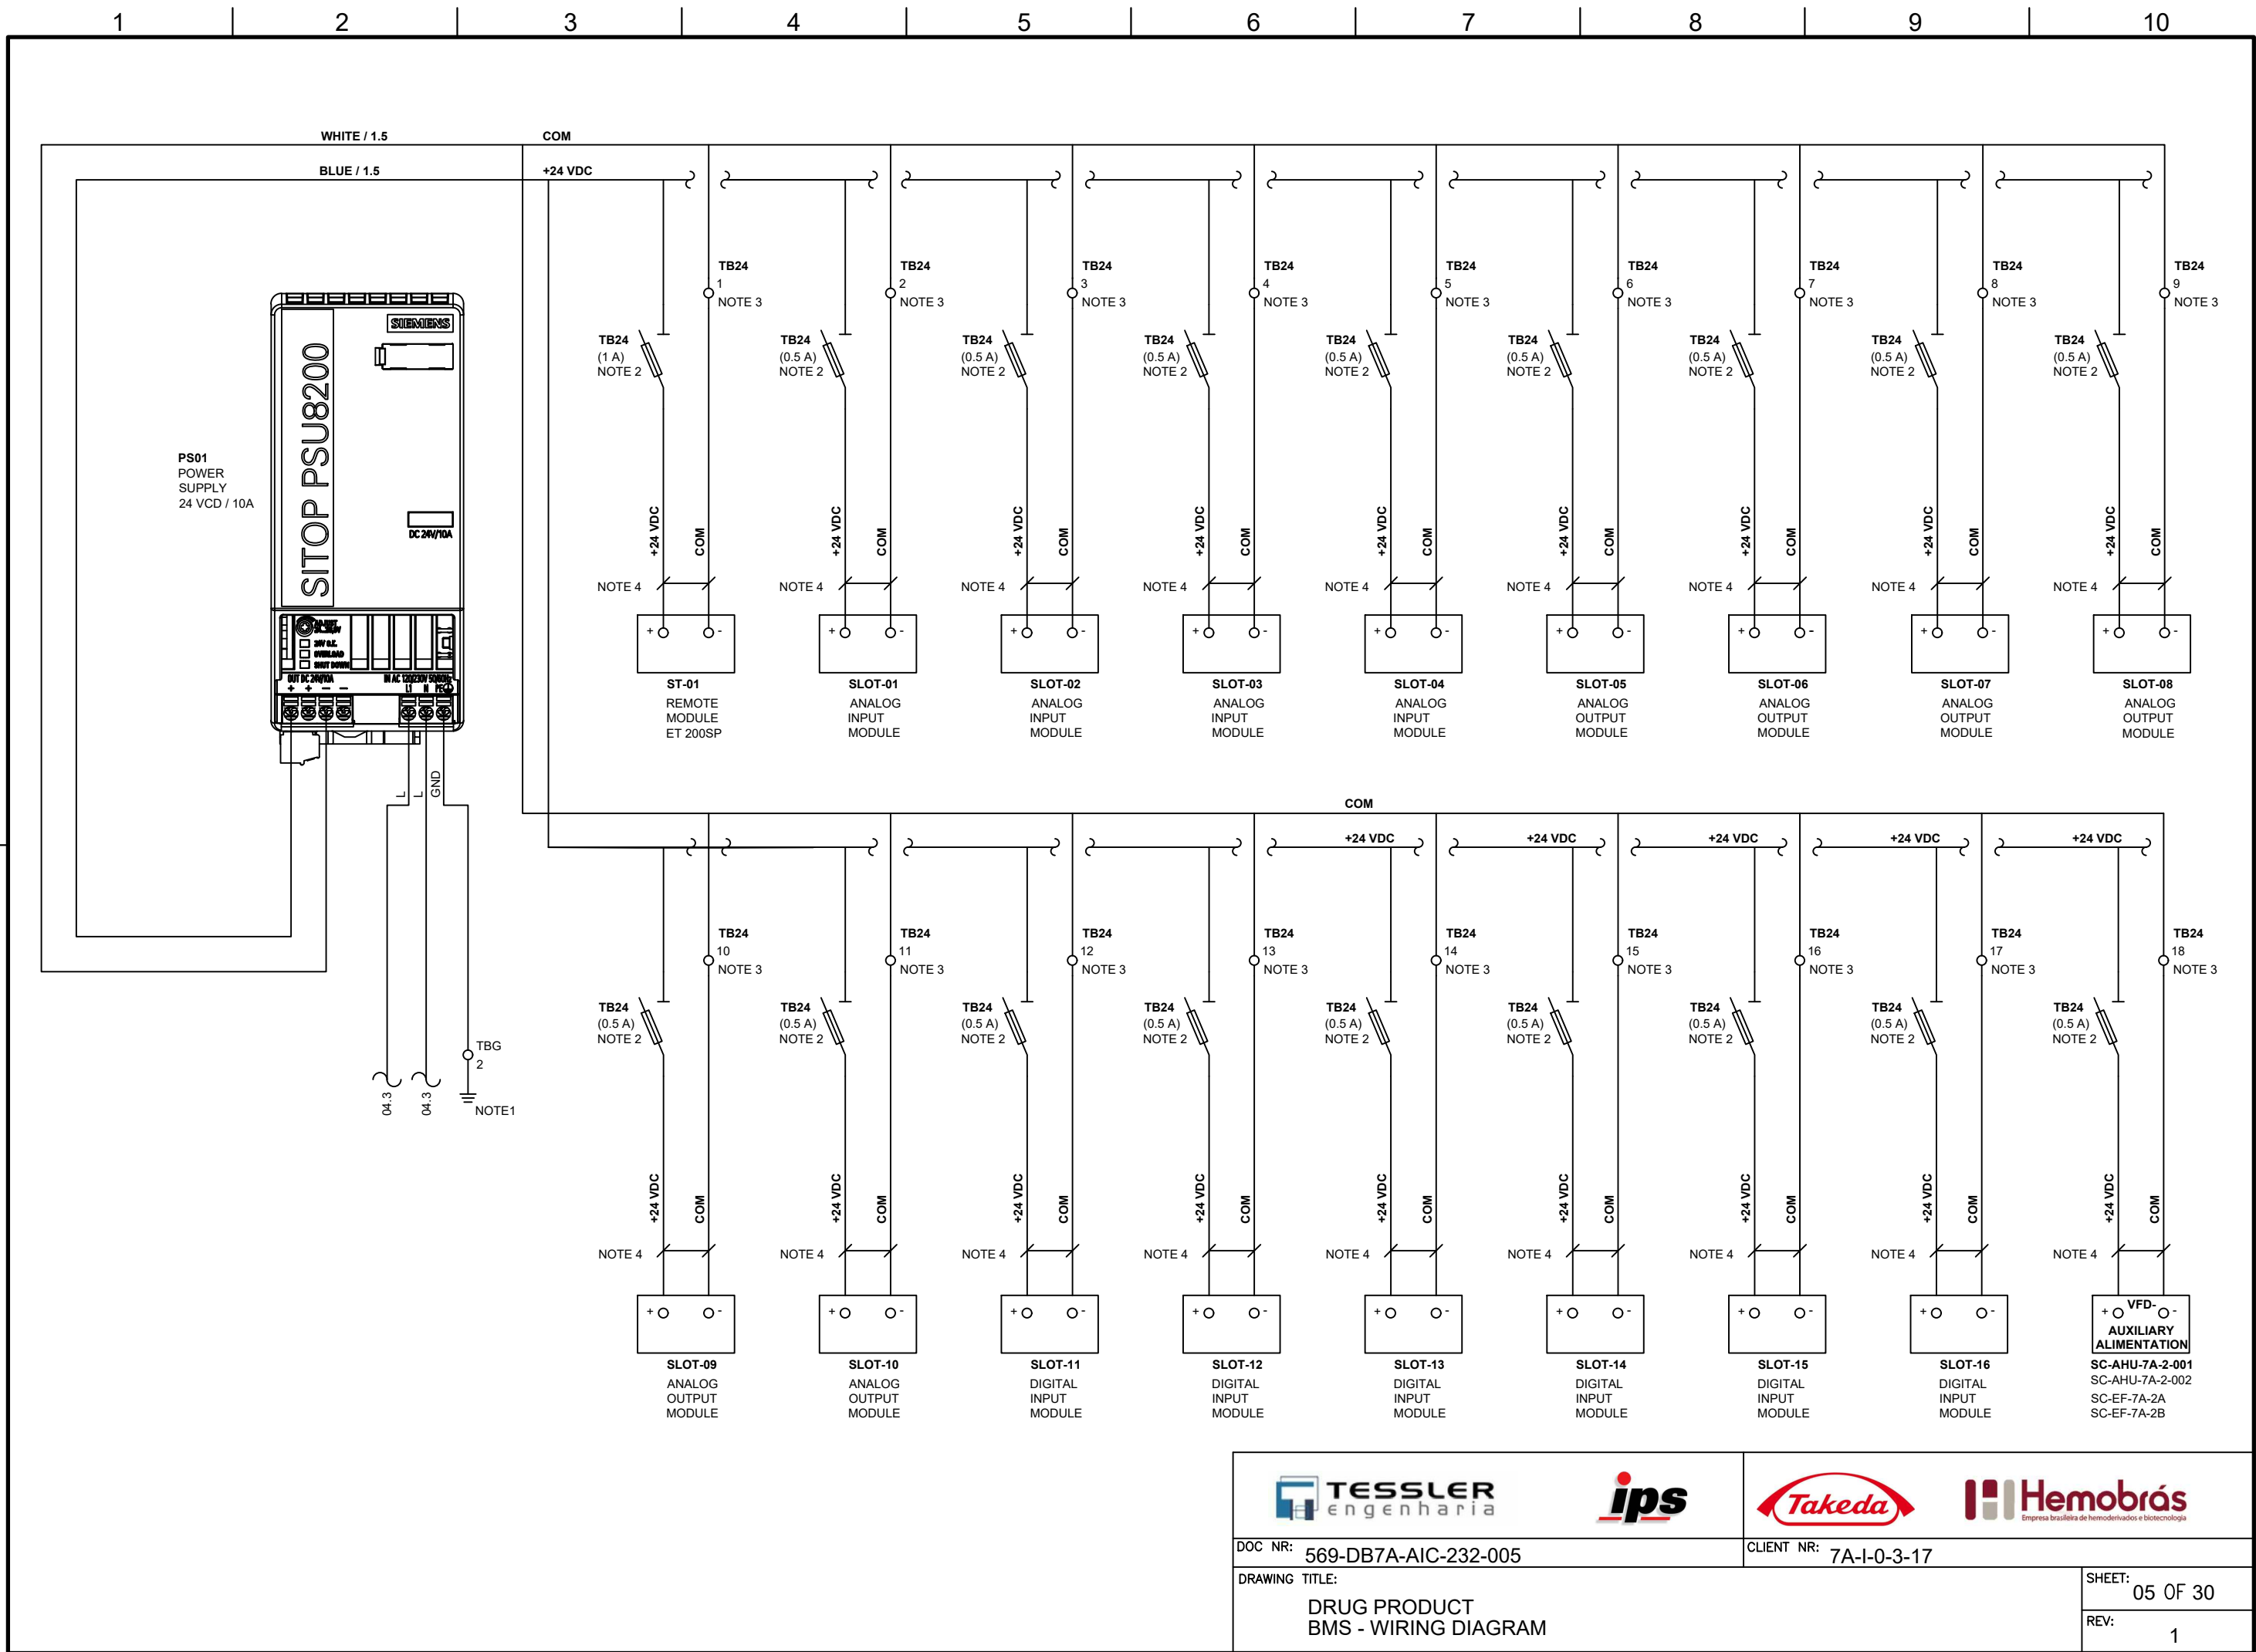

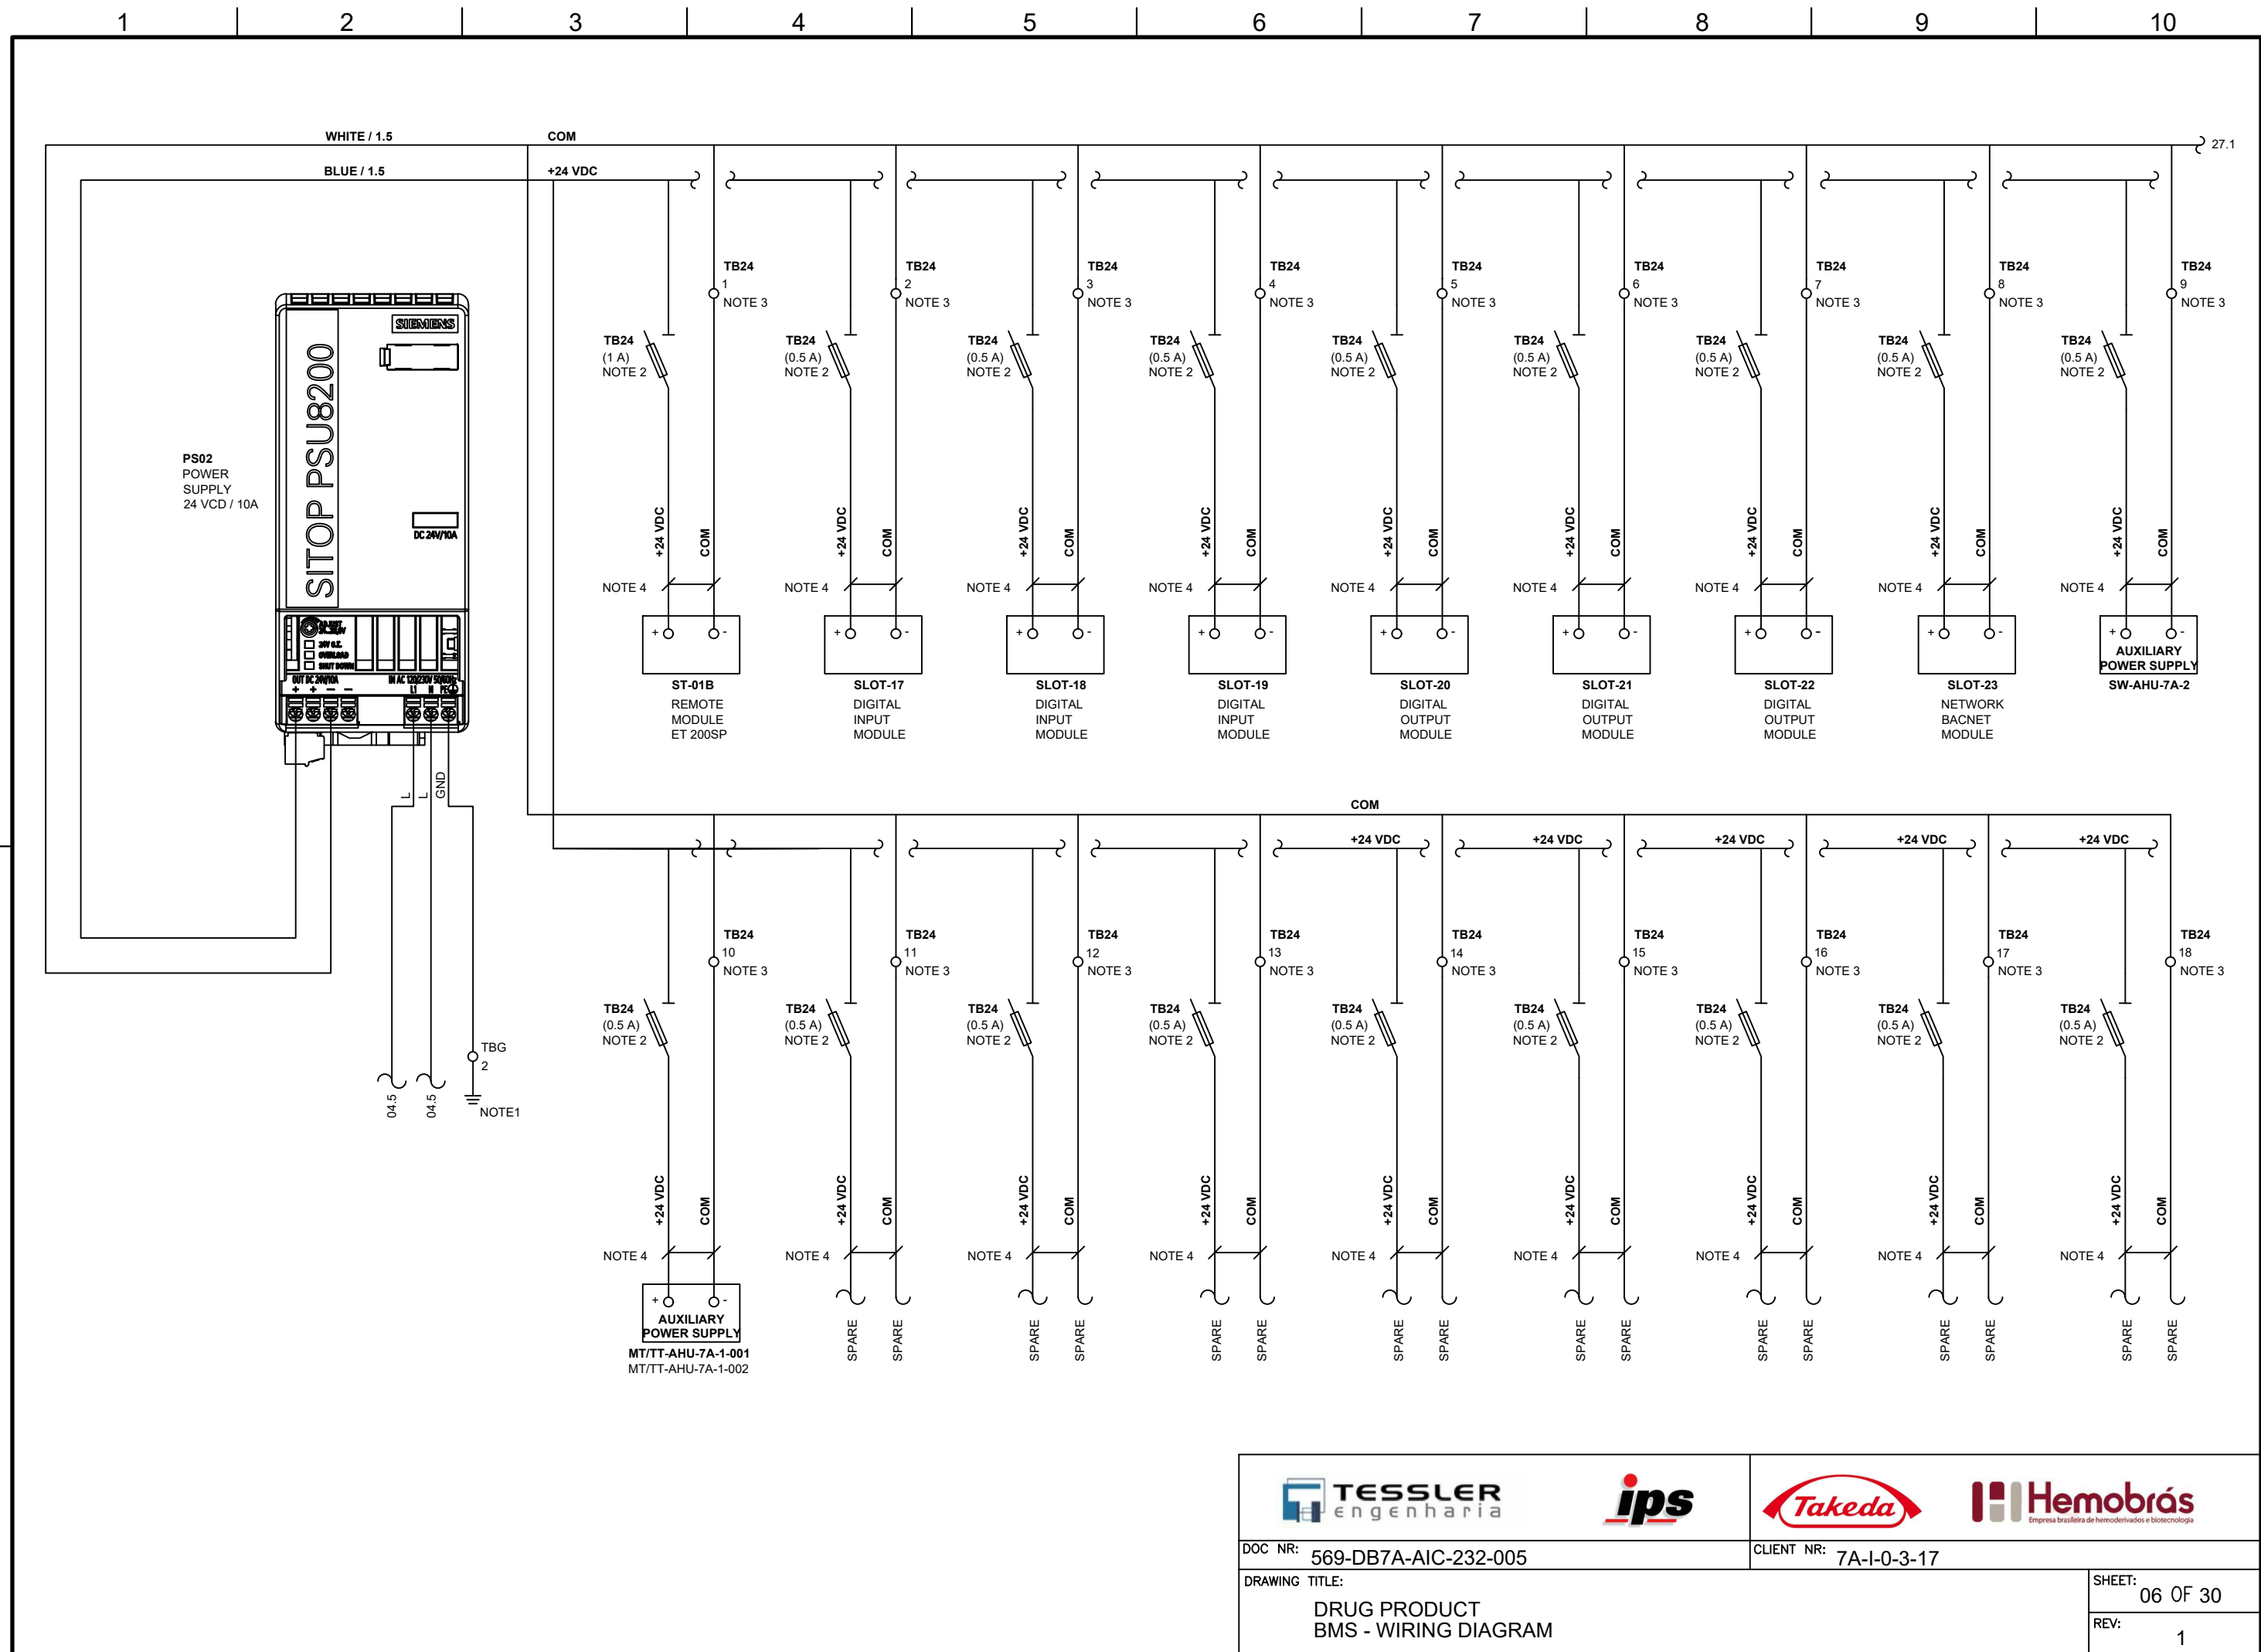



DOC NR: 569-DB7A-AIC-232-005

CLIENT NR: 7A-I-0-3-17


DRAWING TITLE:
DRUG PRODUCT
BMS - WIRING DIAGRAM

SHEET:
06 OF 30

REV:
1

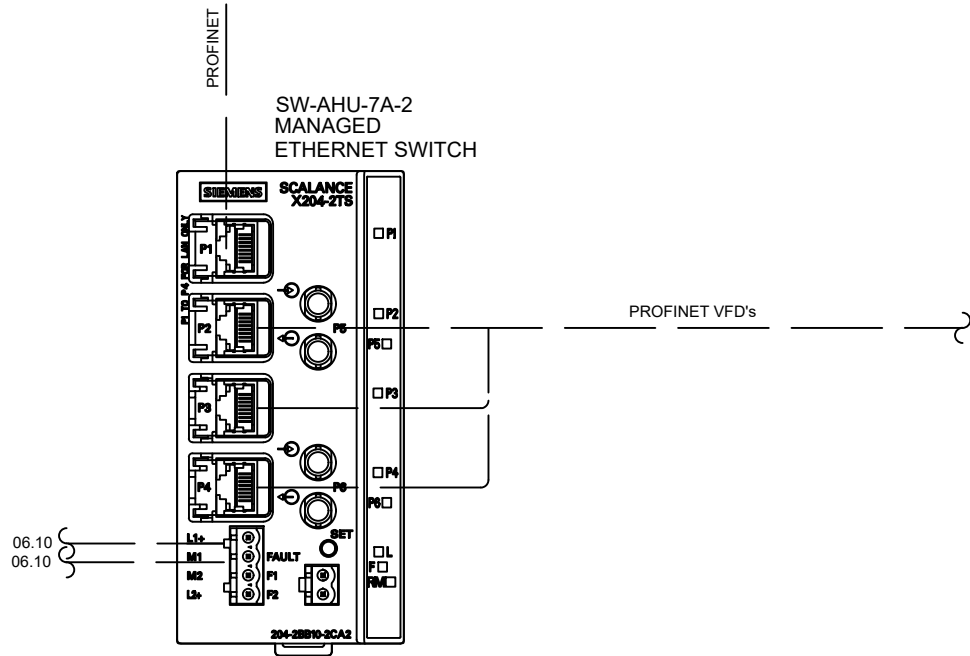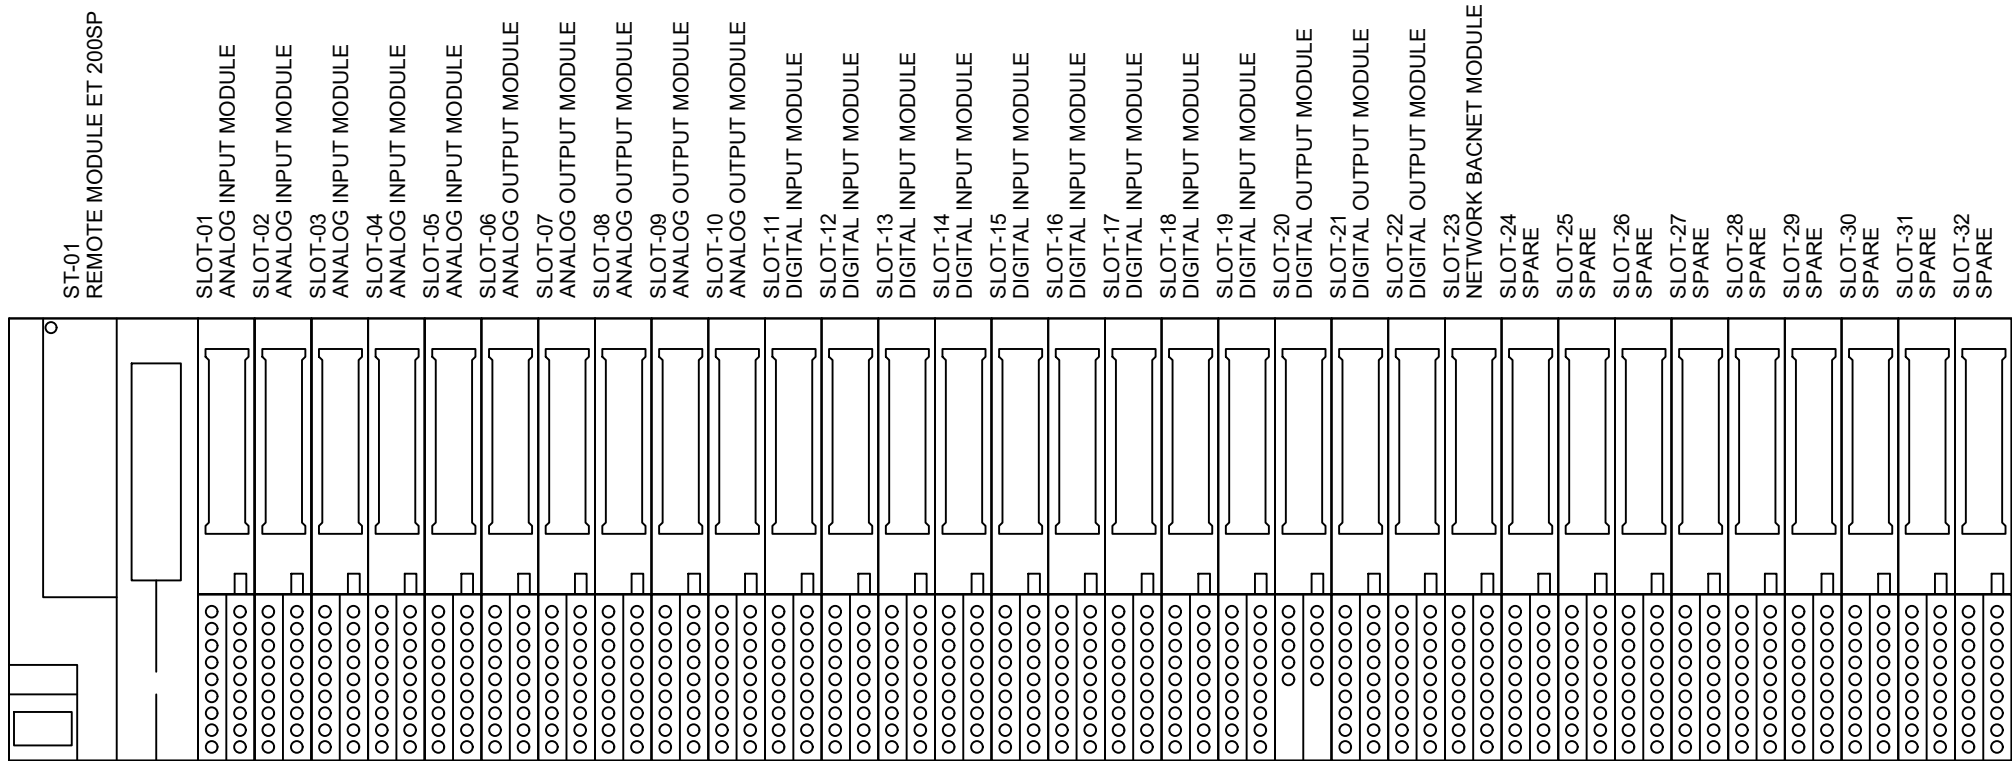

SW-AHU-7A-2			
PORT	SIGNAL TO	TAG	SERVICE
1	VFD	SC-AHU-7A-2-001	MOTOR SPEED CONTROL
2	VFD	SC-AHU-7A-2-002	MOTOR SPEED CONTROL
3	VFD	SC-EF-7A-2A	MOTOR SPEED CONTROL
4	VFD	SC-EF-7A-2B	MOTOR SPEED CONTROL
5	-	-	-
6	-	-	-
7	-	-	-
8	-	-	-

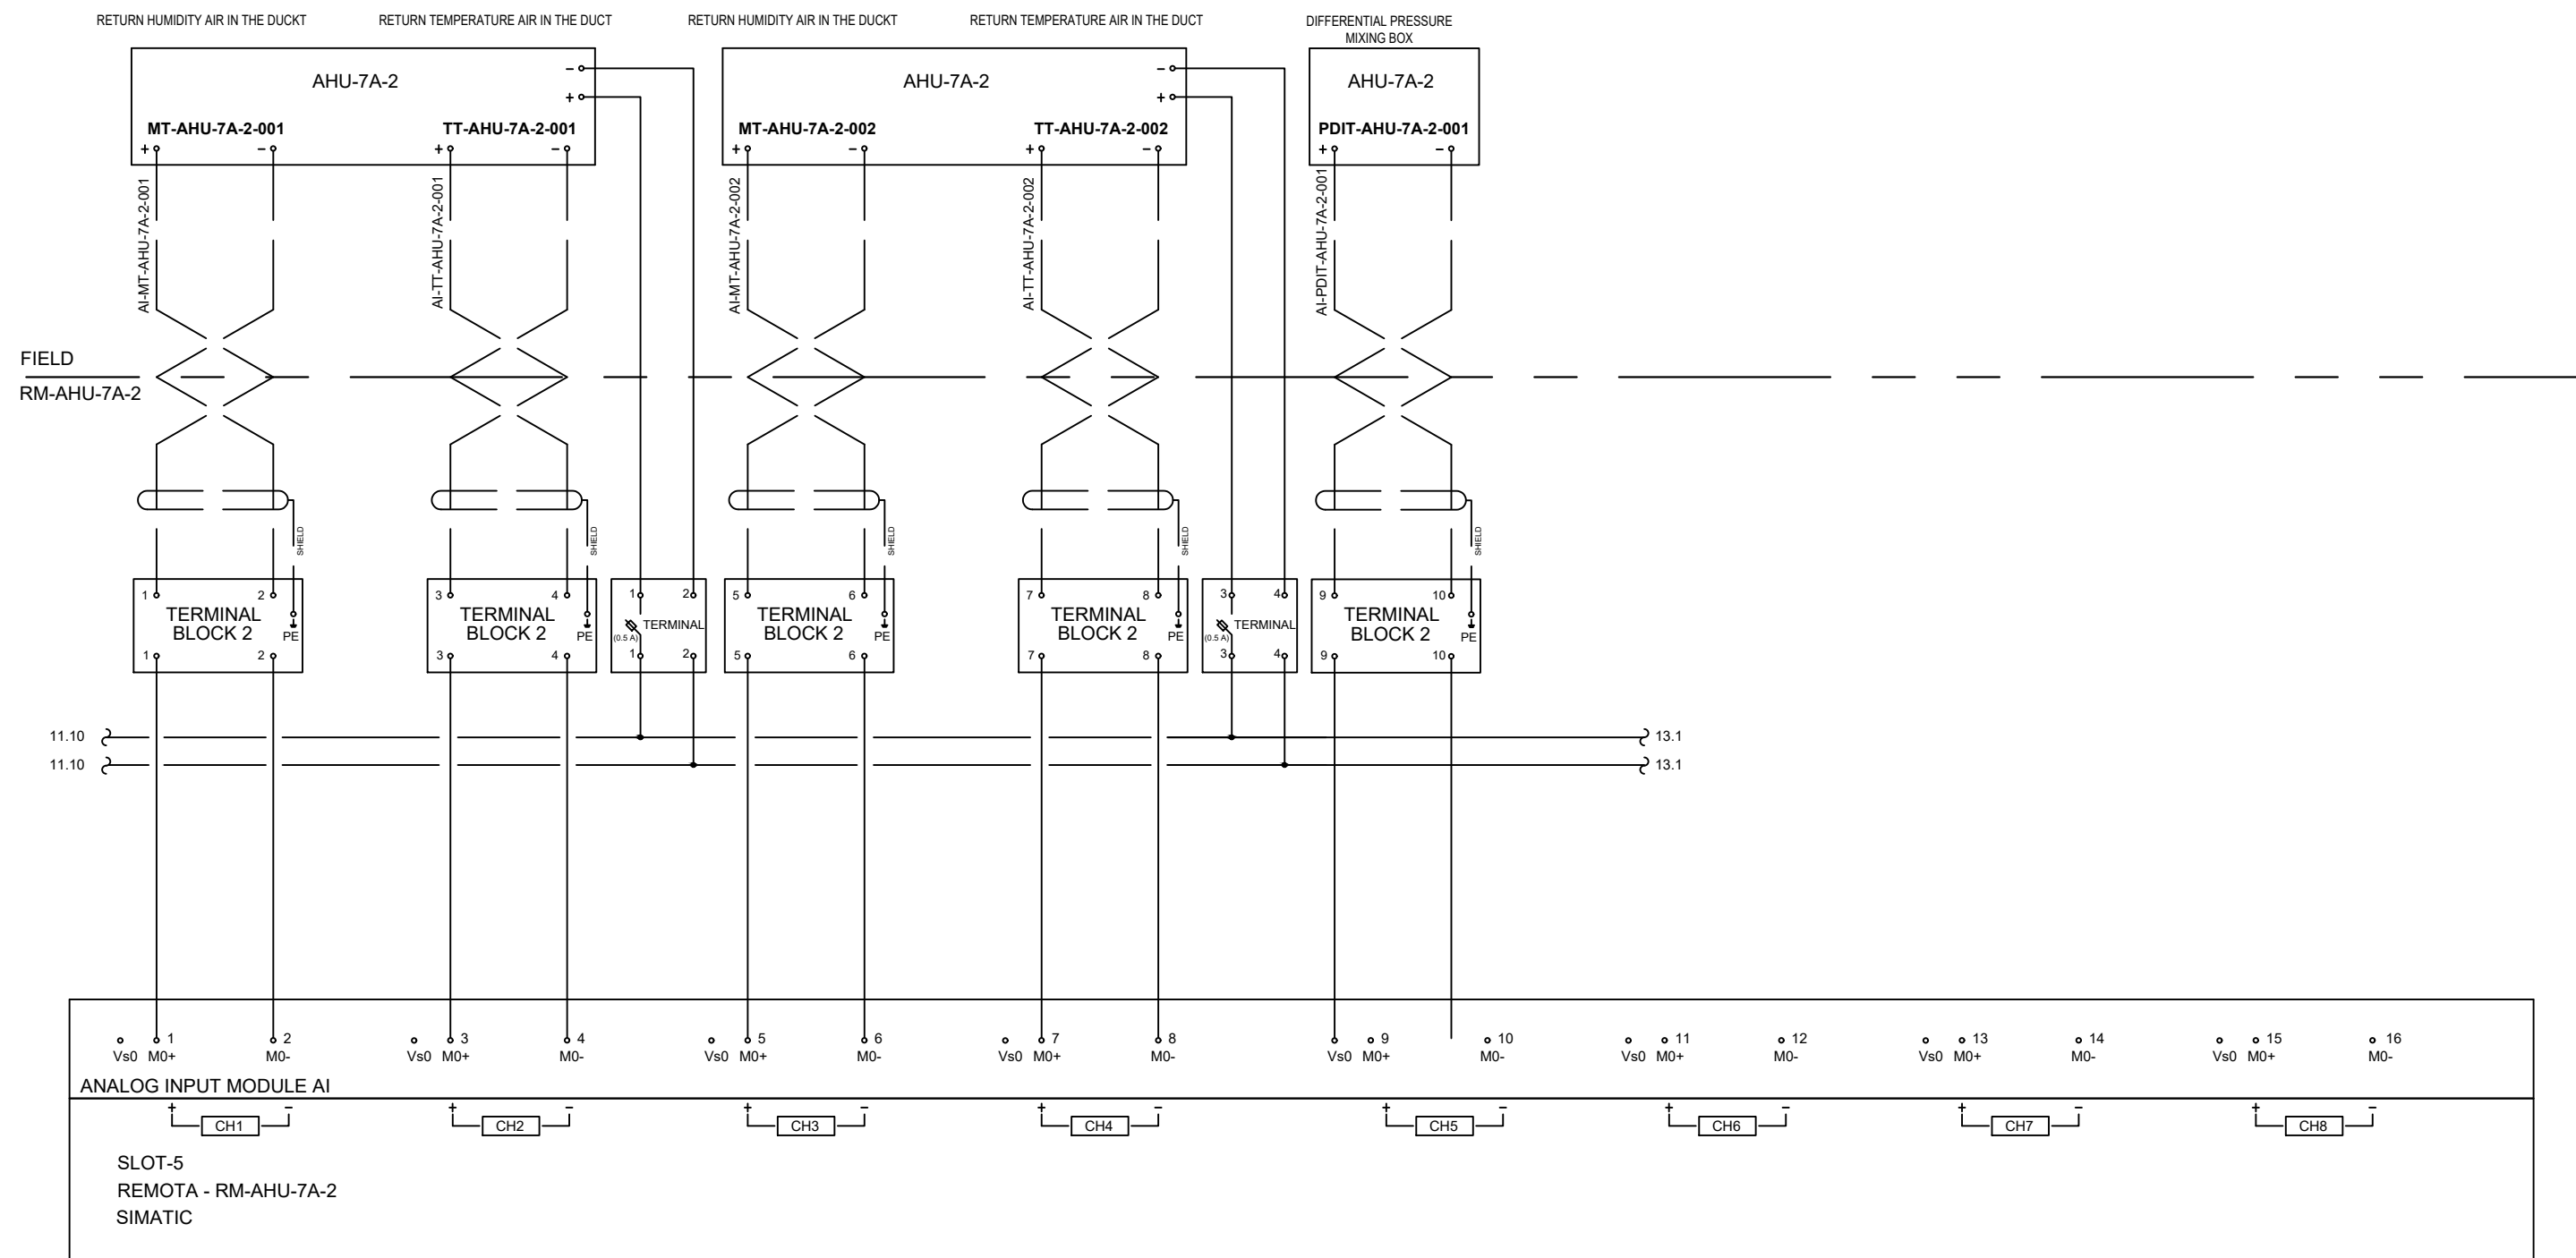


DOC NR: 569-DB7A-AIC-232-005

CLIENT NR: 7A-I-0-3-17

DRAWING TITLE:
DRUG PRODUCT
BMS - WIRING DIAGRAM

SHEET: 12 OF 30
REV: 1

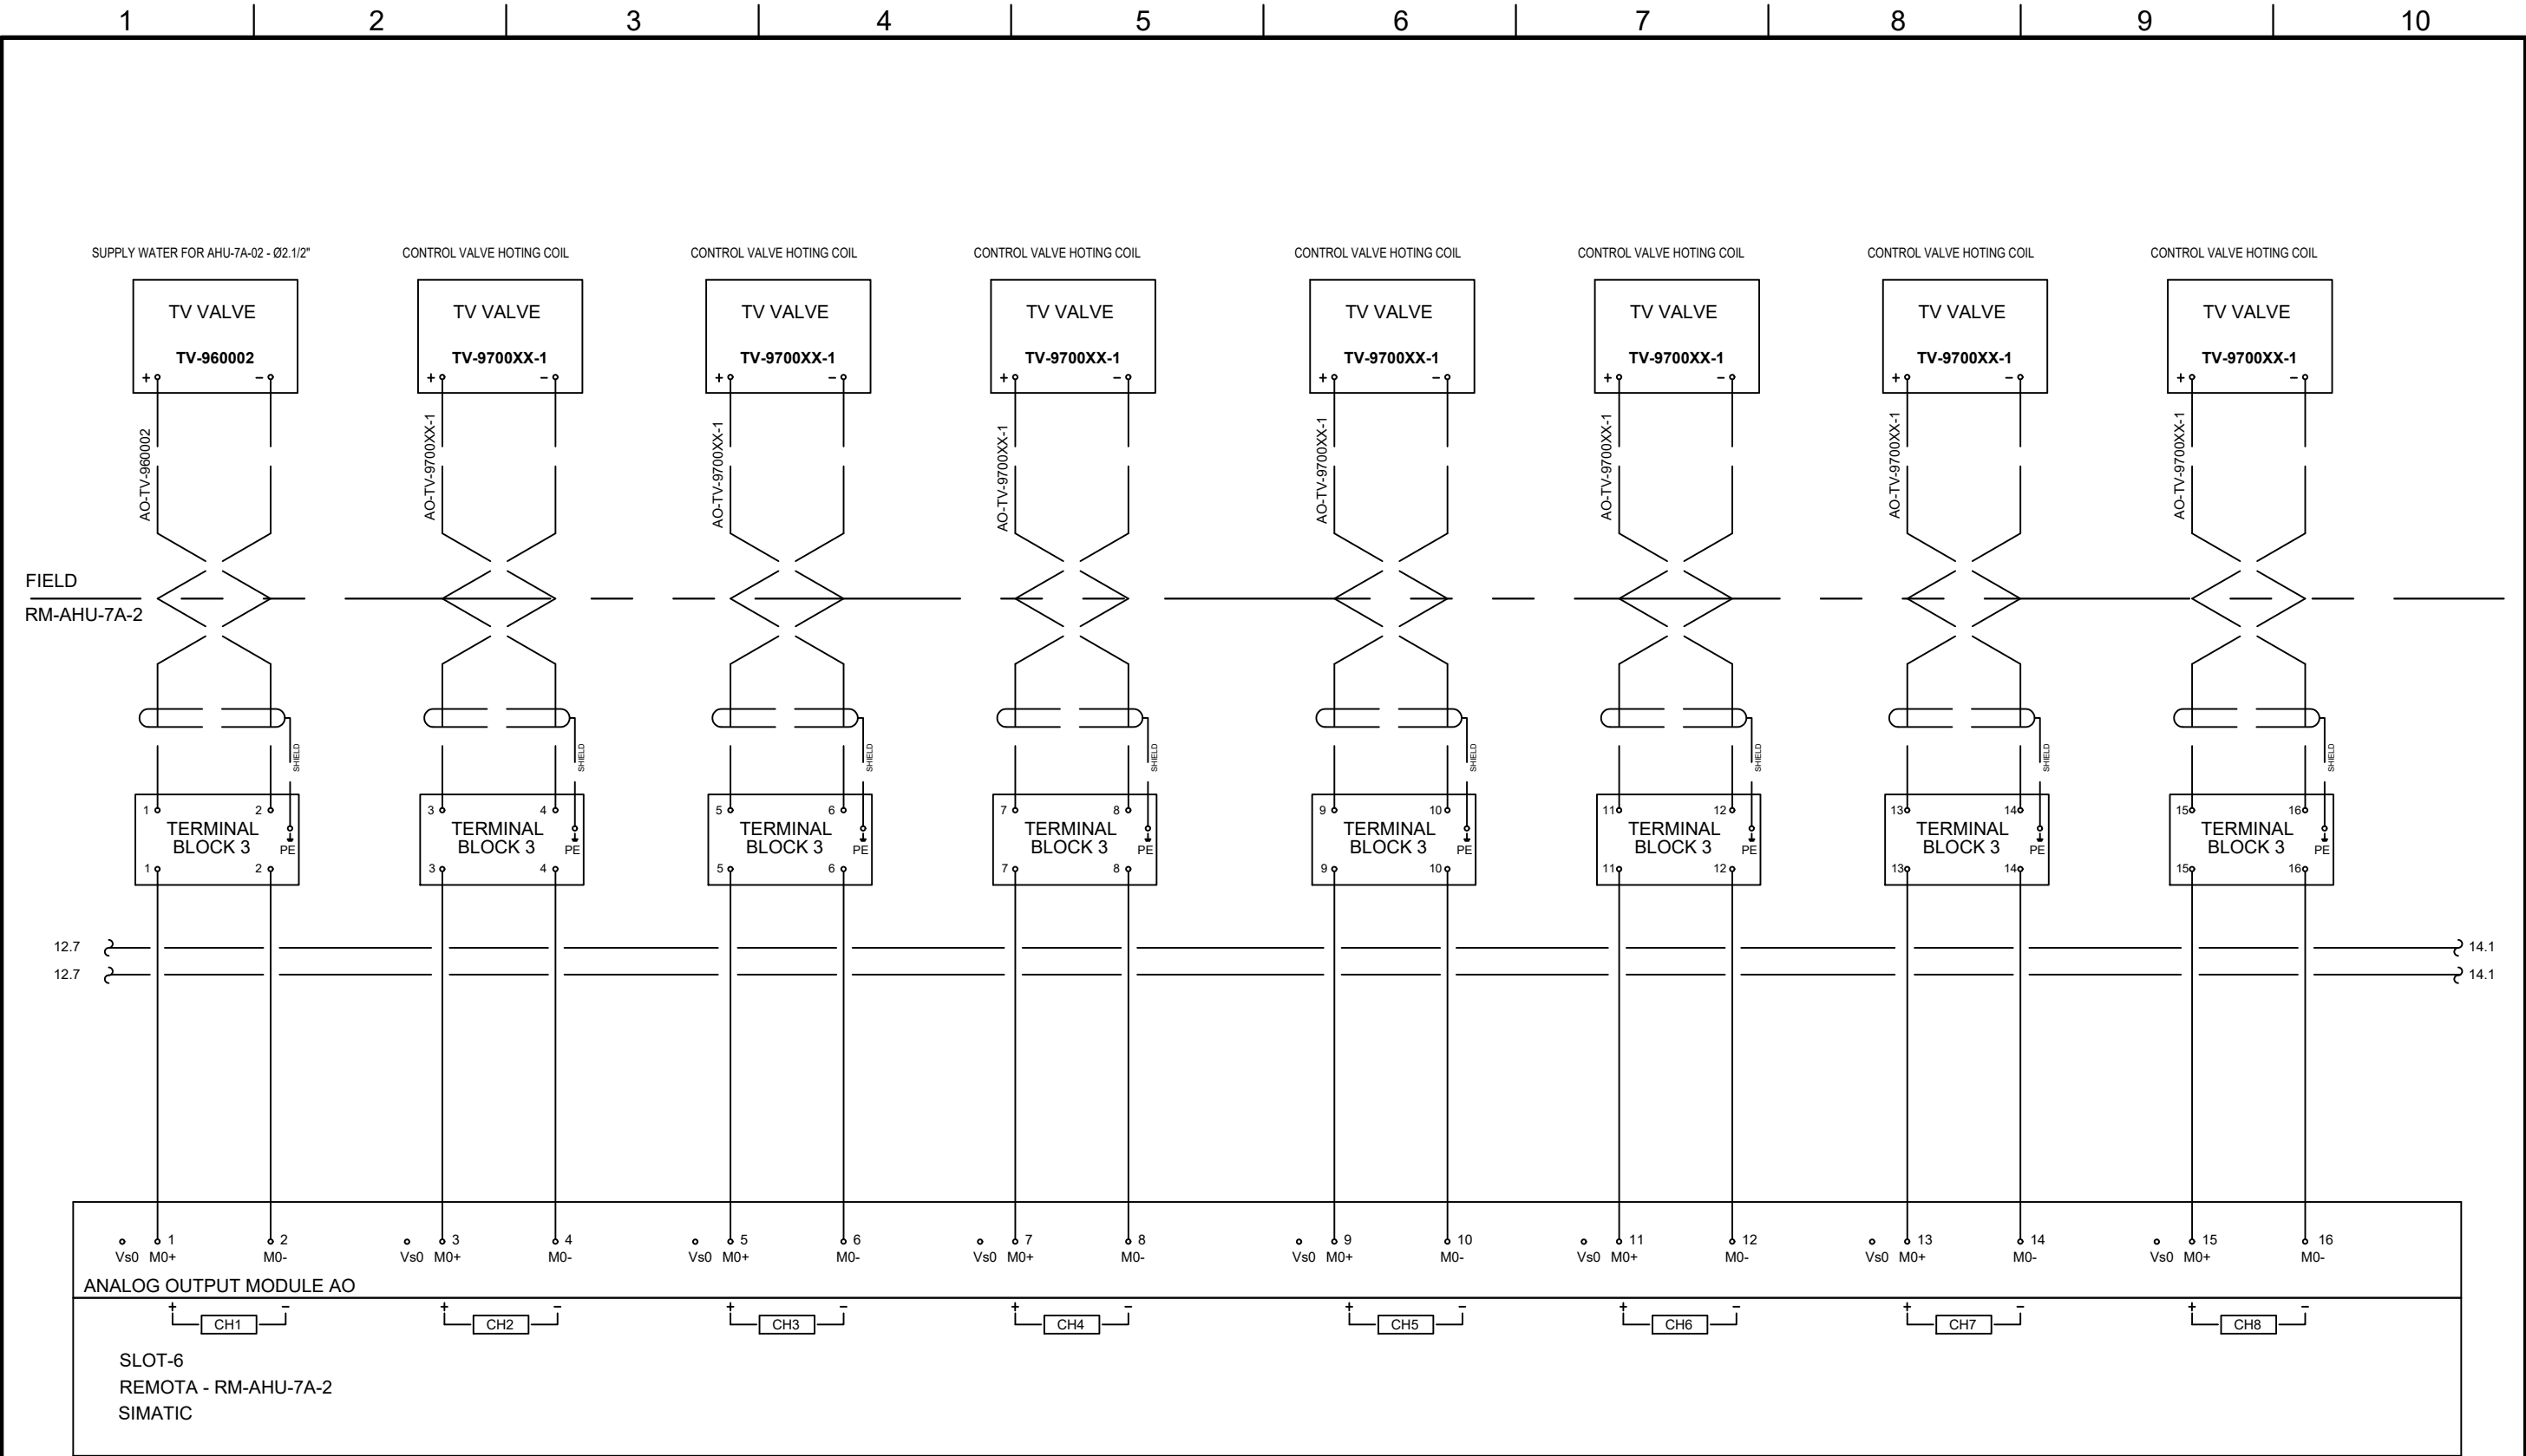


DOC NR: 569-DB7A-AIC-232-005

CLIENT NR: 7A-I-0-3-17

DRAWING TITLE:
DRUG PRODUCT
BMS - WIRING DIAGRAM

SHEET: 13 OF 30
REV: 1

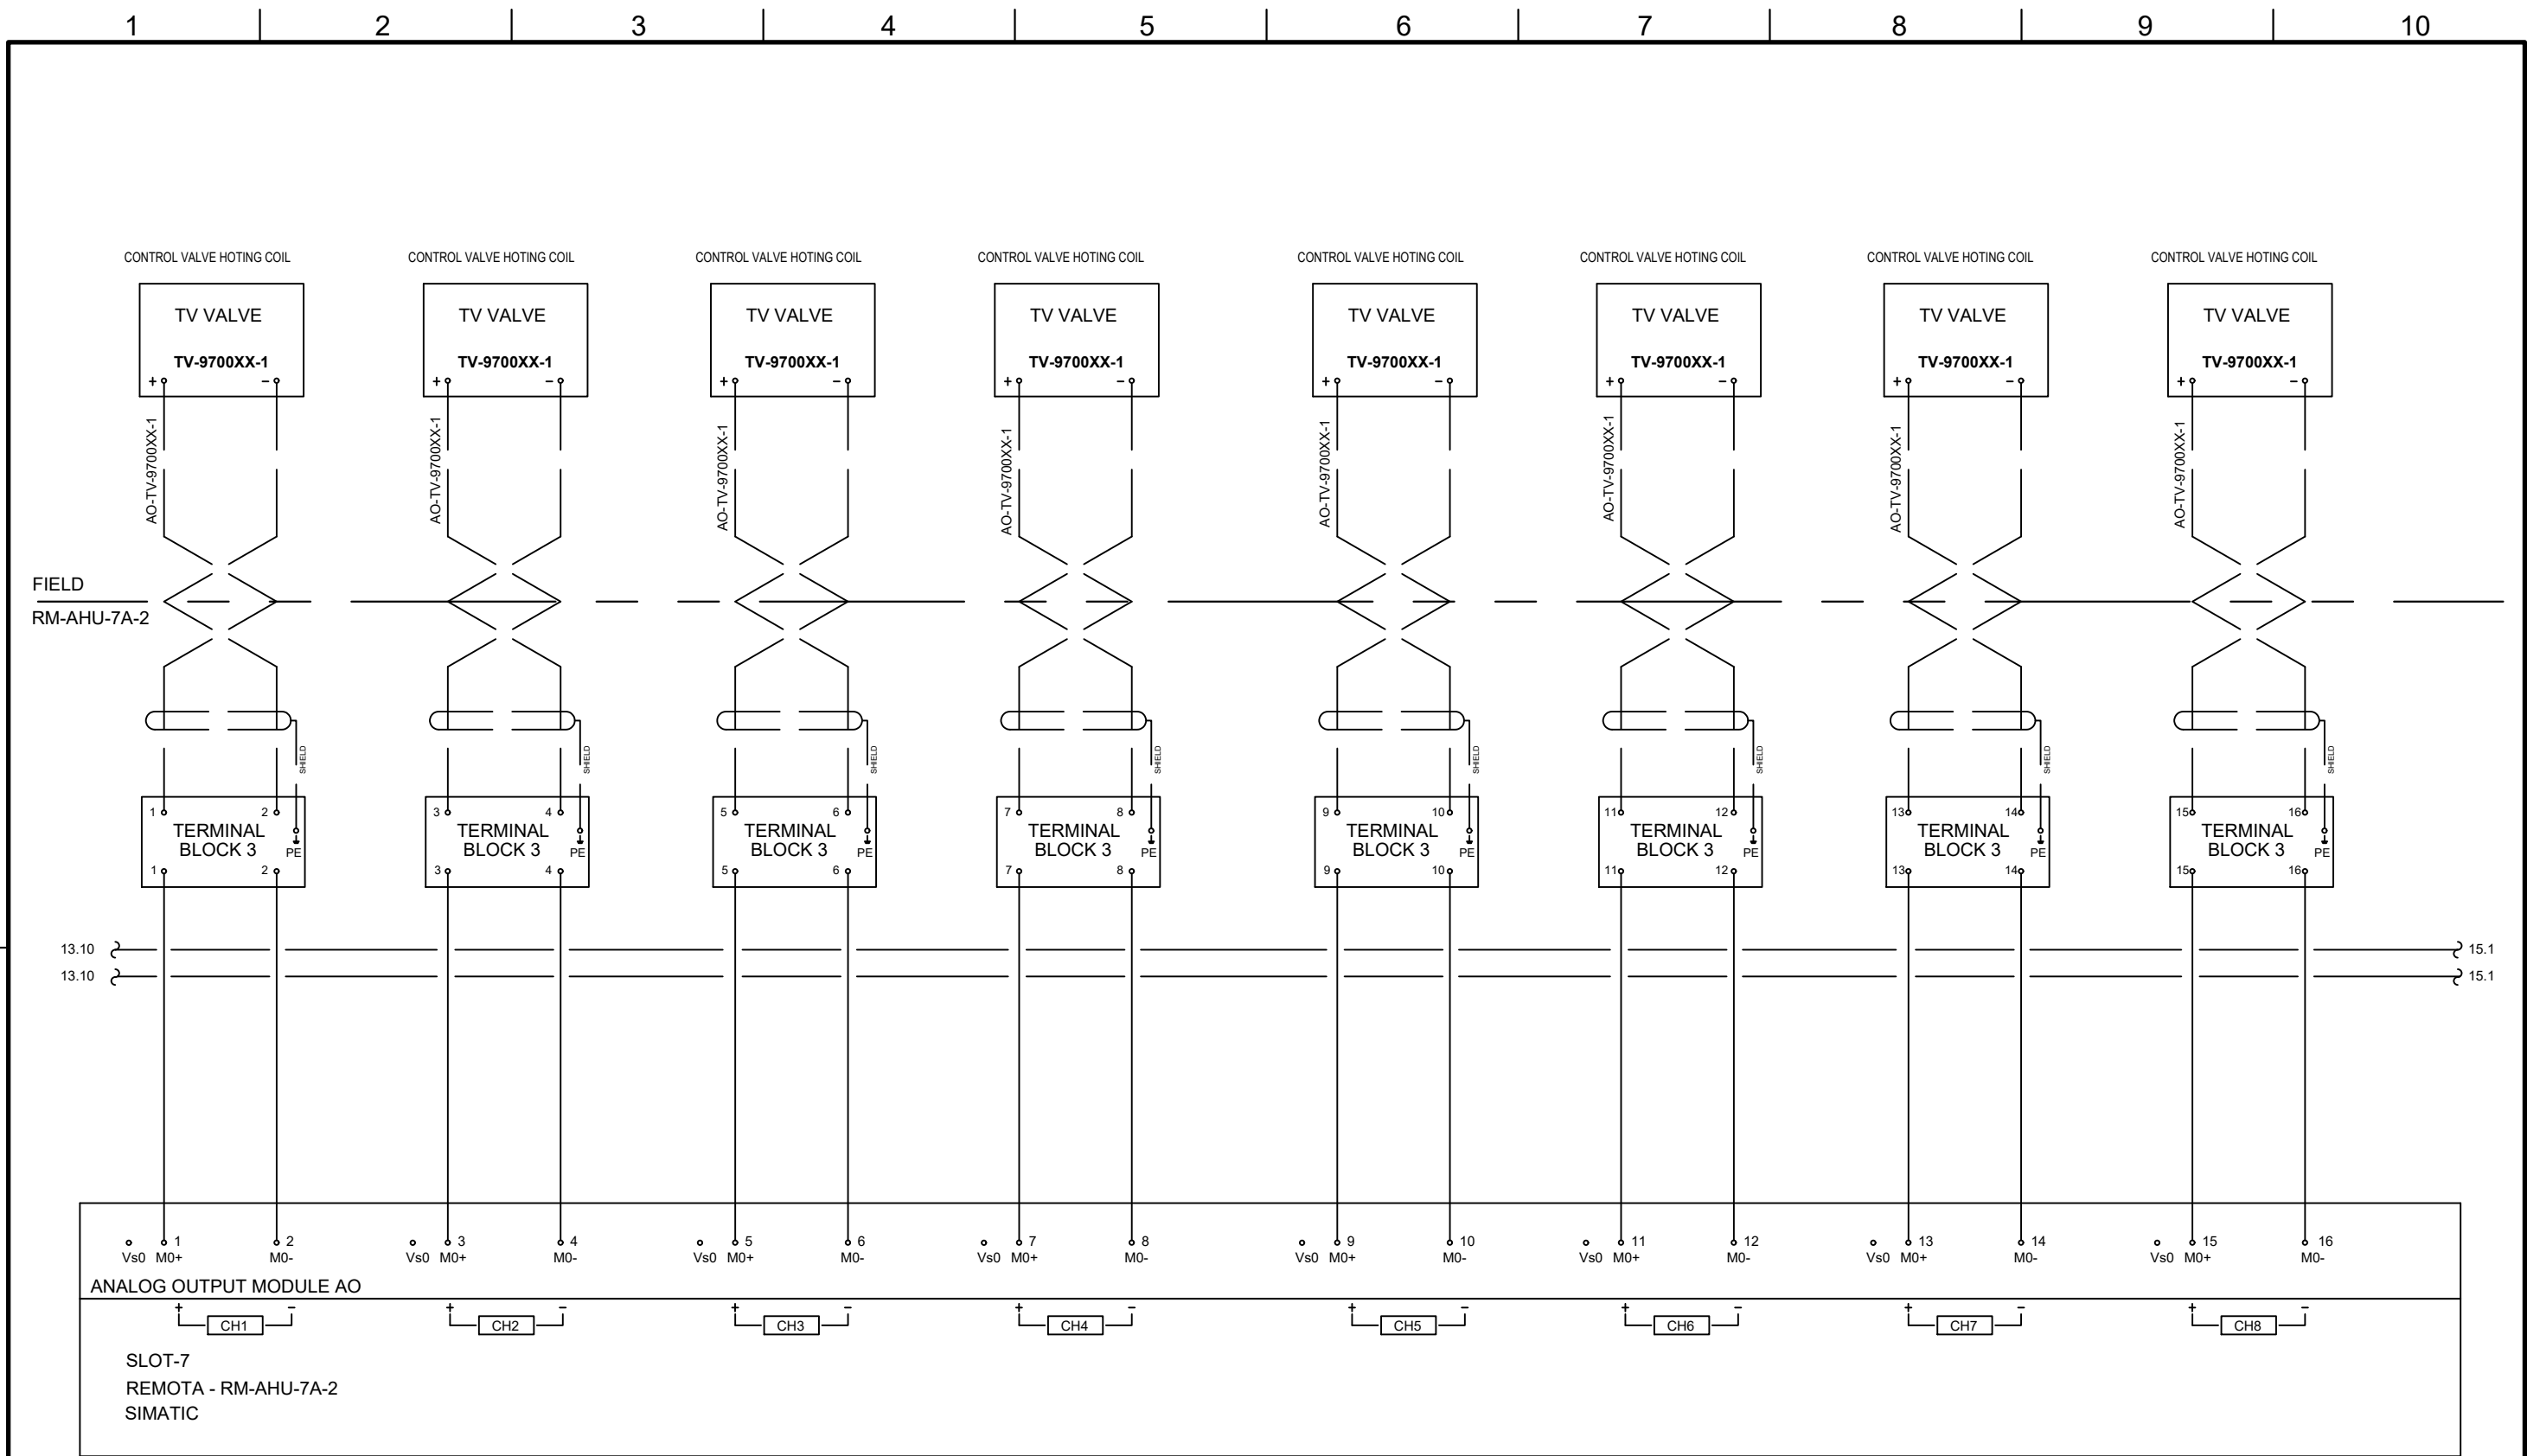


DOC NR: 569-DB7A-AIC-232-005

CLIENT NR: 7A-I-0-3-17

DRAWING TITLE:
DRUG PRODUCT
BMS - WIRING DIAGRAM

SHEET: 14 OF 30

REV: 1

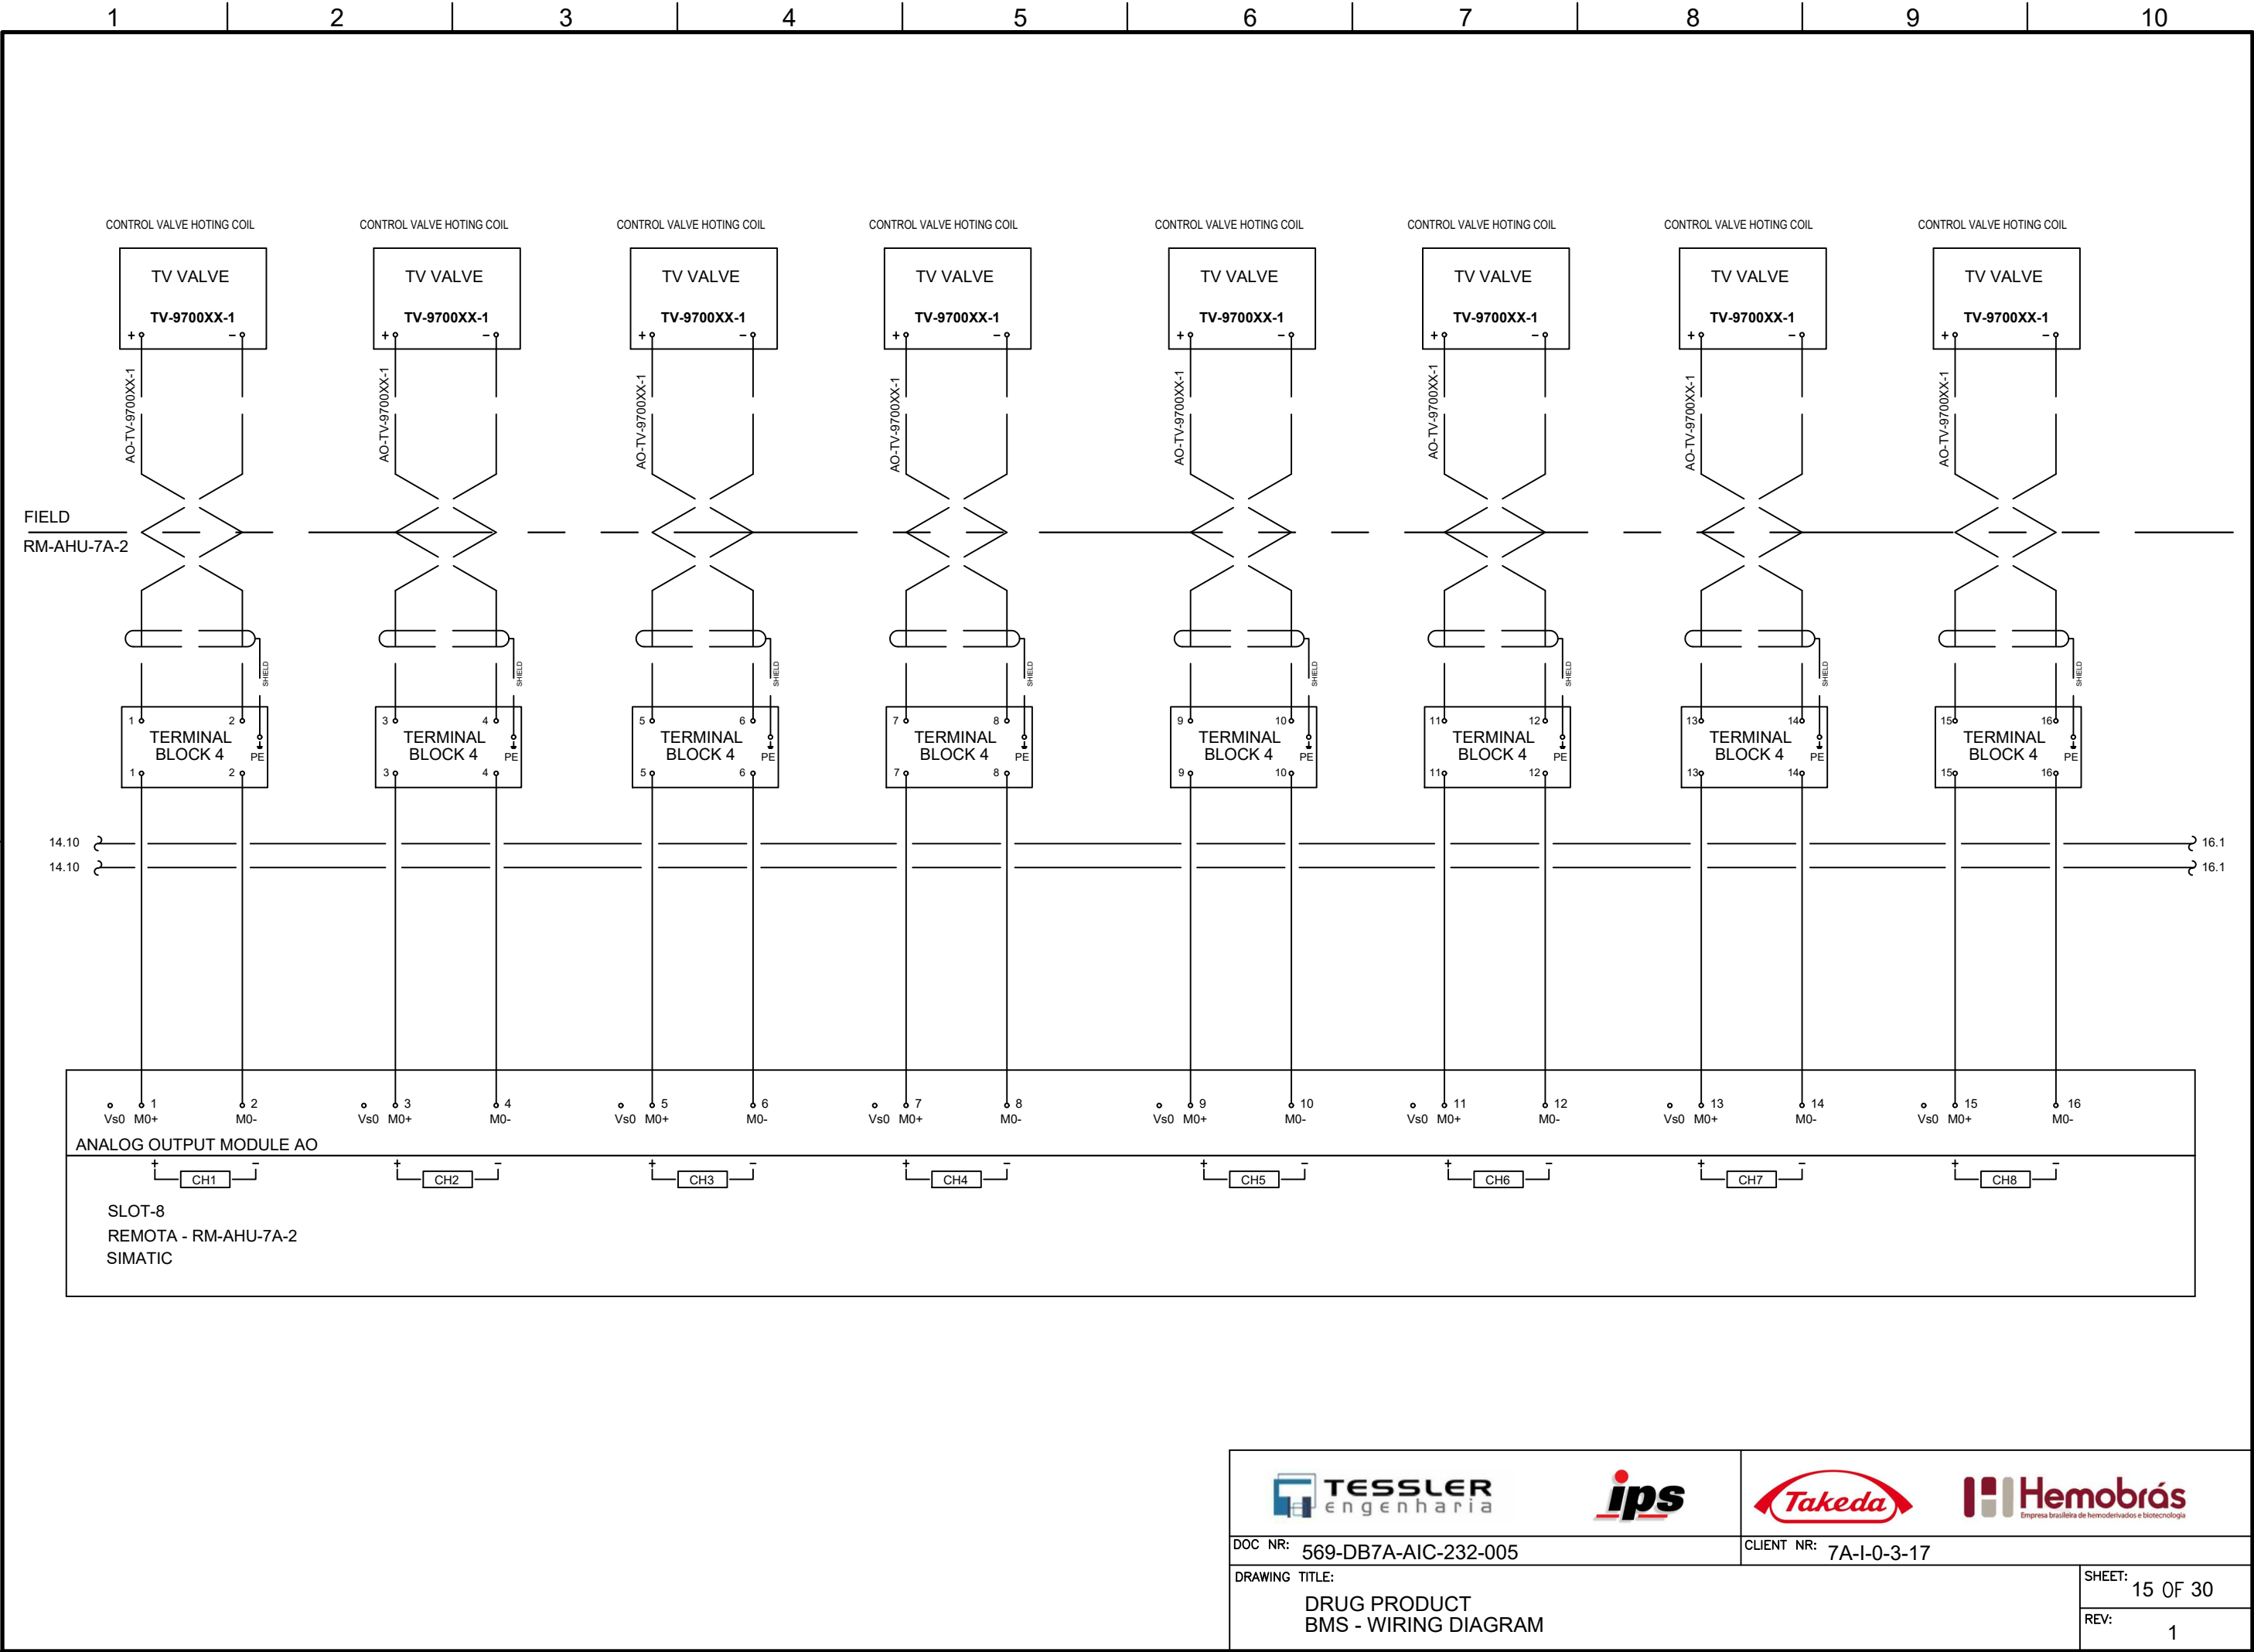



DOC NR: 569-DB7A-AIC-232-005


CLIENT NR: 7A-I-0-3-17

DRAWING TITLE:
DRUG PRODUCT
BMS - WIRING DIAGRAM

SHEET: 15 OF 30
REV: 1

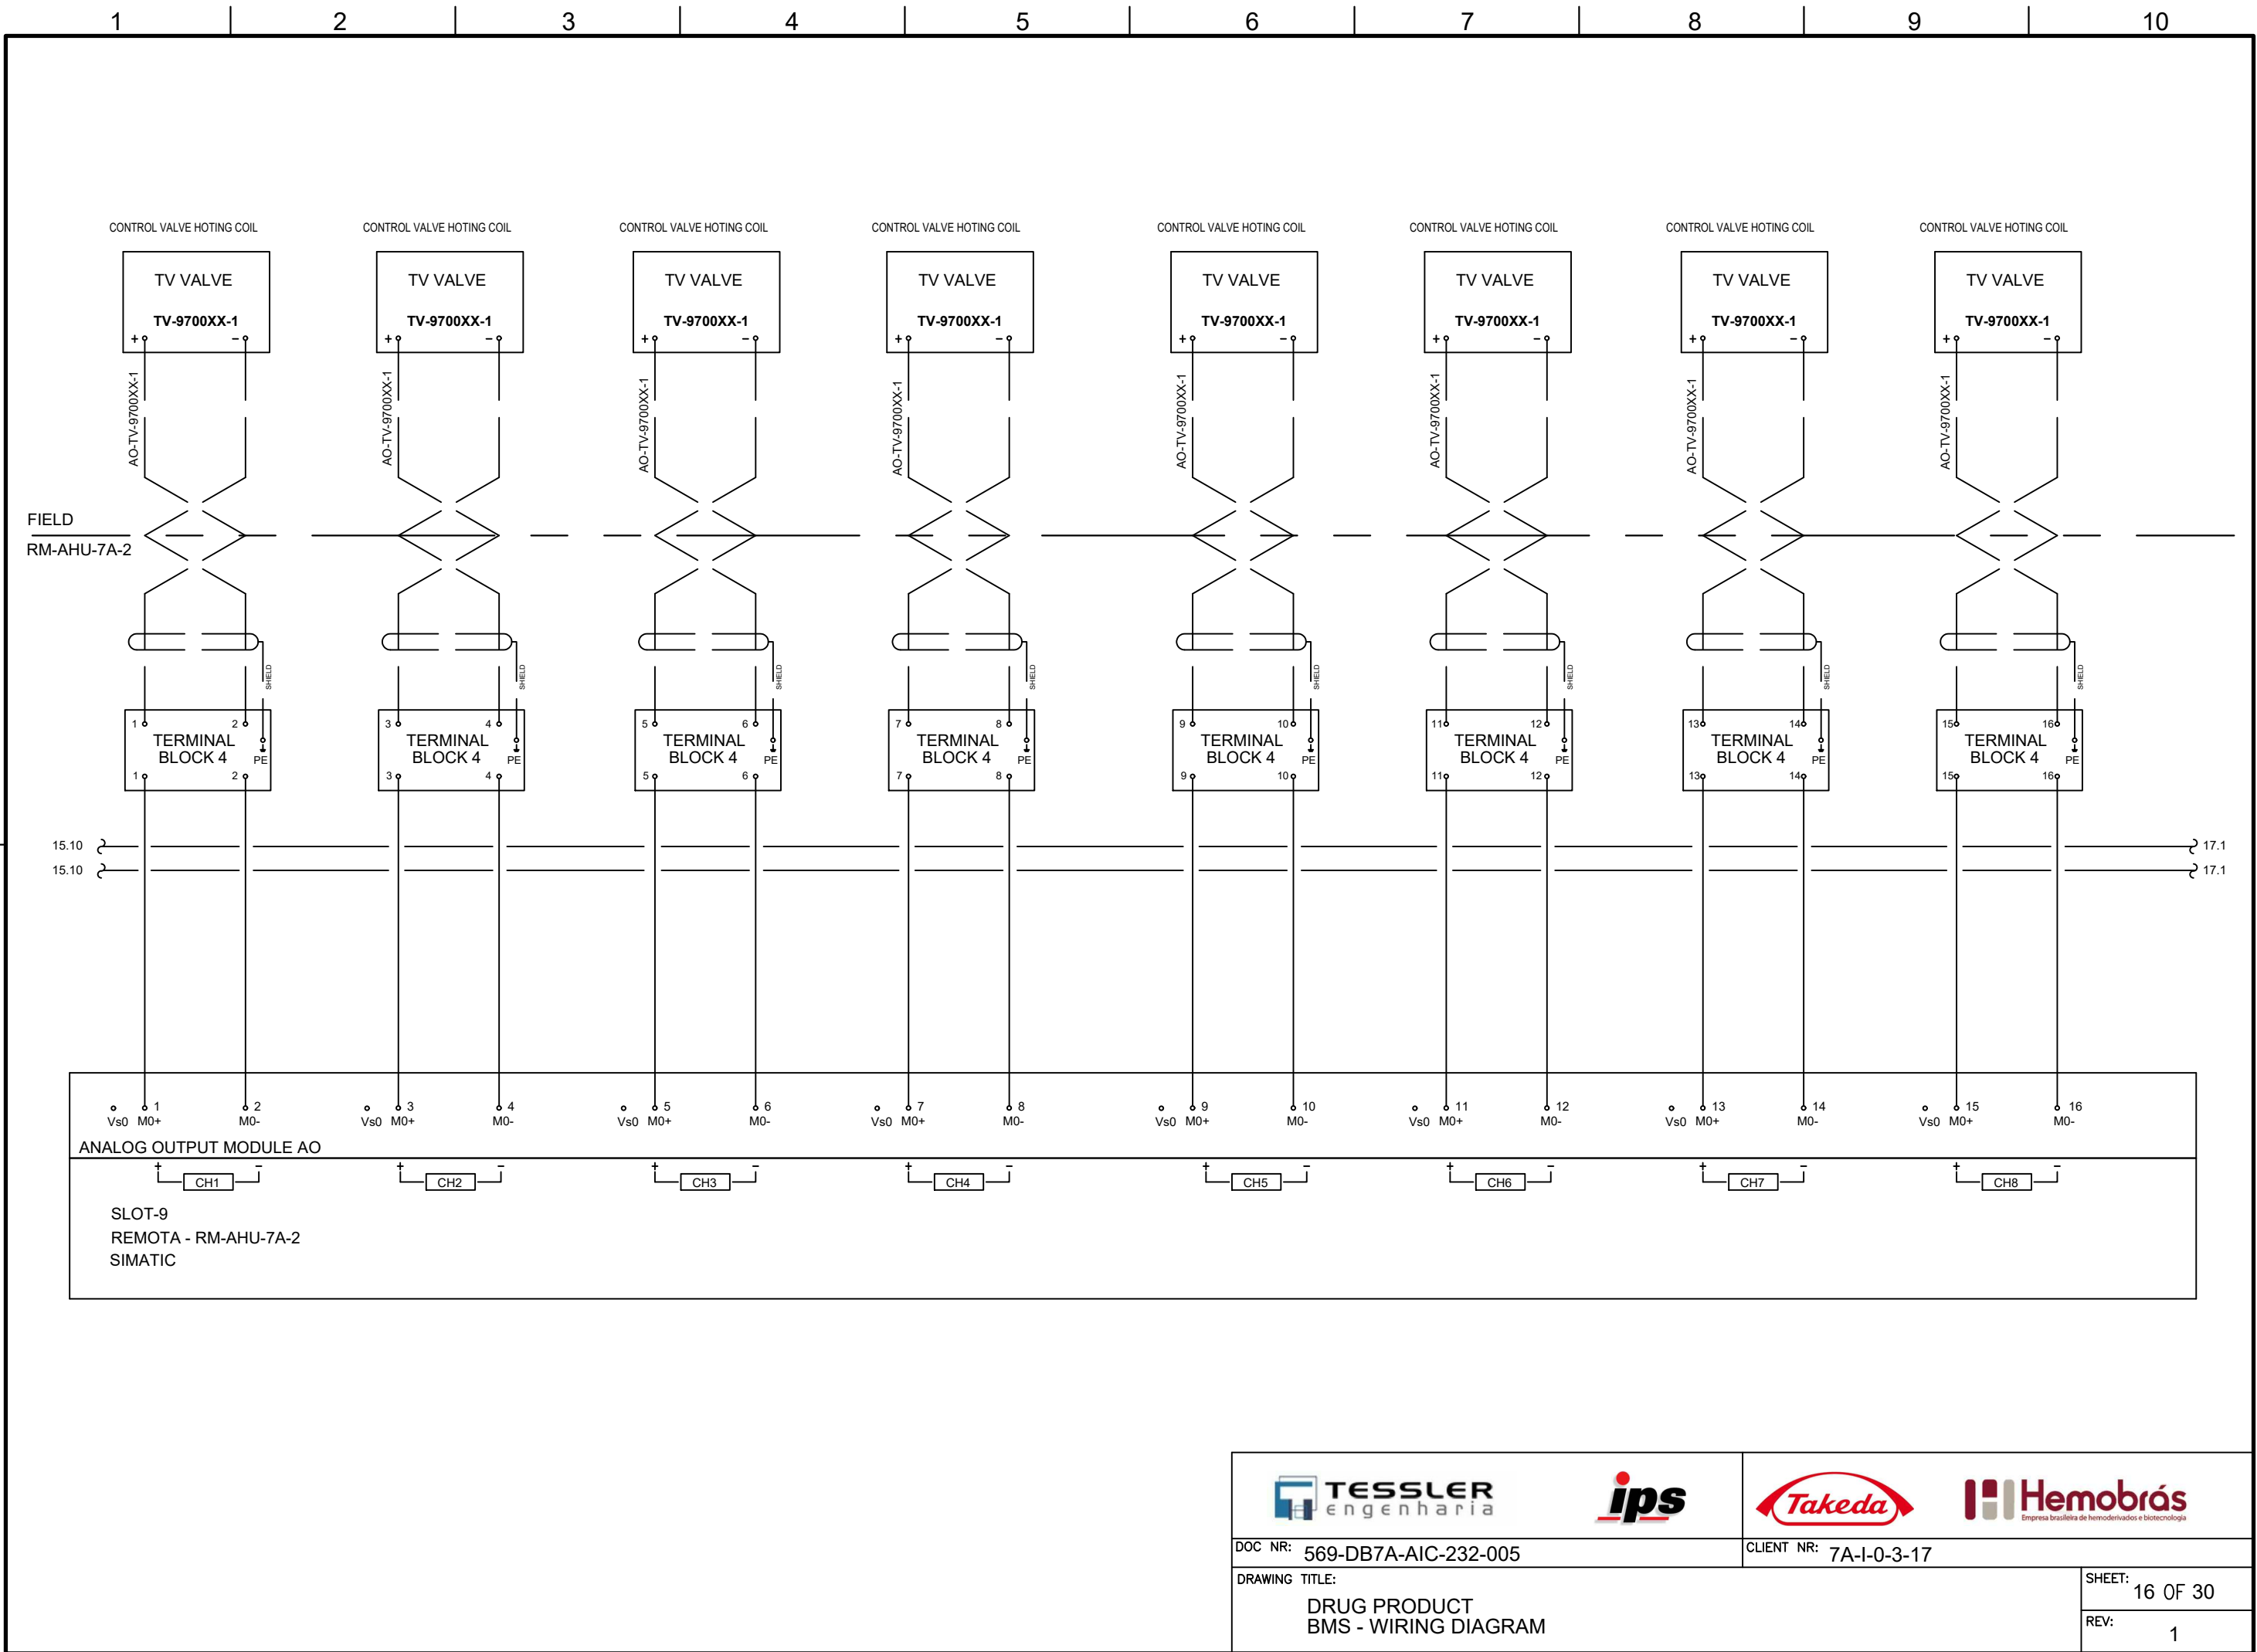

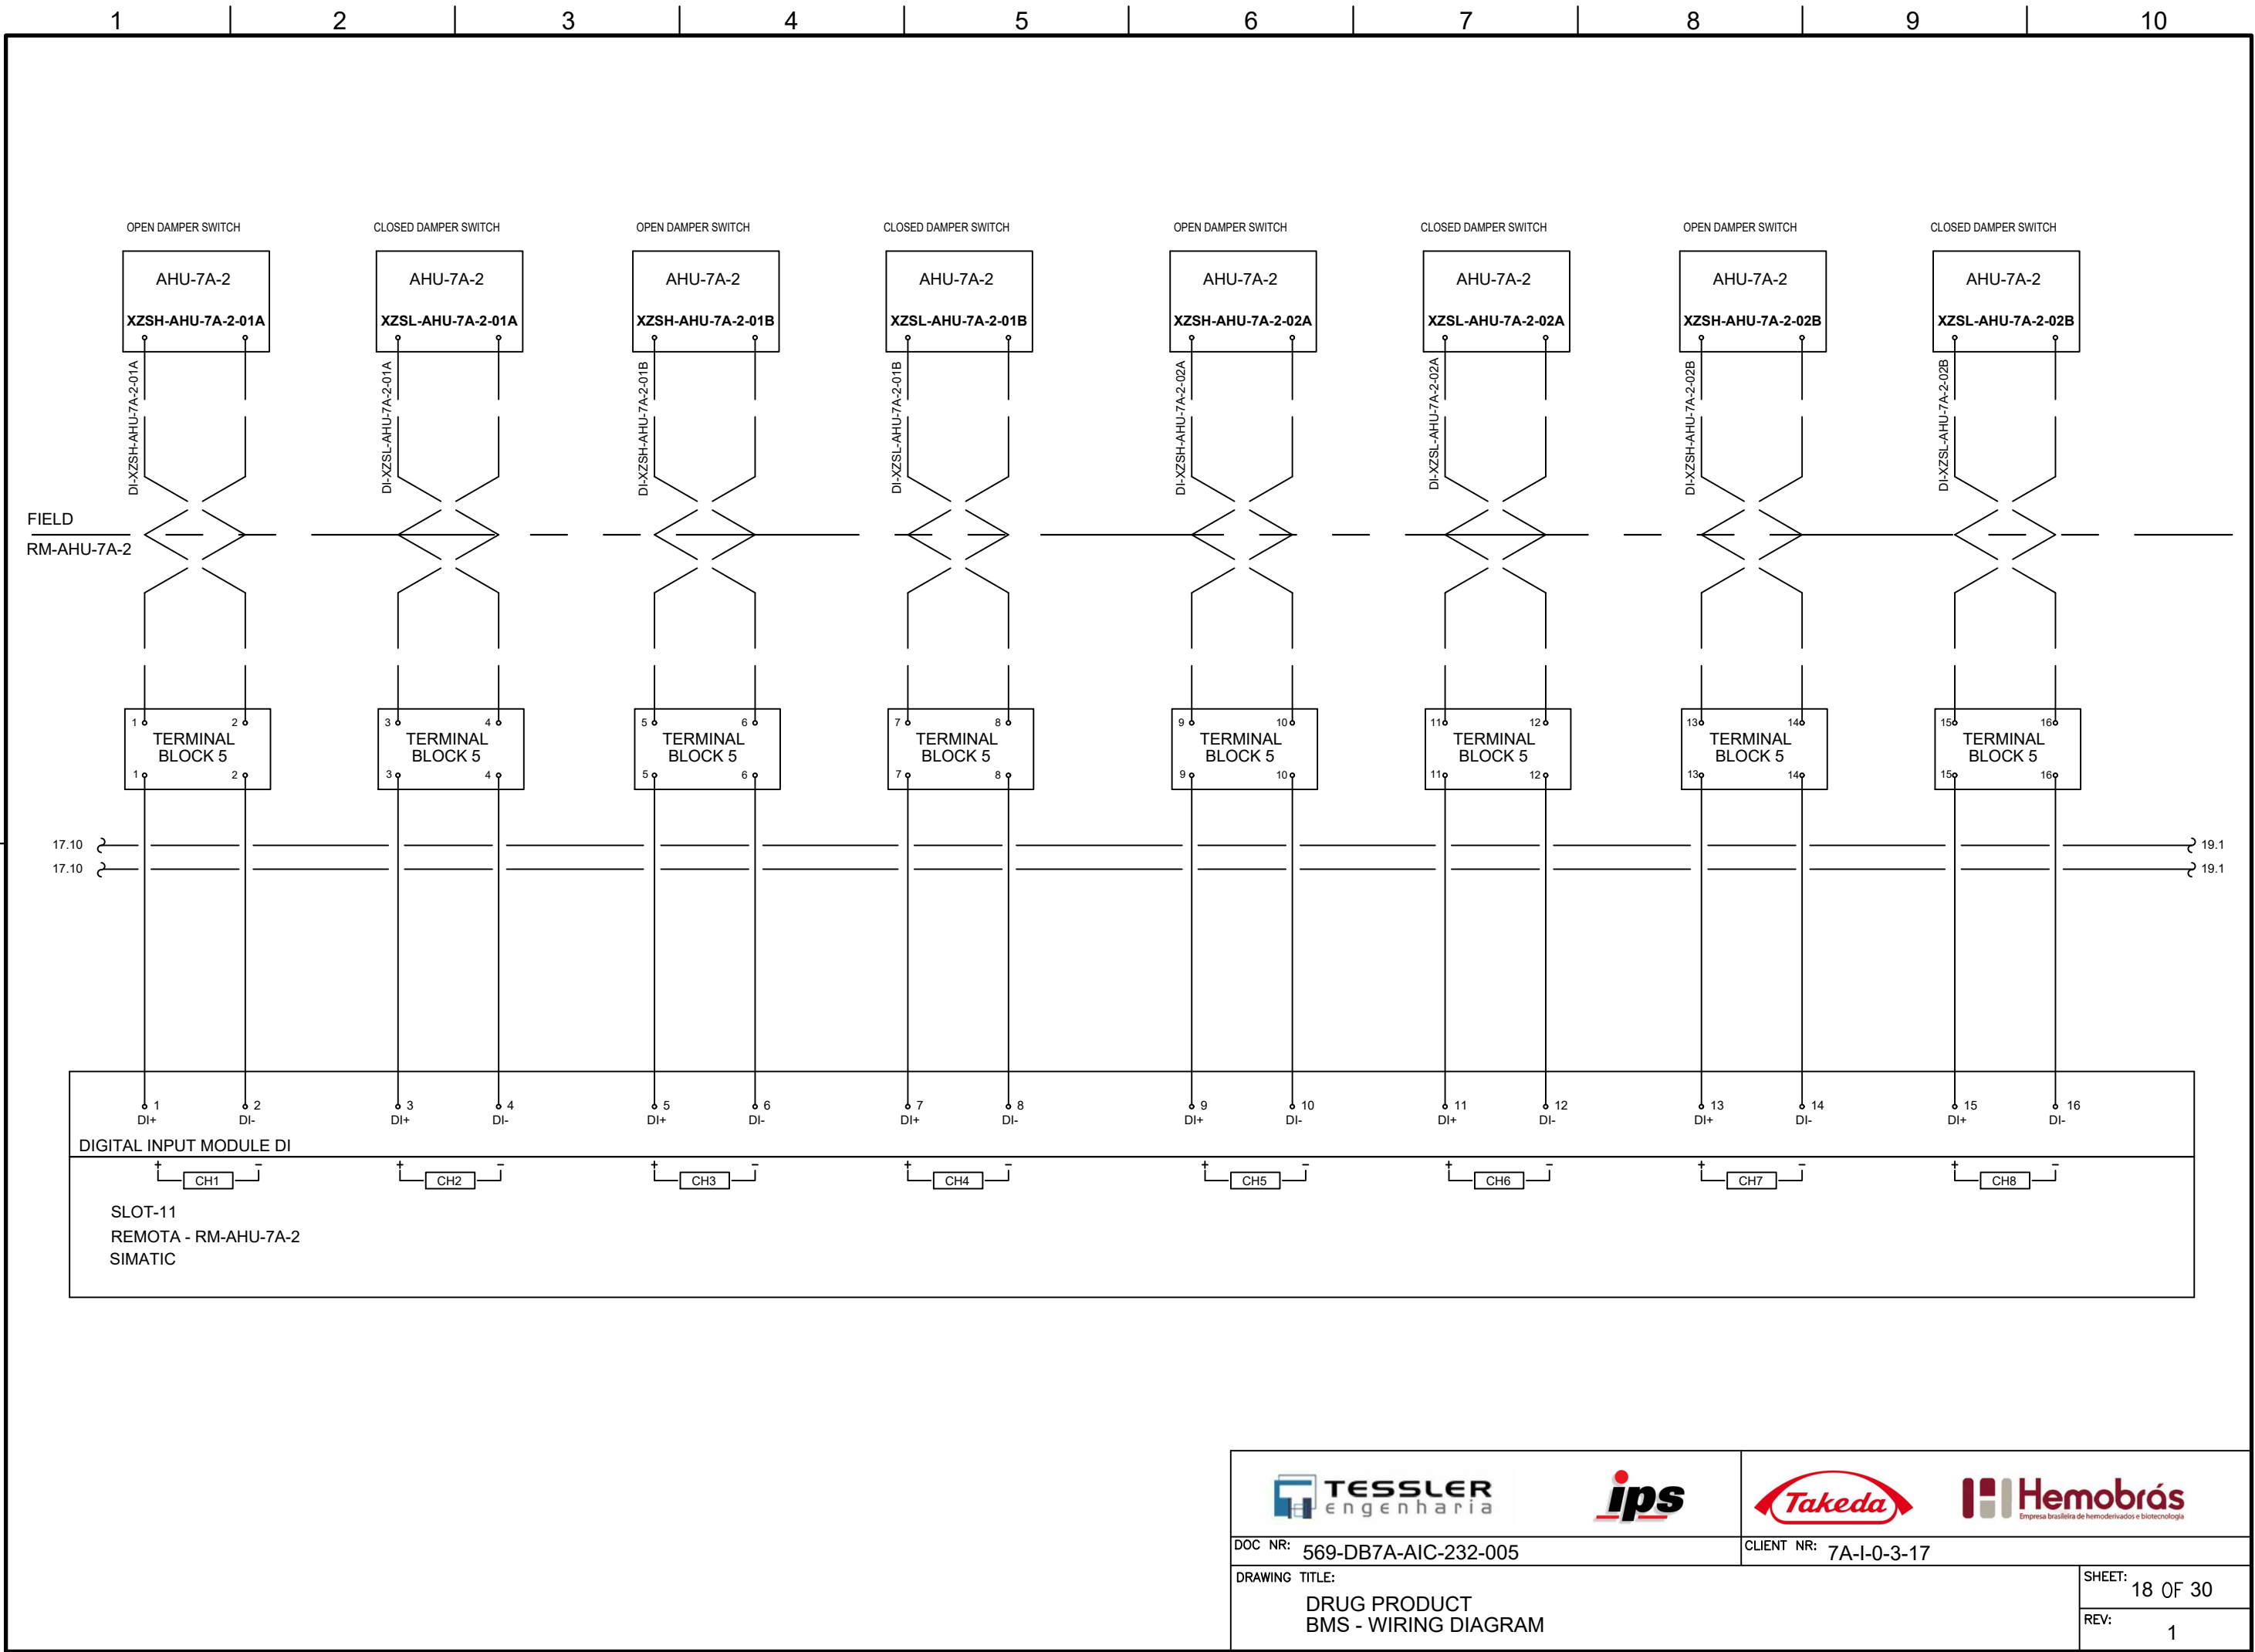

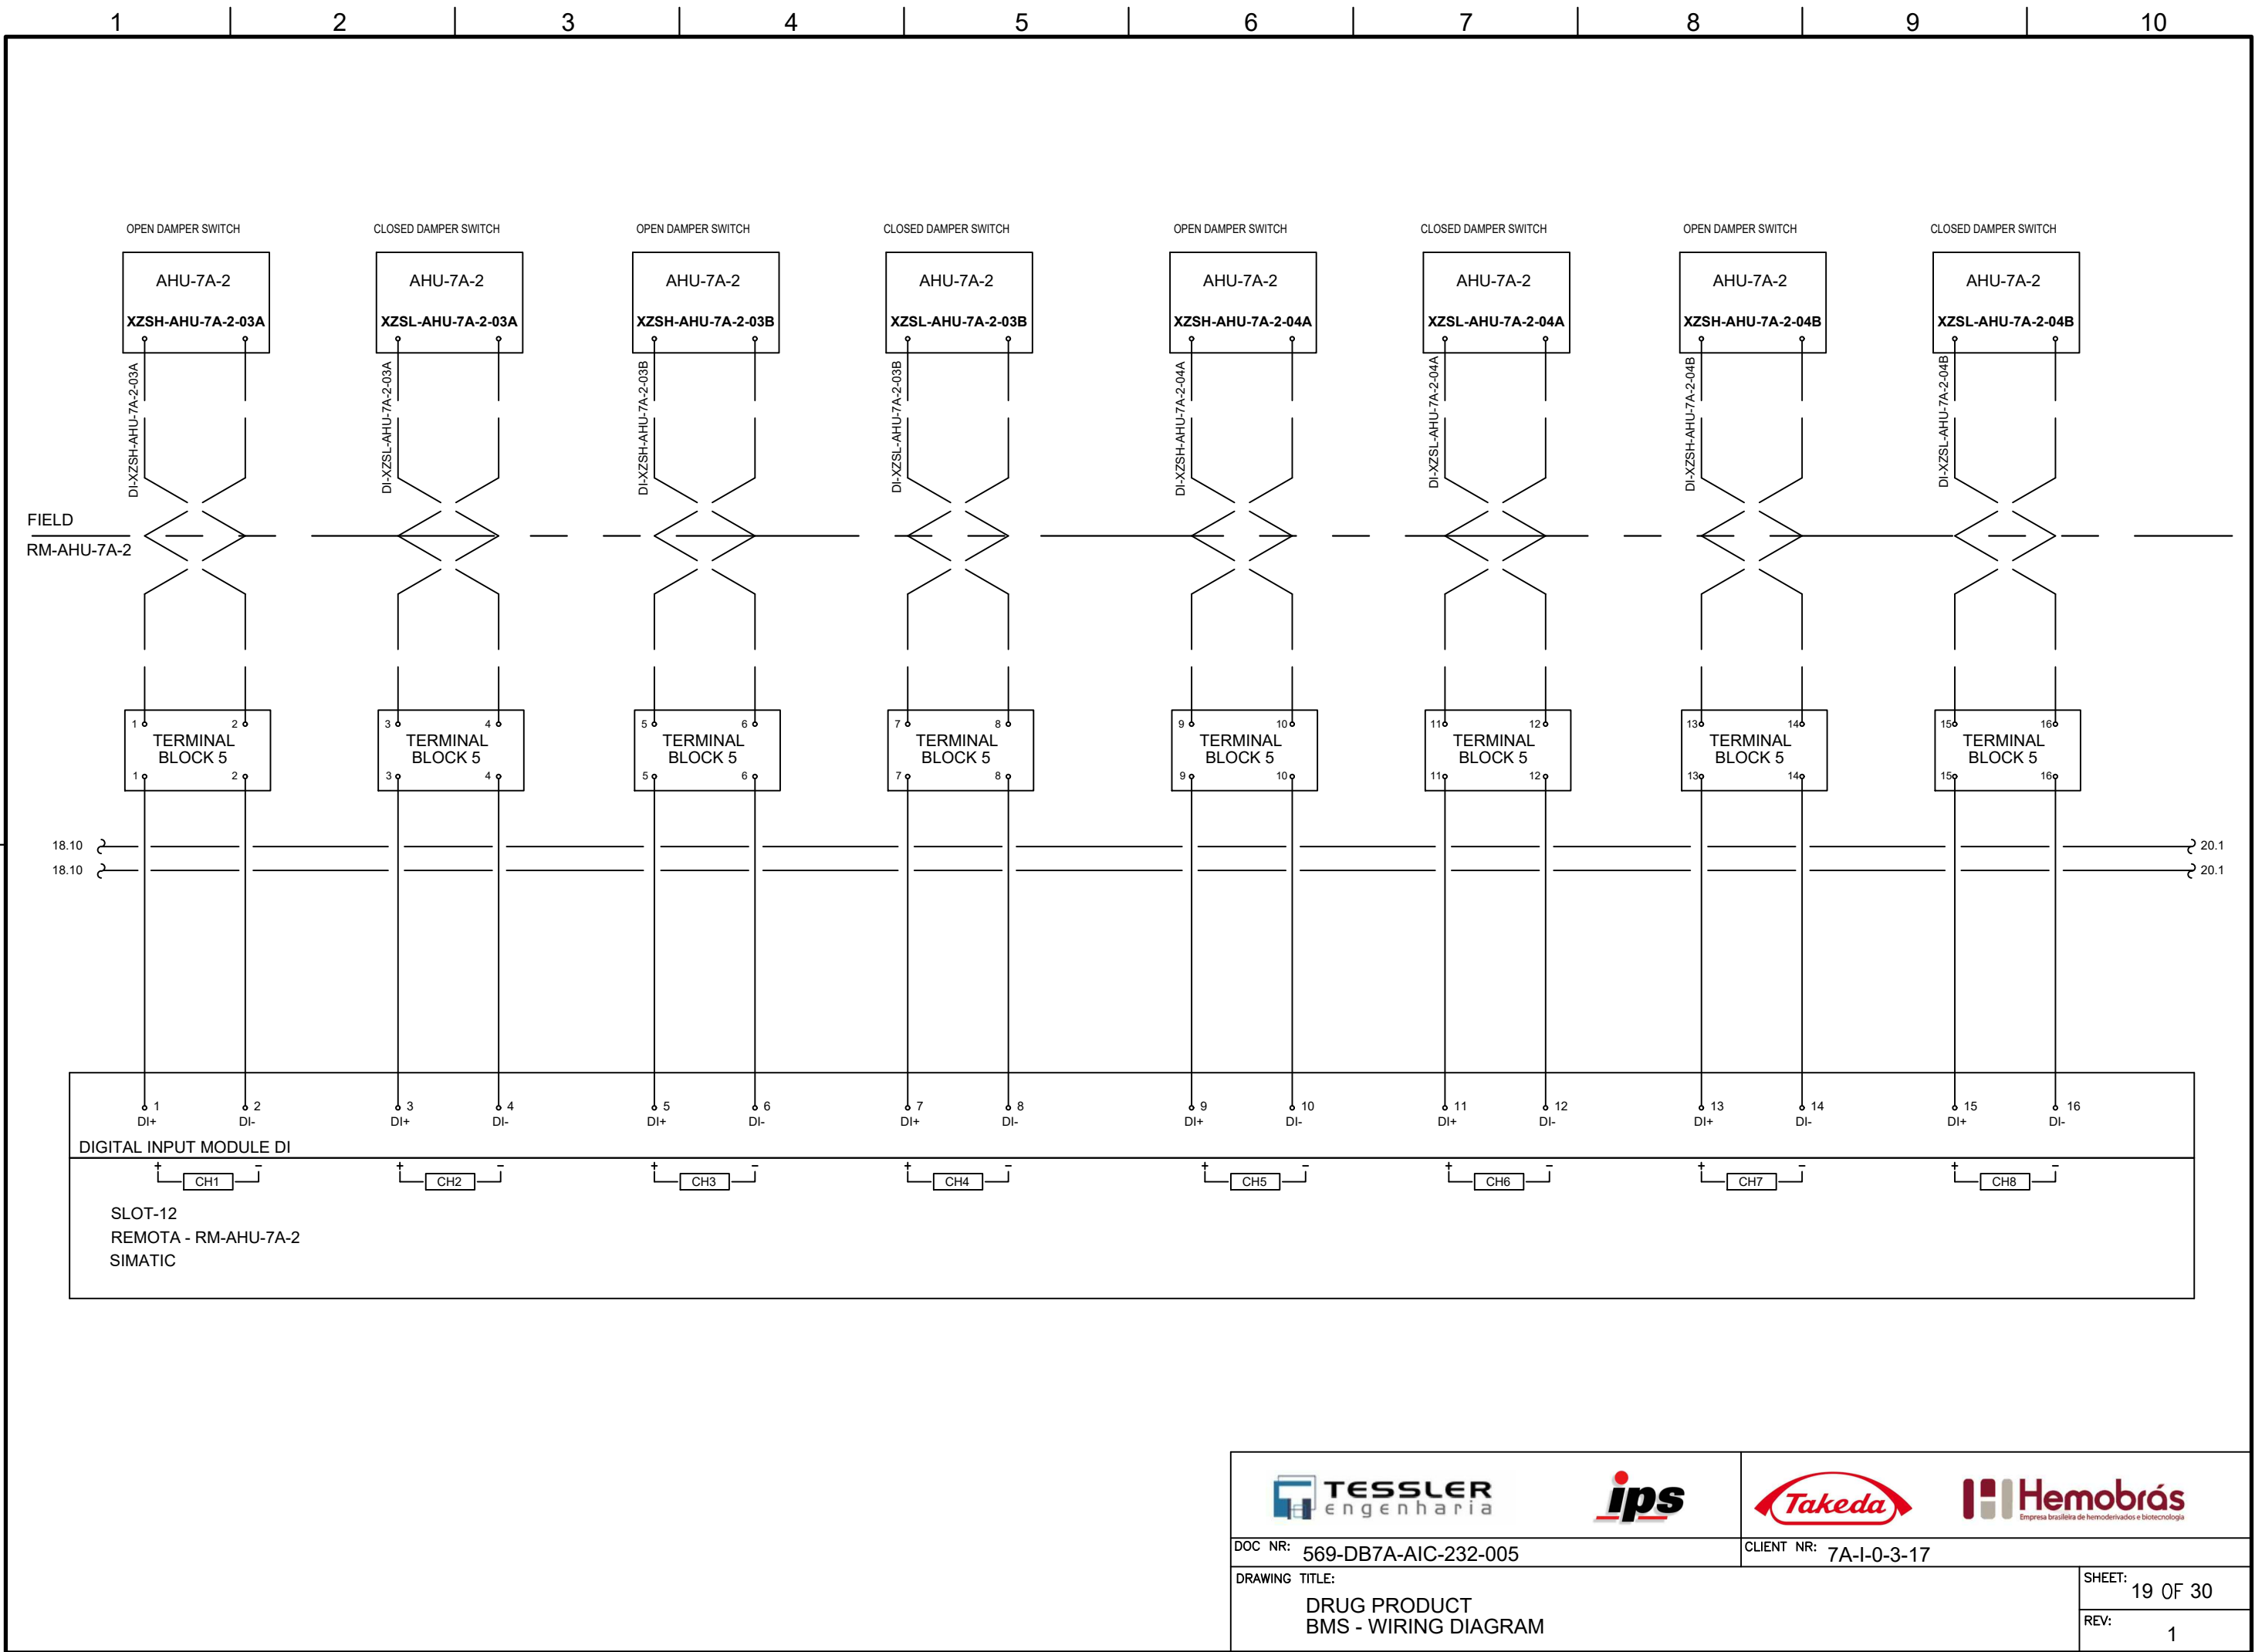

TESSLER

engenharia

ips

DOC NR: 569-DB7A-AIC-232-005

CLIENT NR: 7A-I-0-3-17

DRAWING TITLE: DRUG PRODUCT BMS - WIRING DIAGRAM


SHEET: 19 OF 30

REV: 1

Takeda

Hemobrás

Empresa brasileira de hemoderivados e biotecnologia

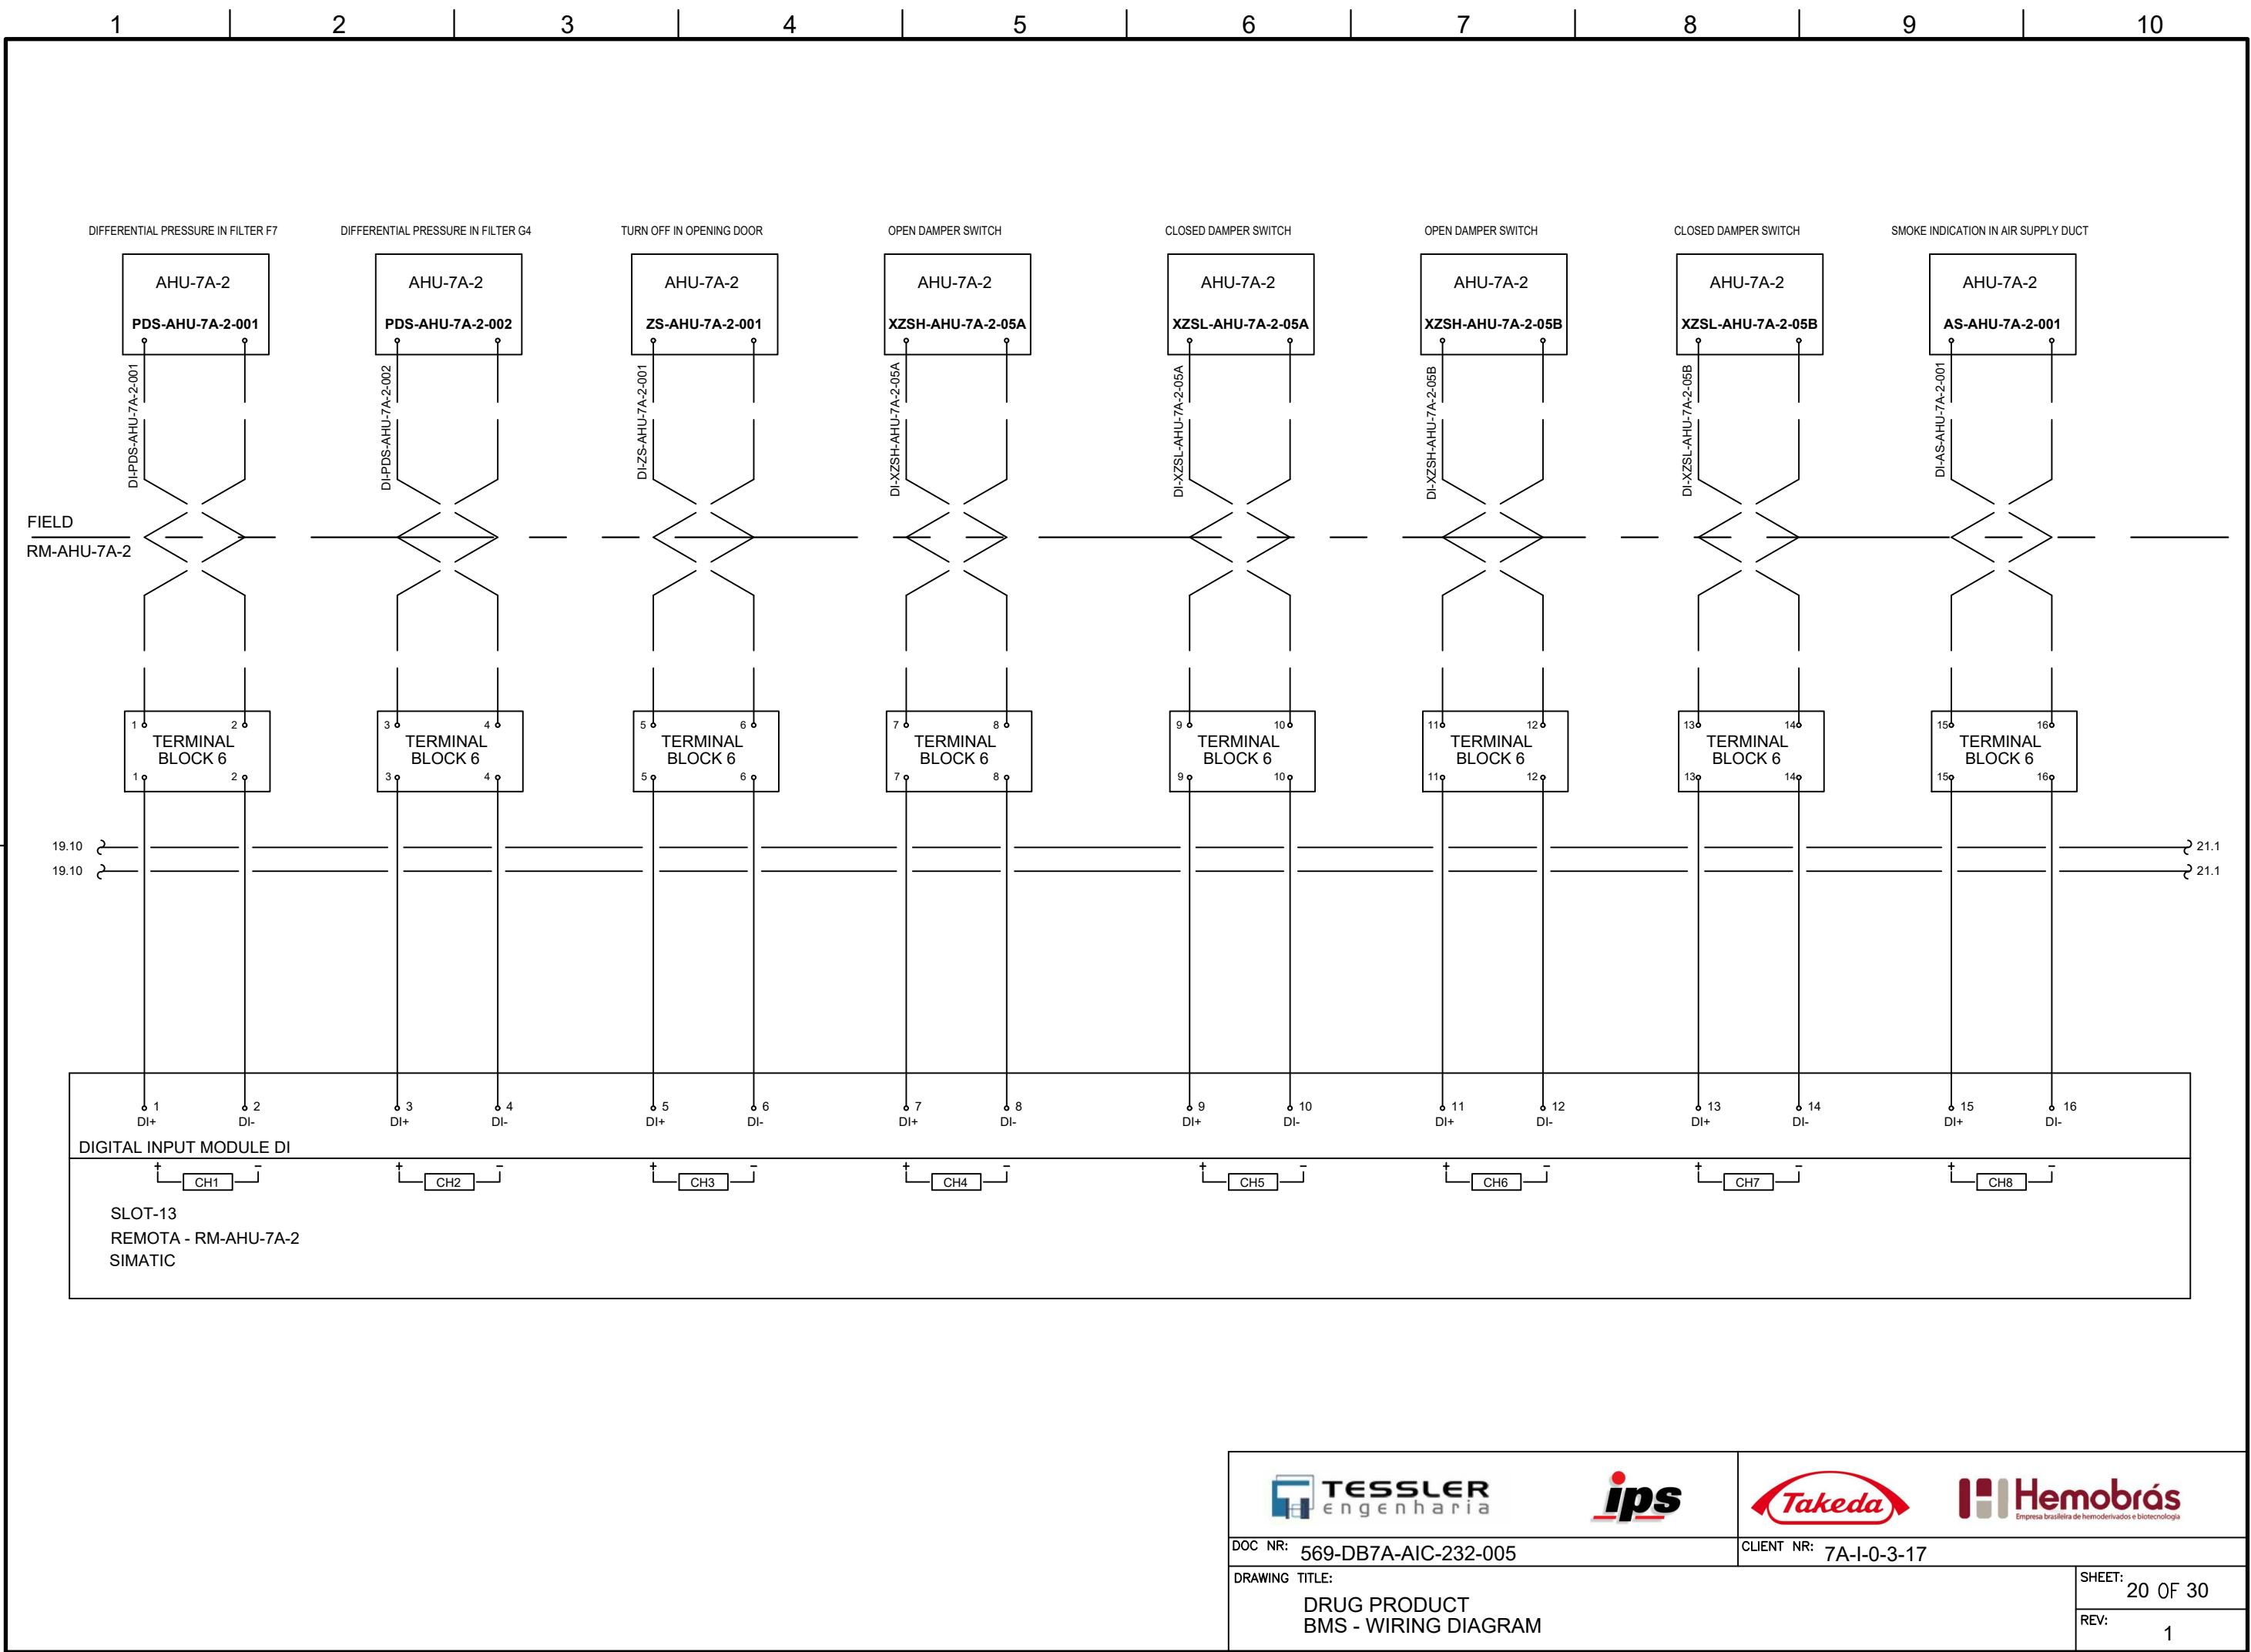

TESSLER

engenharia

ips

Takeda

Empresa brasileira de hemoderivados e biotecnologia

Hemobrás

Empresa brasileira de hemoderivados e biotecnologia


DOC NR: 569-DB7A-AIC-232-005


CLIENT NR: 7A-I-0-3-17

DRAWING TITLE: DRUG PRODUCT
BMS - WIRING DIAGRAM

SHEET: 20 OF 30

REV: 1

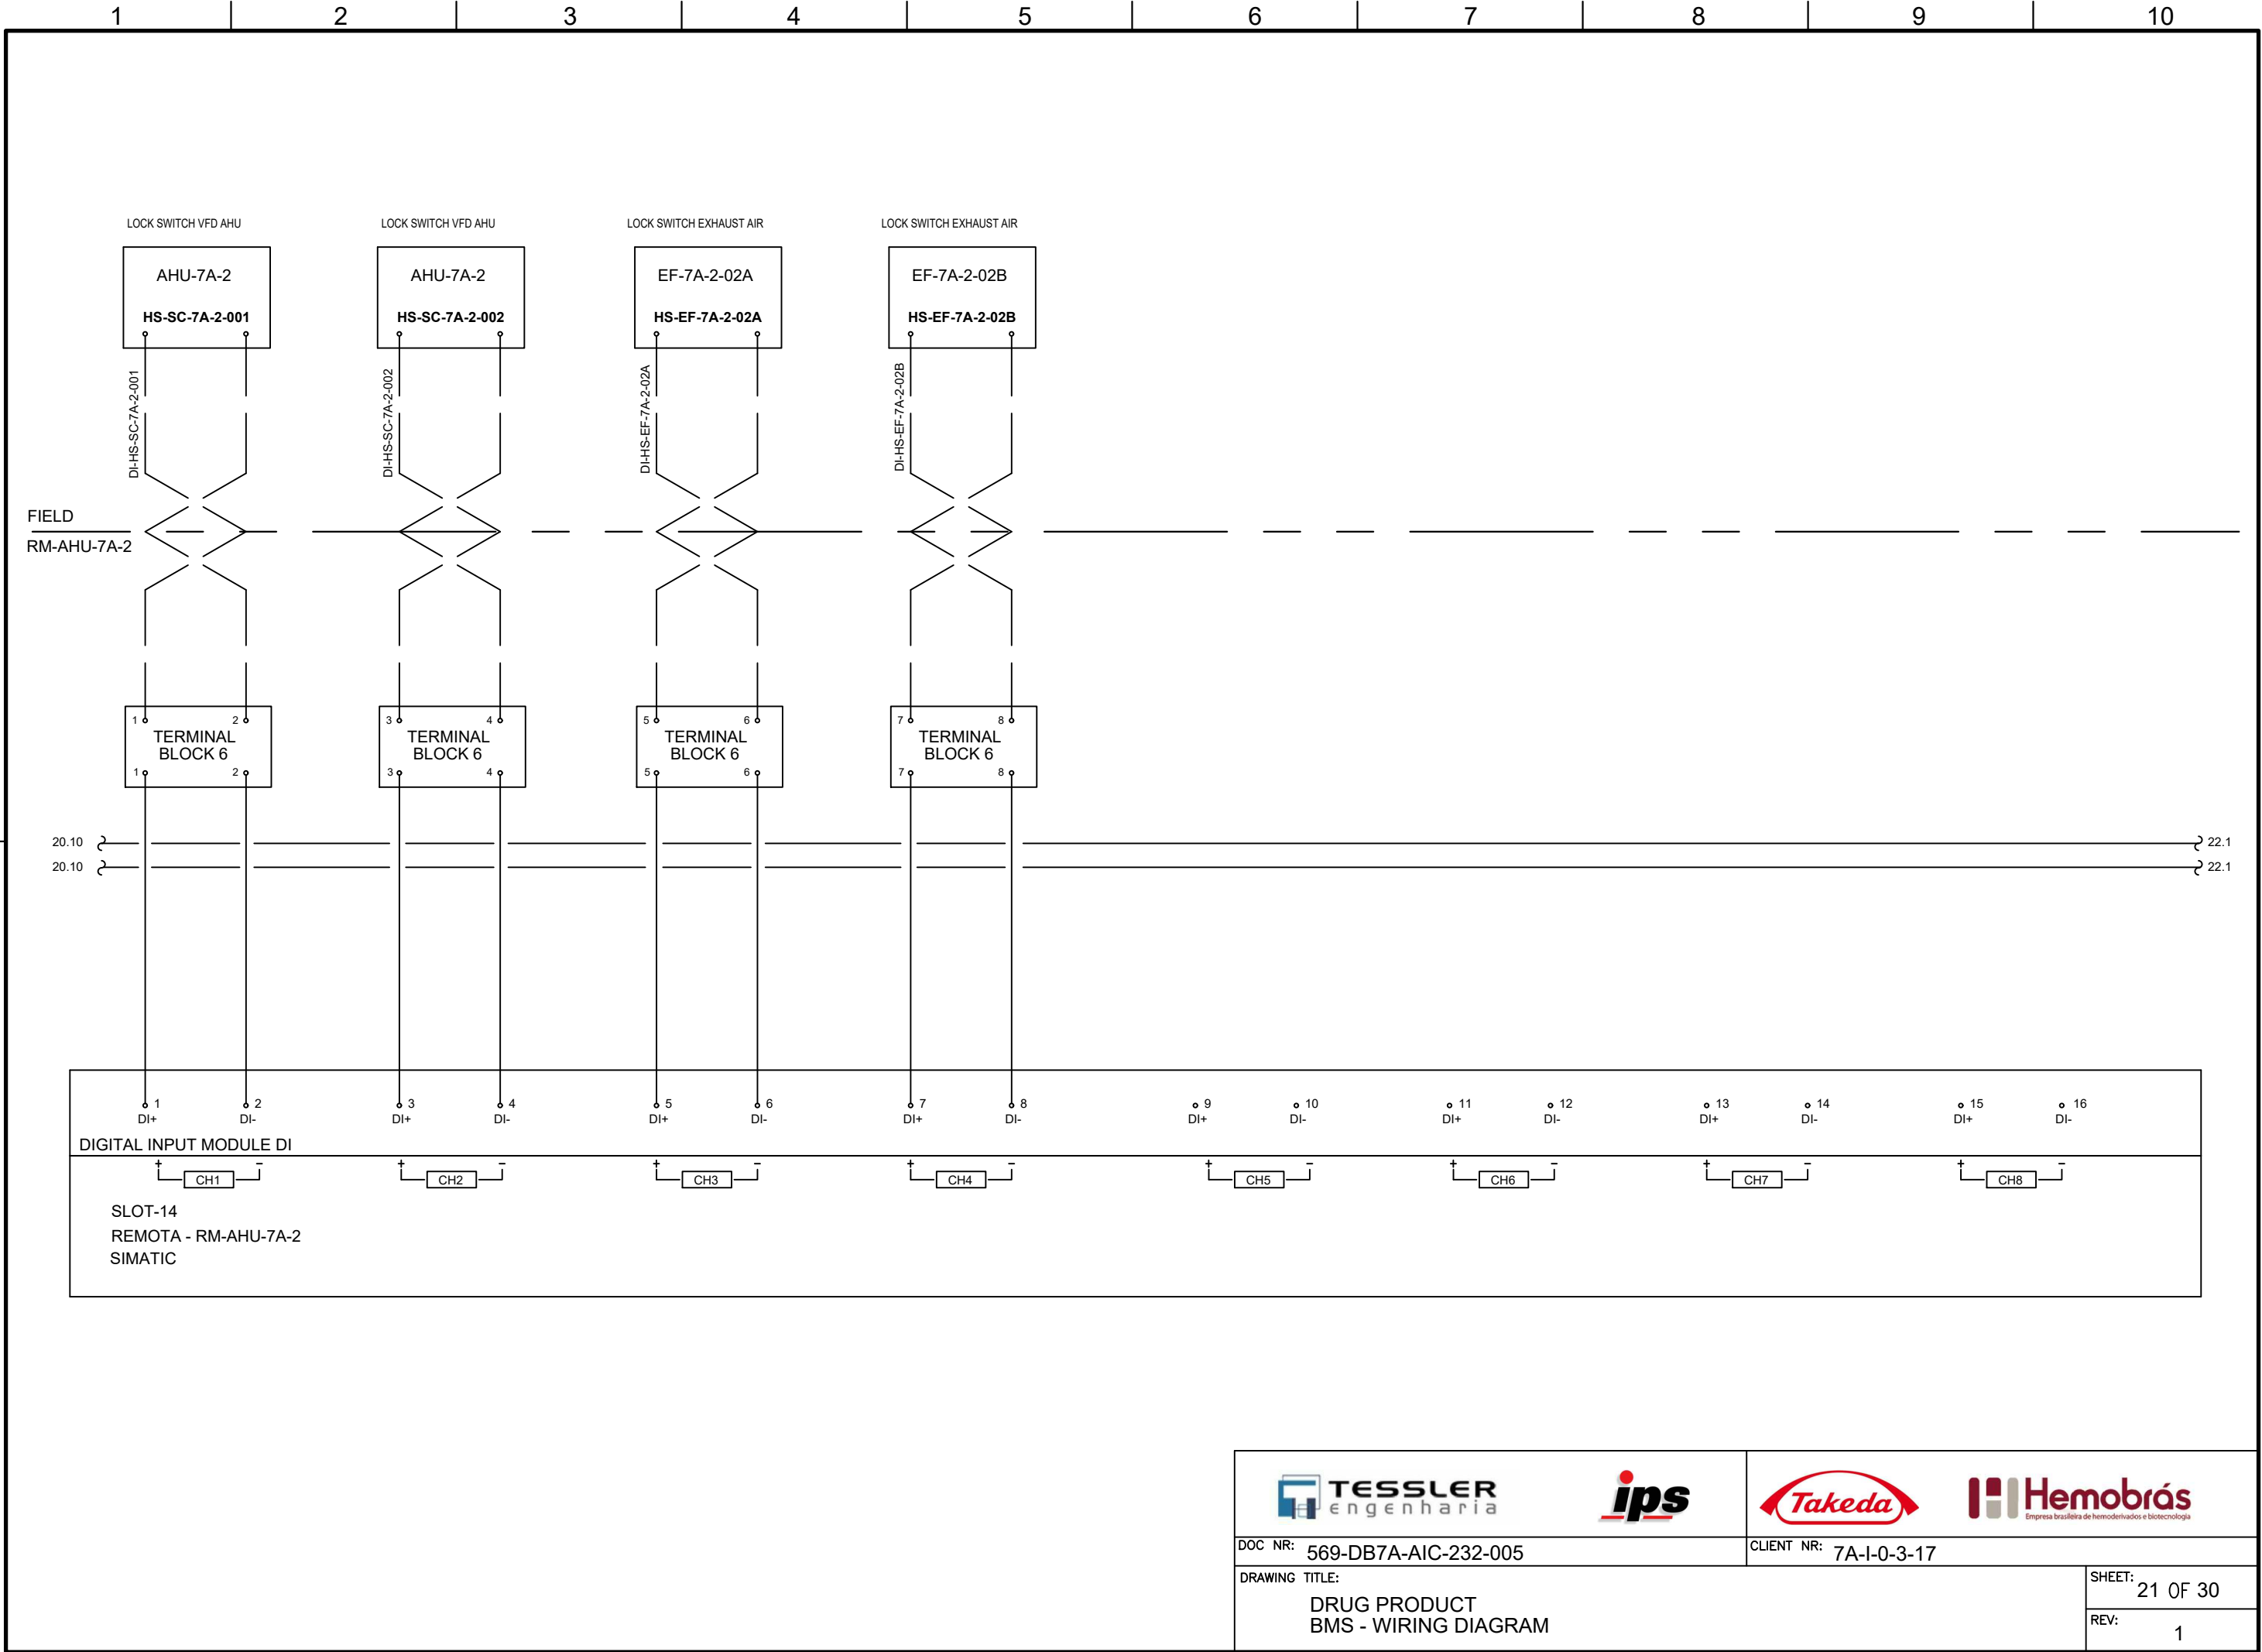

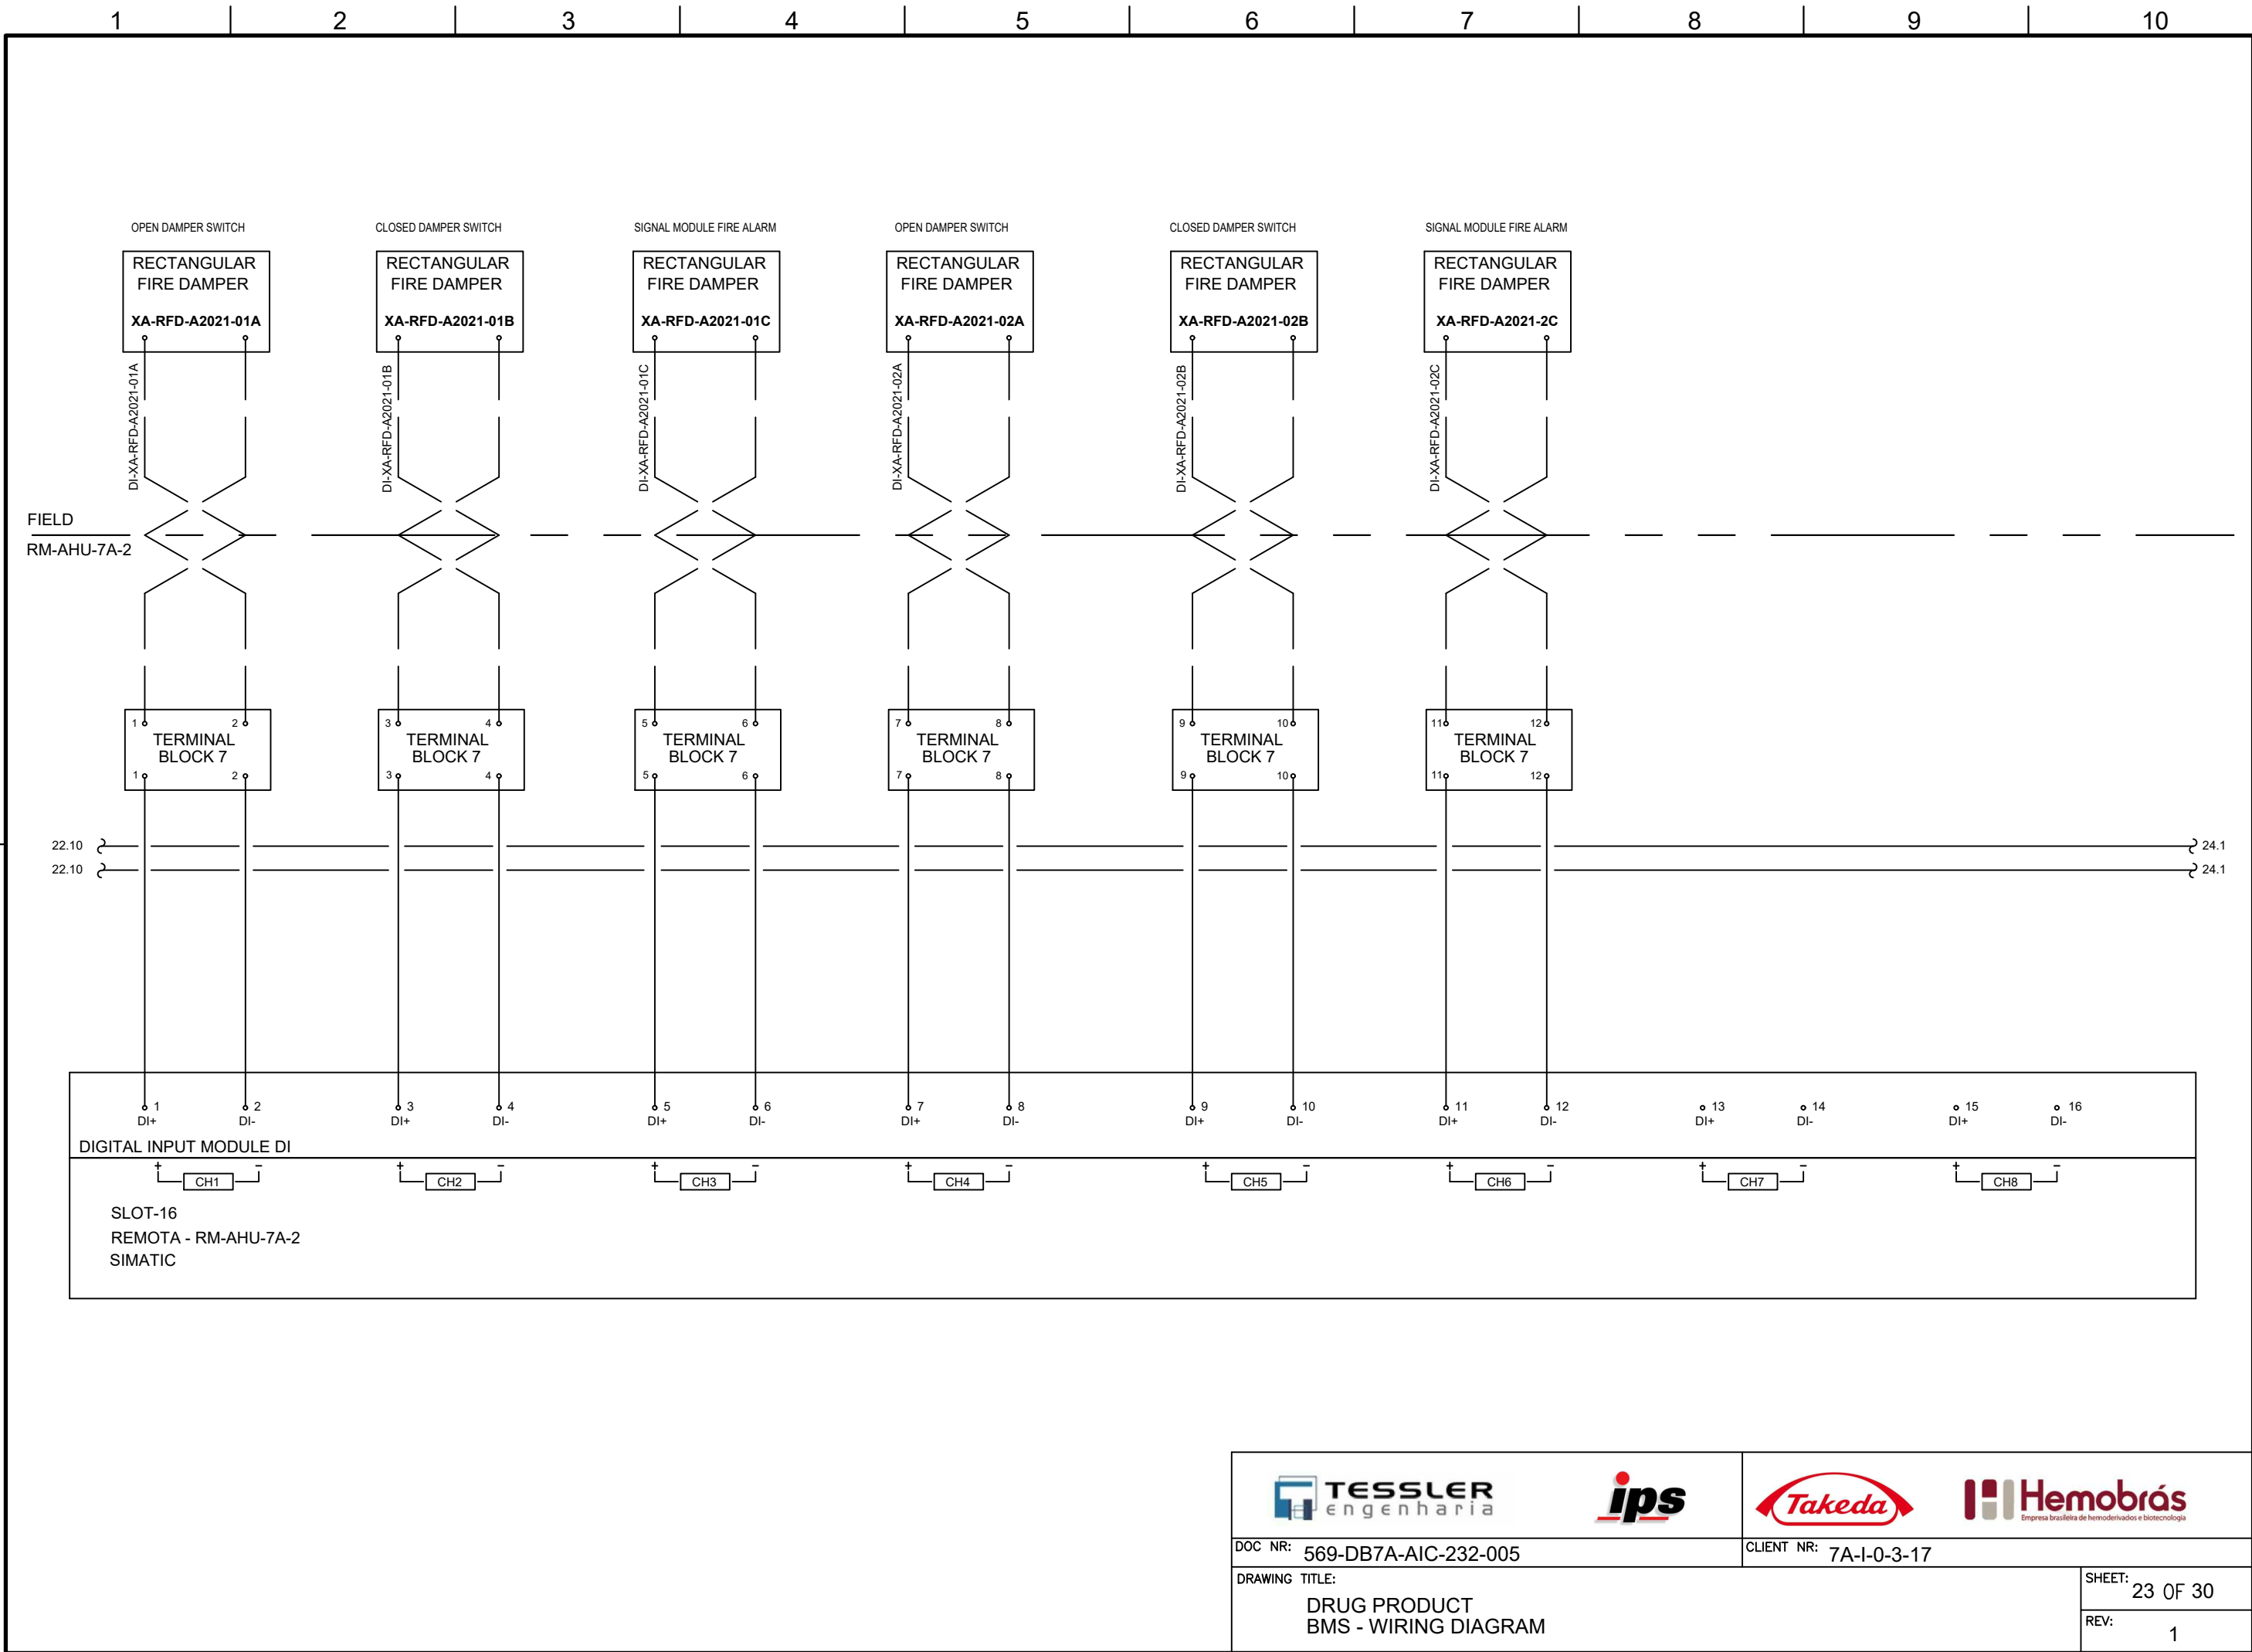

TESSLER

engenharia

ips

Takeda

Hemobrás

Empresa brasileira de hemoderivados e biotecnologia


DOC NR: 569-DB7A-AIC-232-005


CLIENT NR: 7A-I-0-3-17


DRAWING TITLE:
DRUG PRODUCT
BMS - WIRING DIAGRAM


SHEET: 23 OF 30


REV: 1

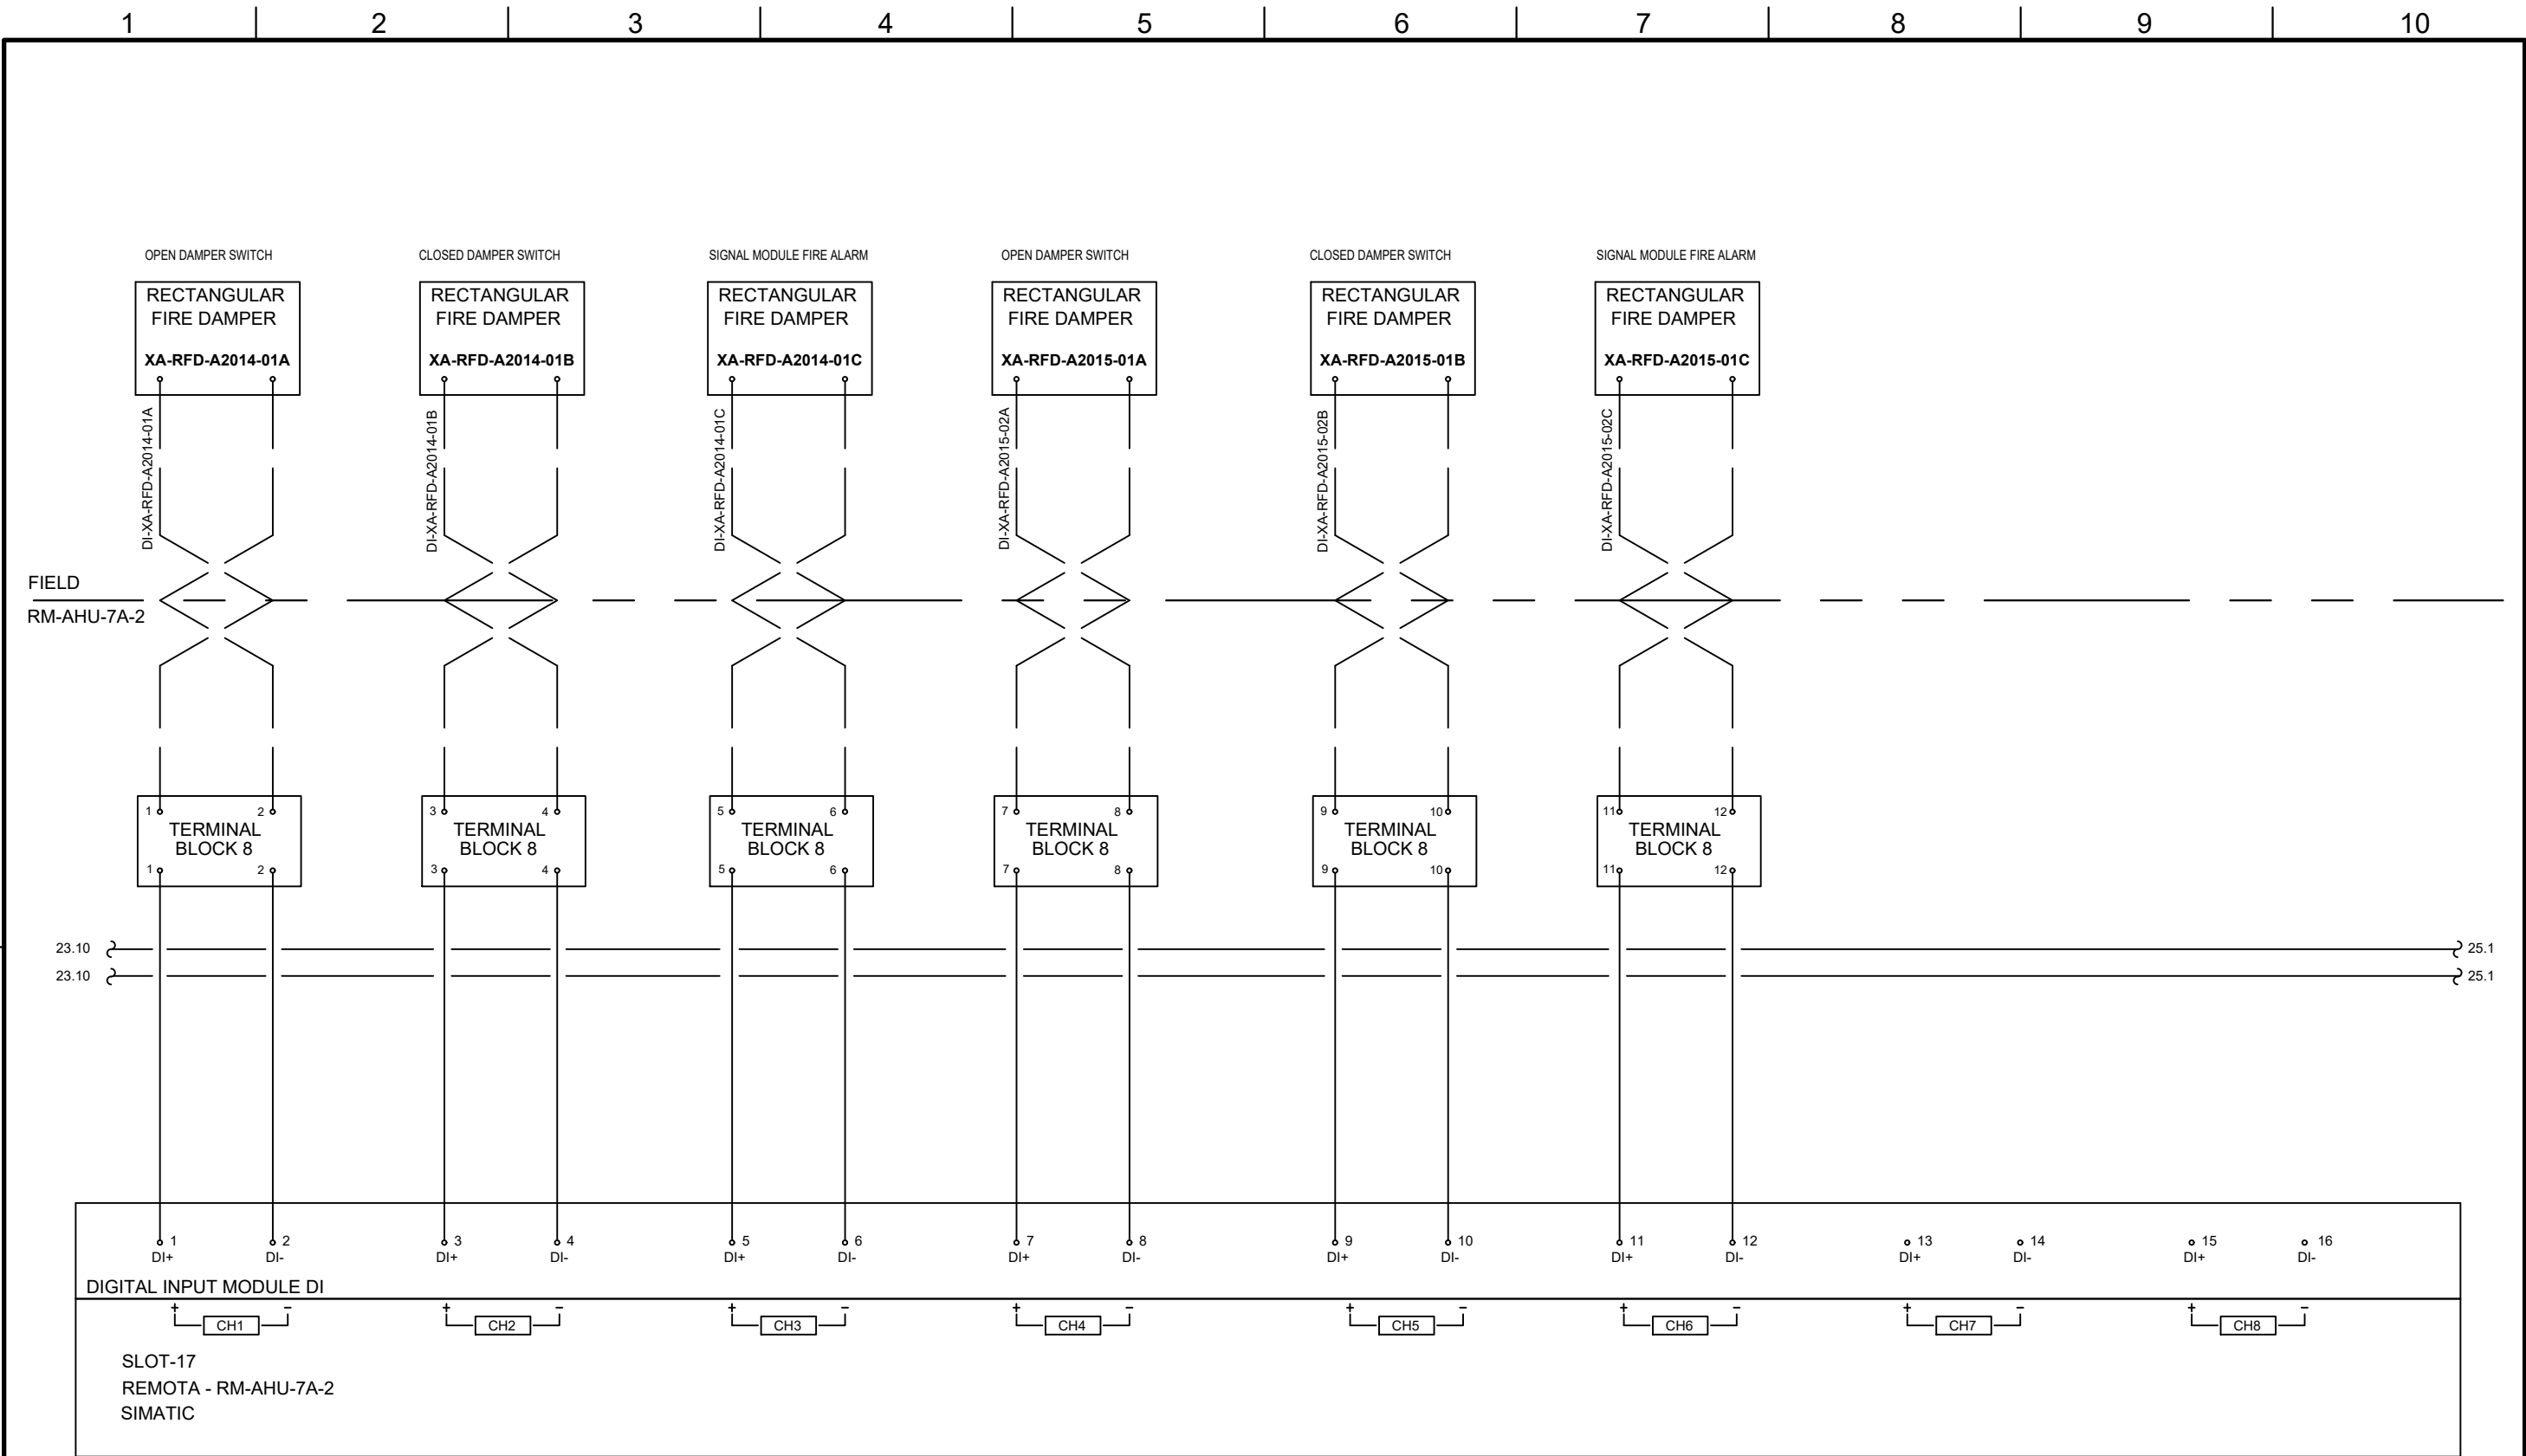

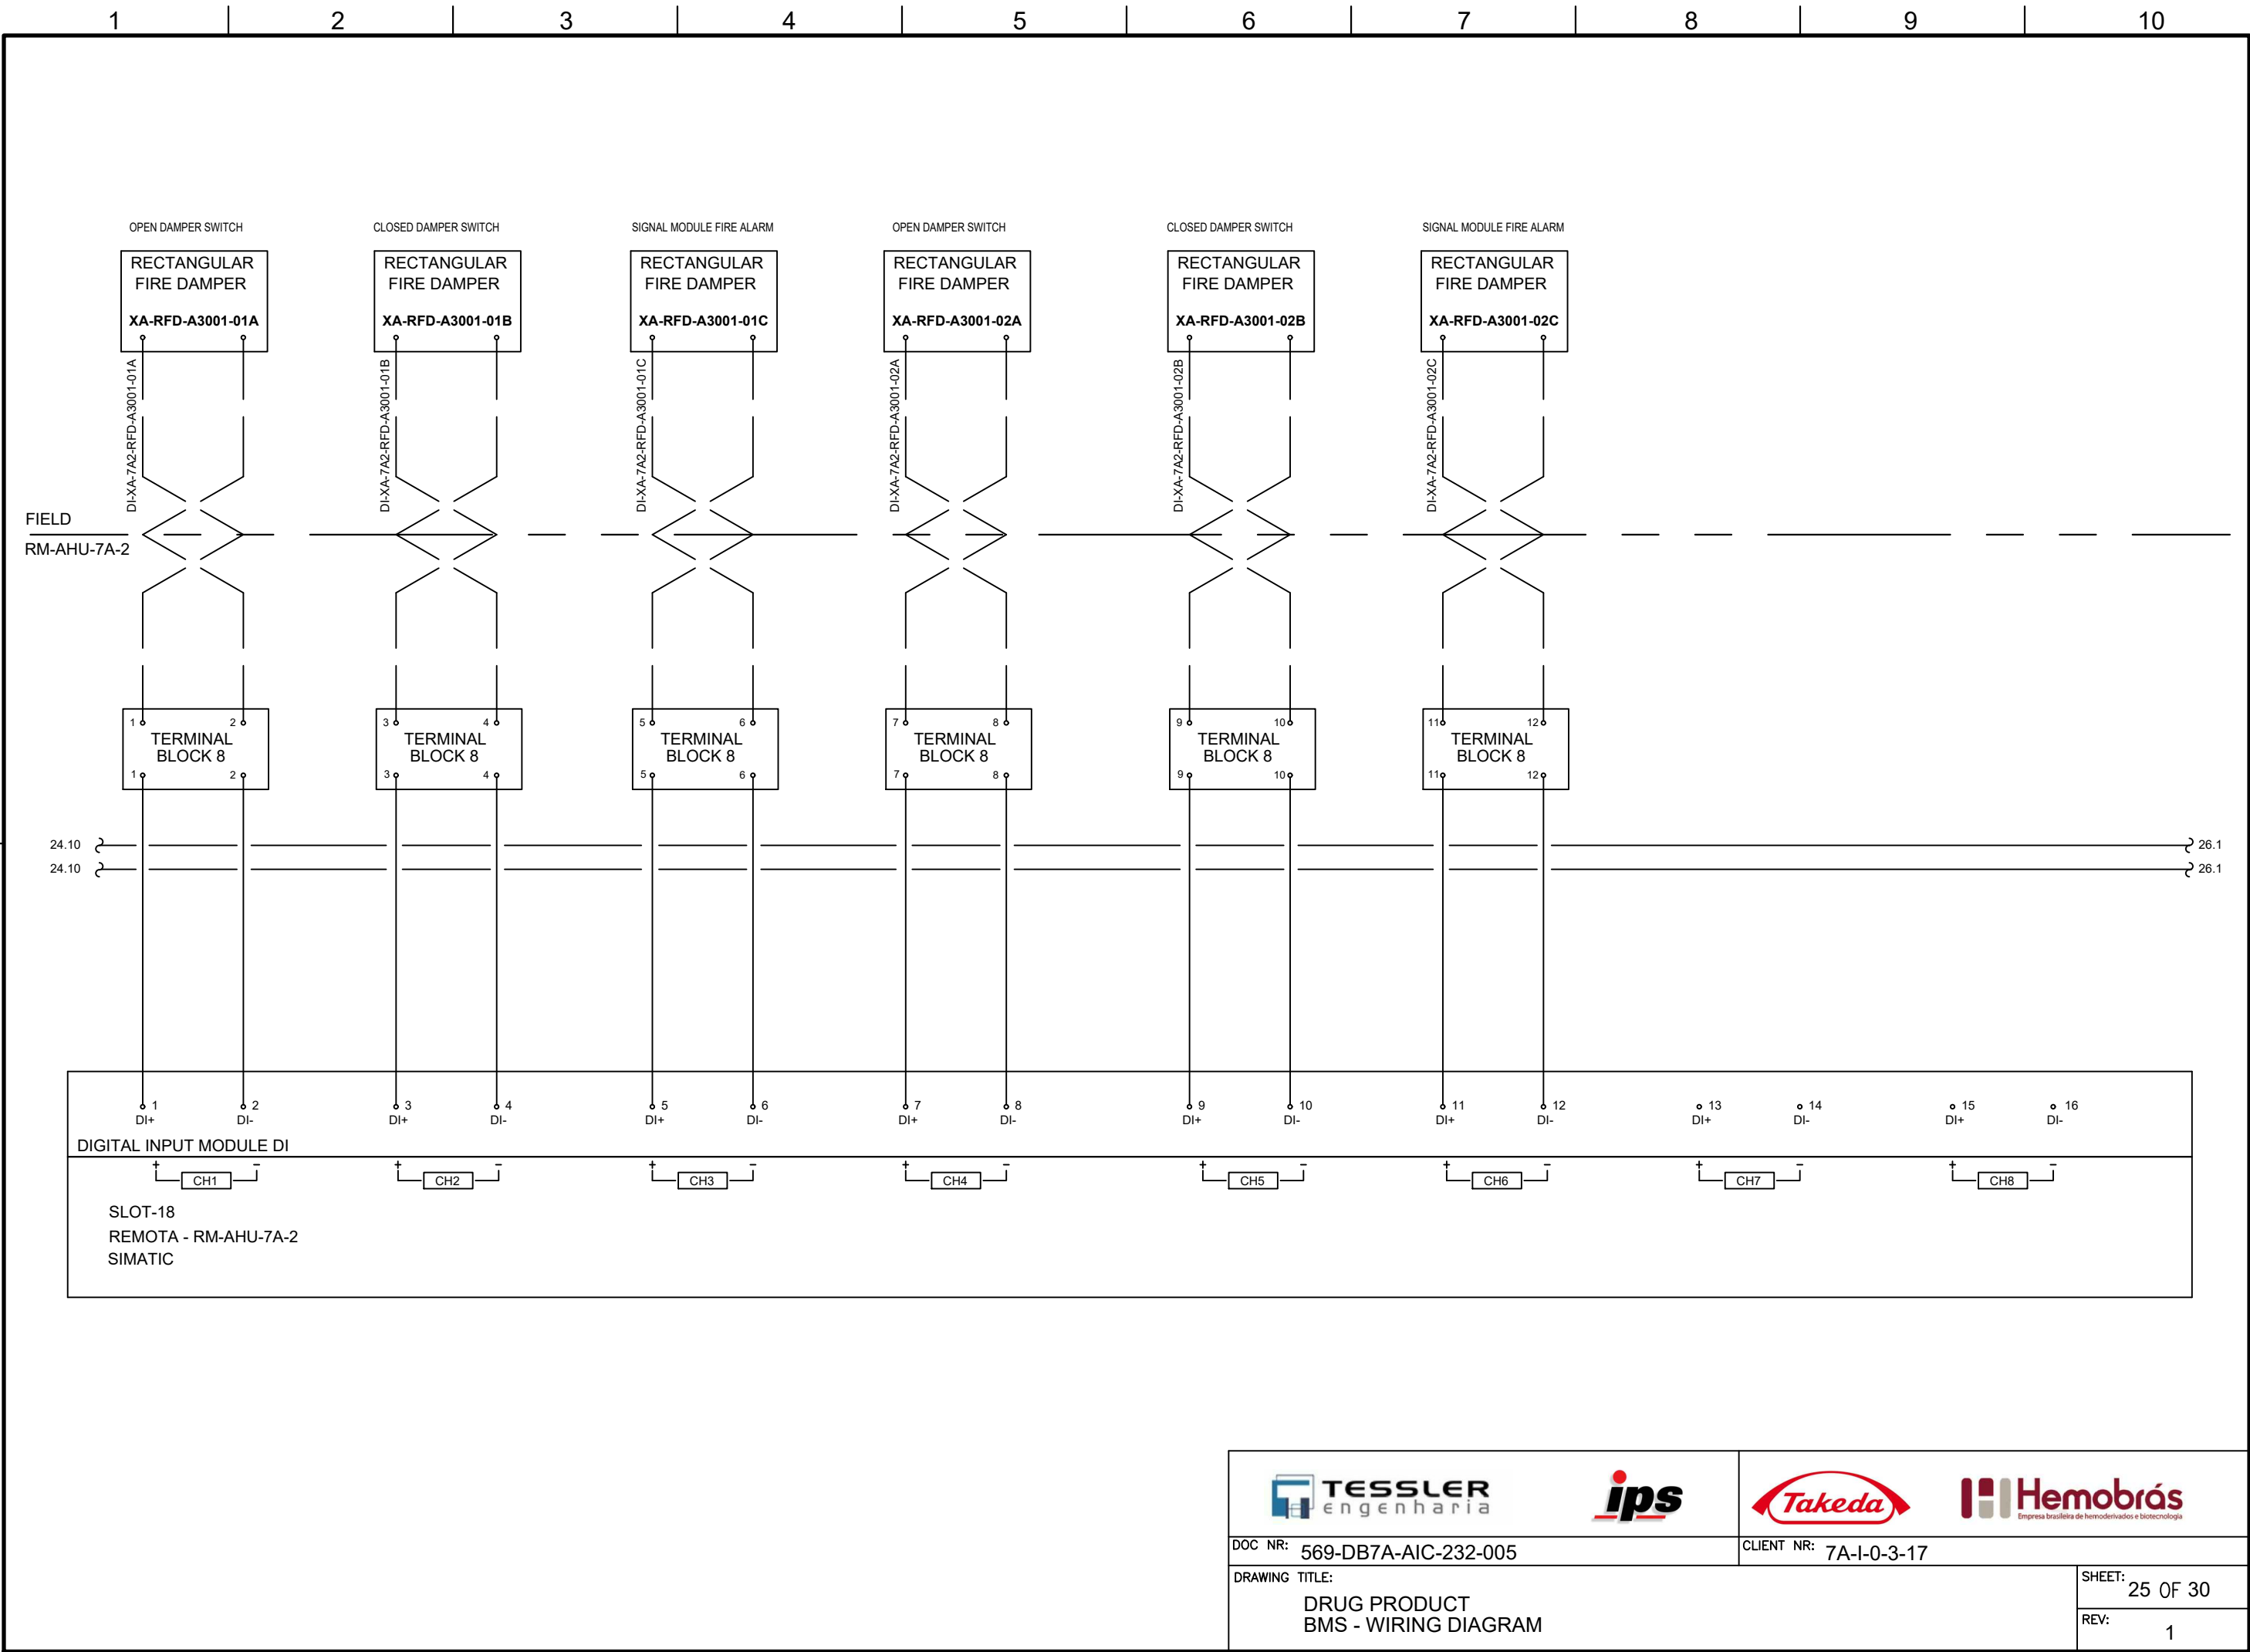

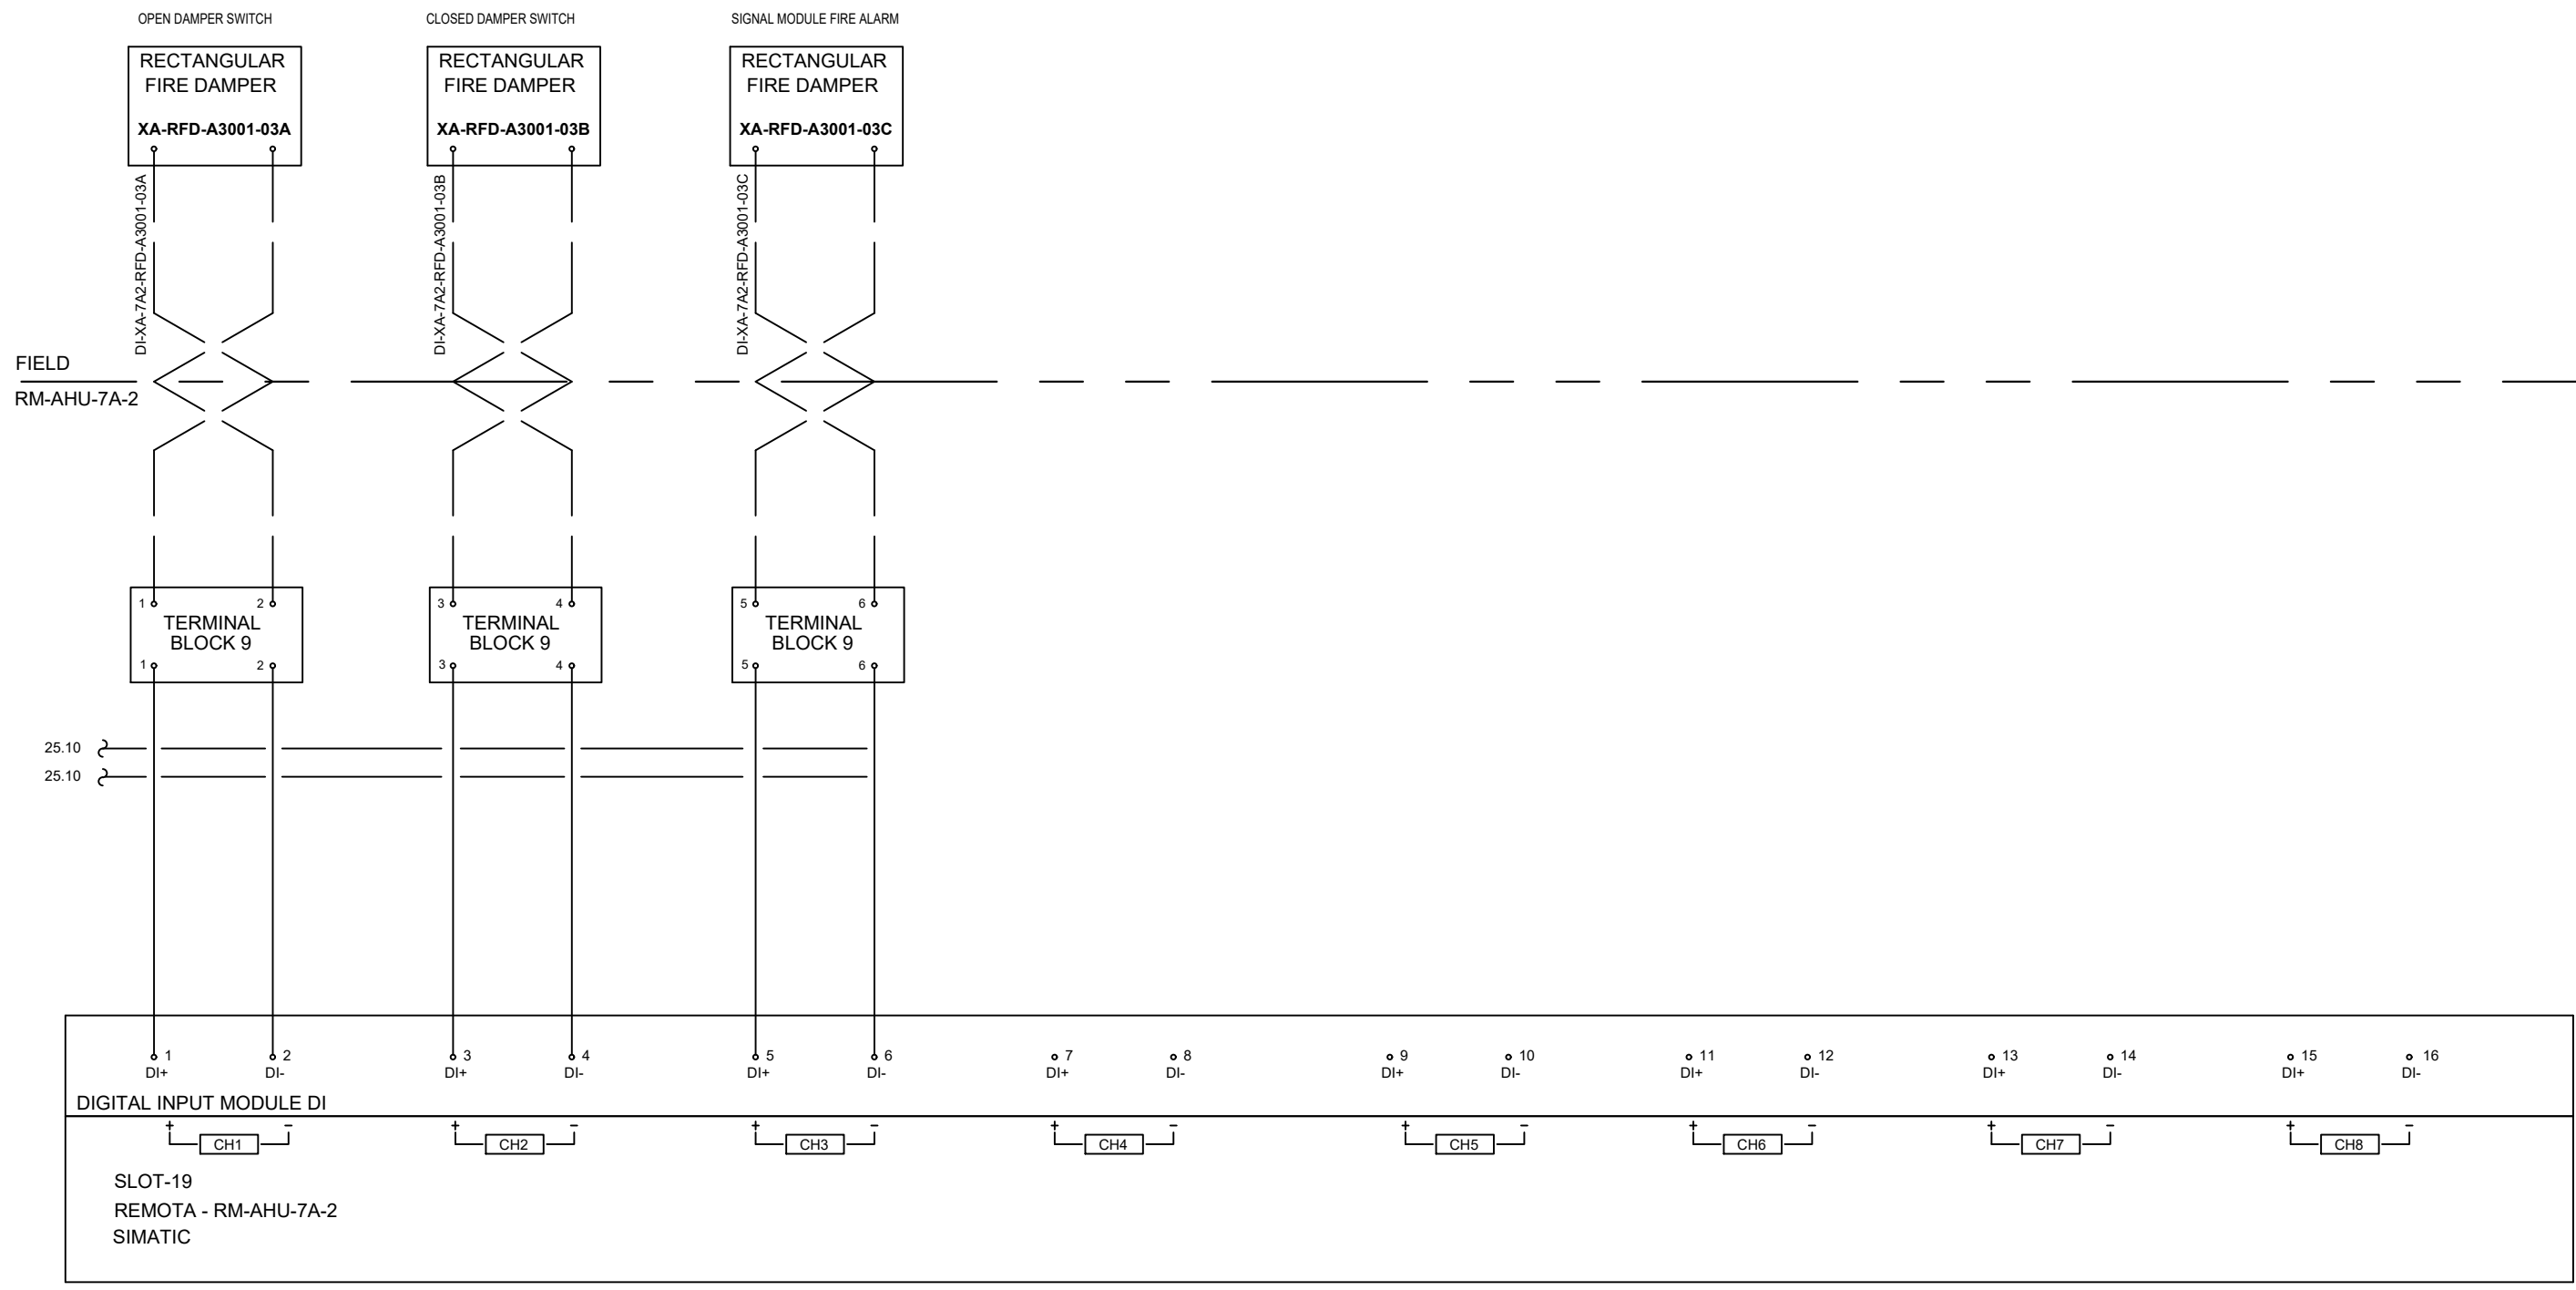

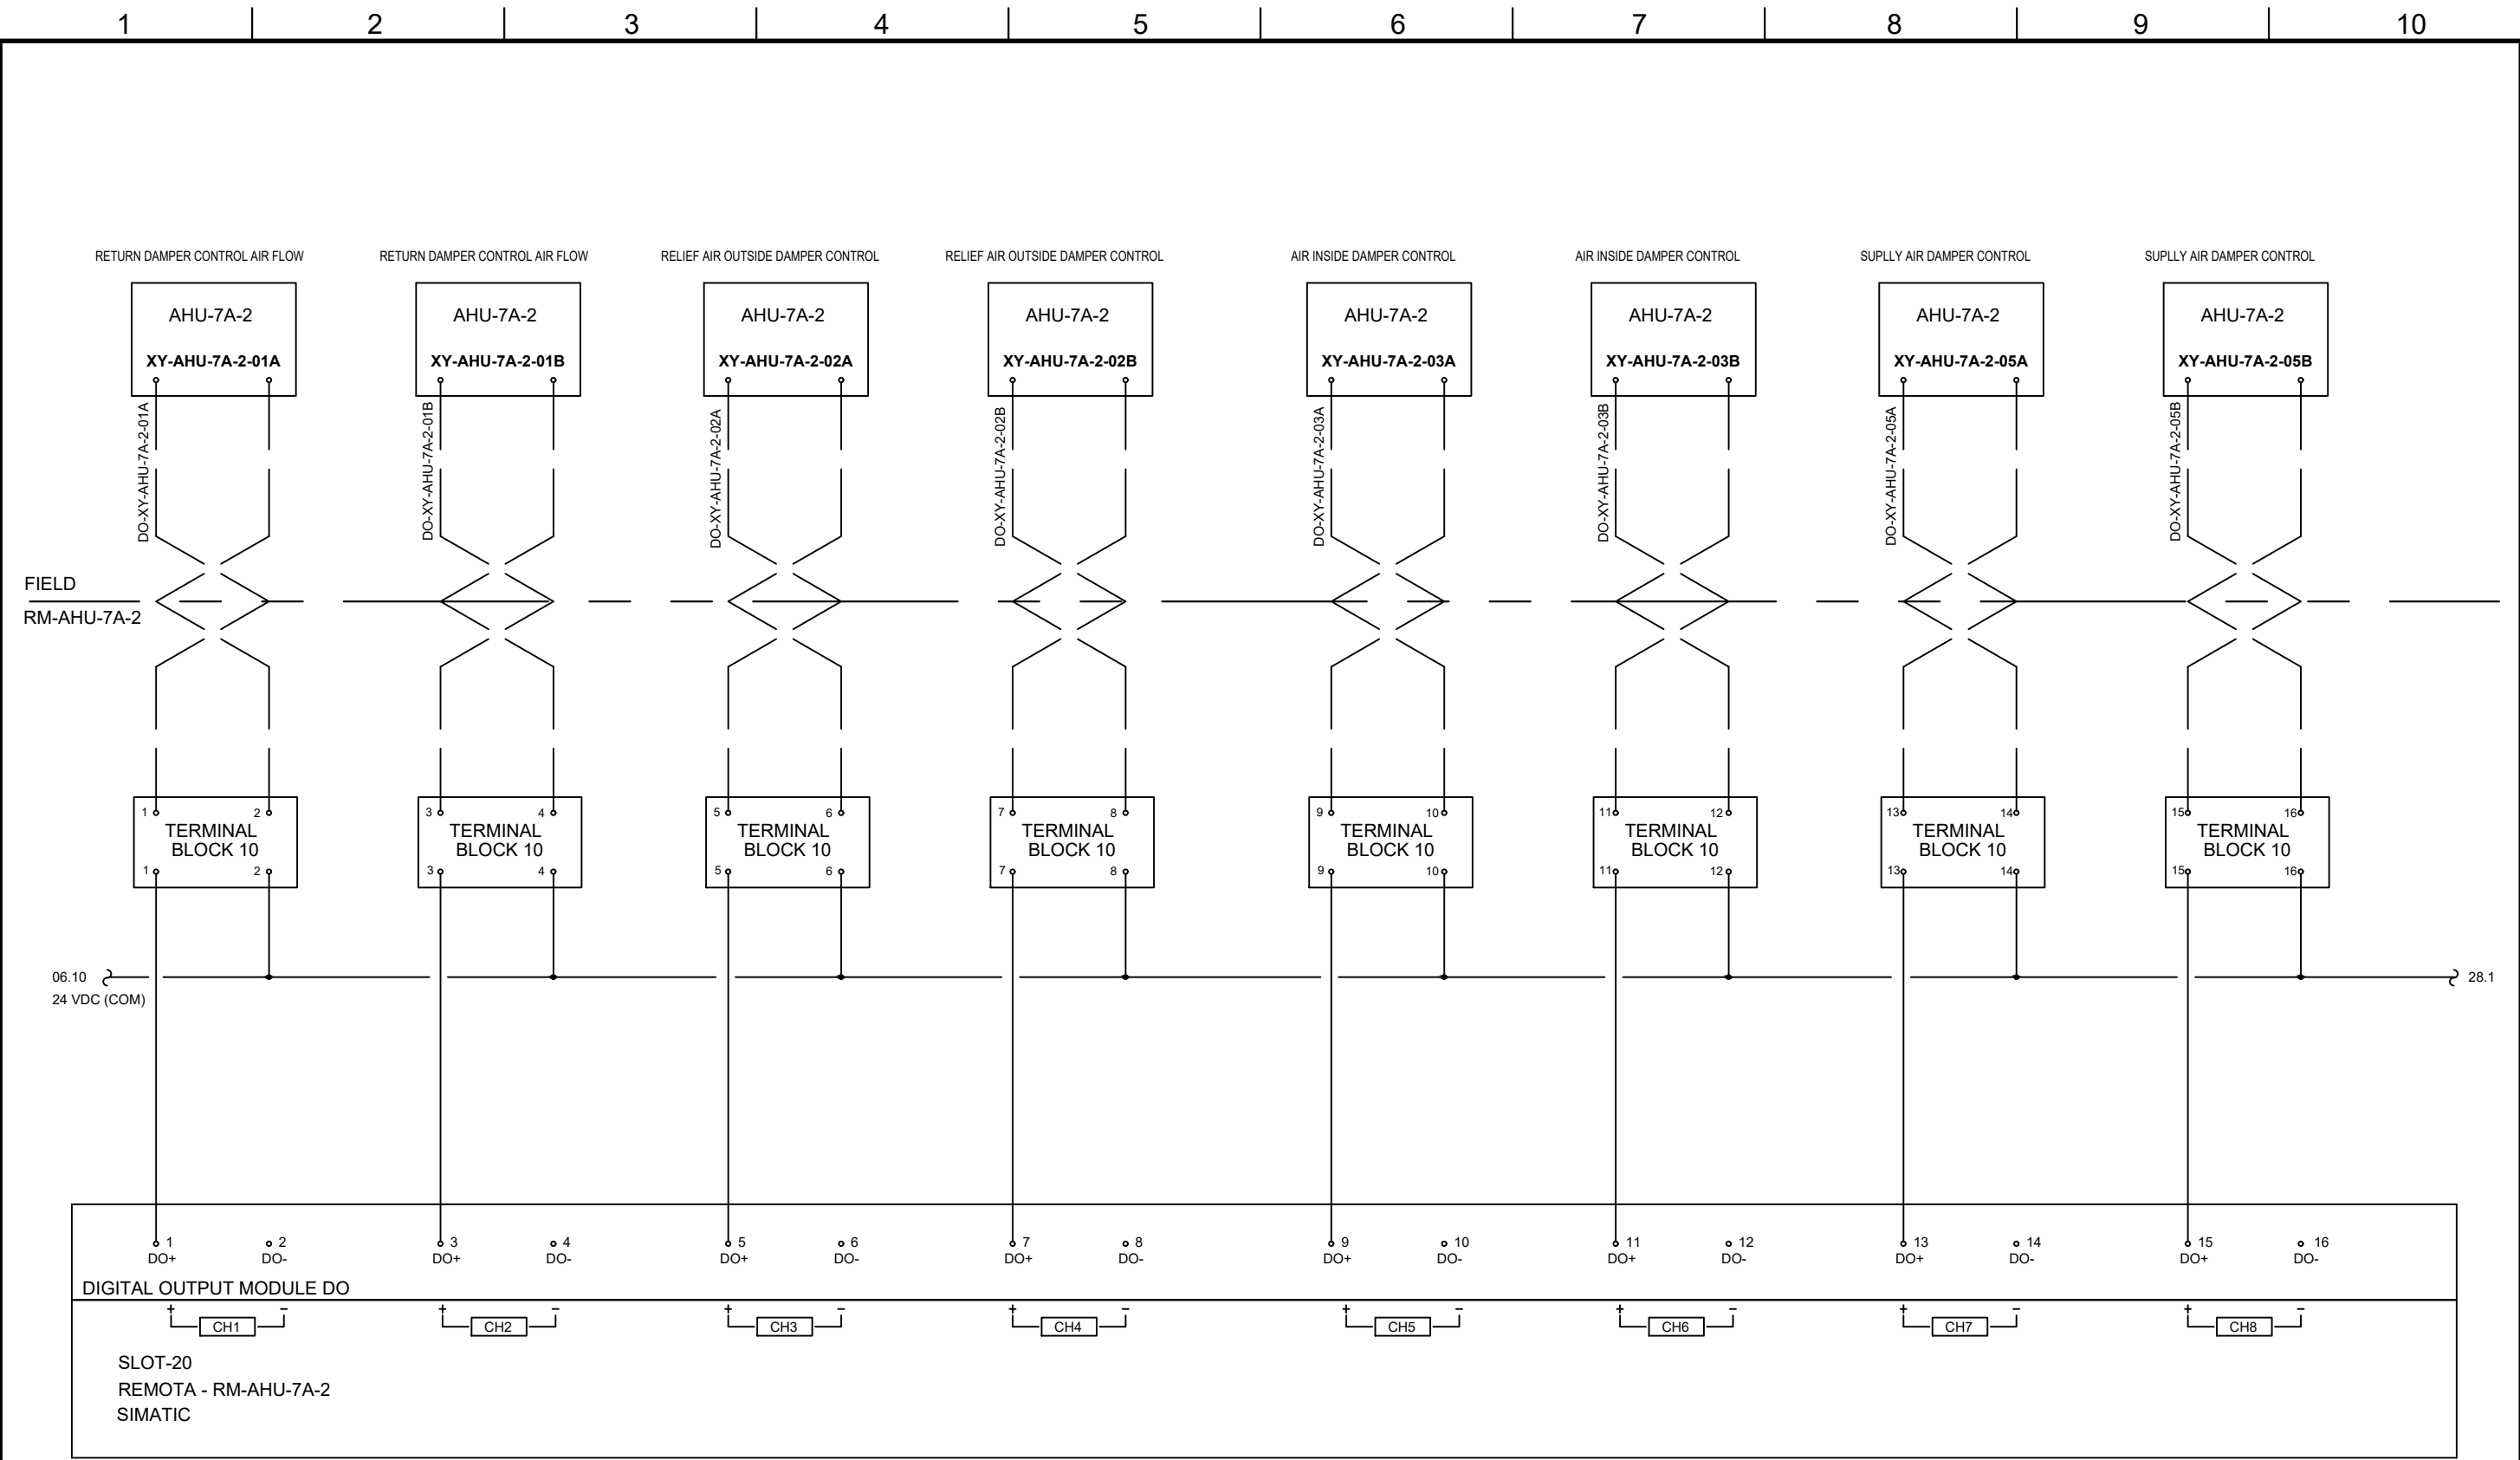

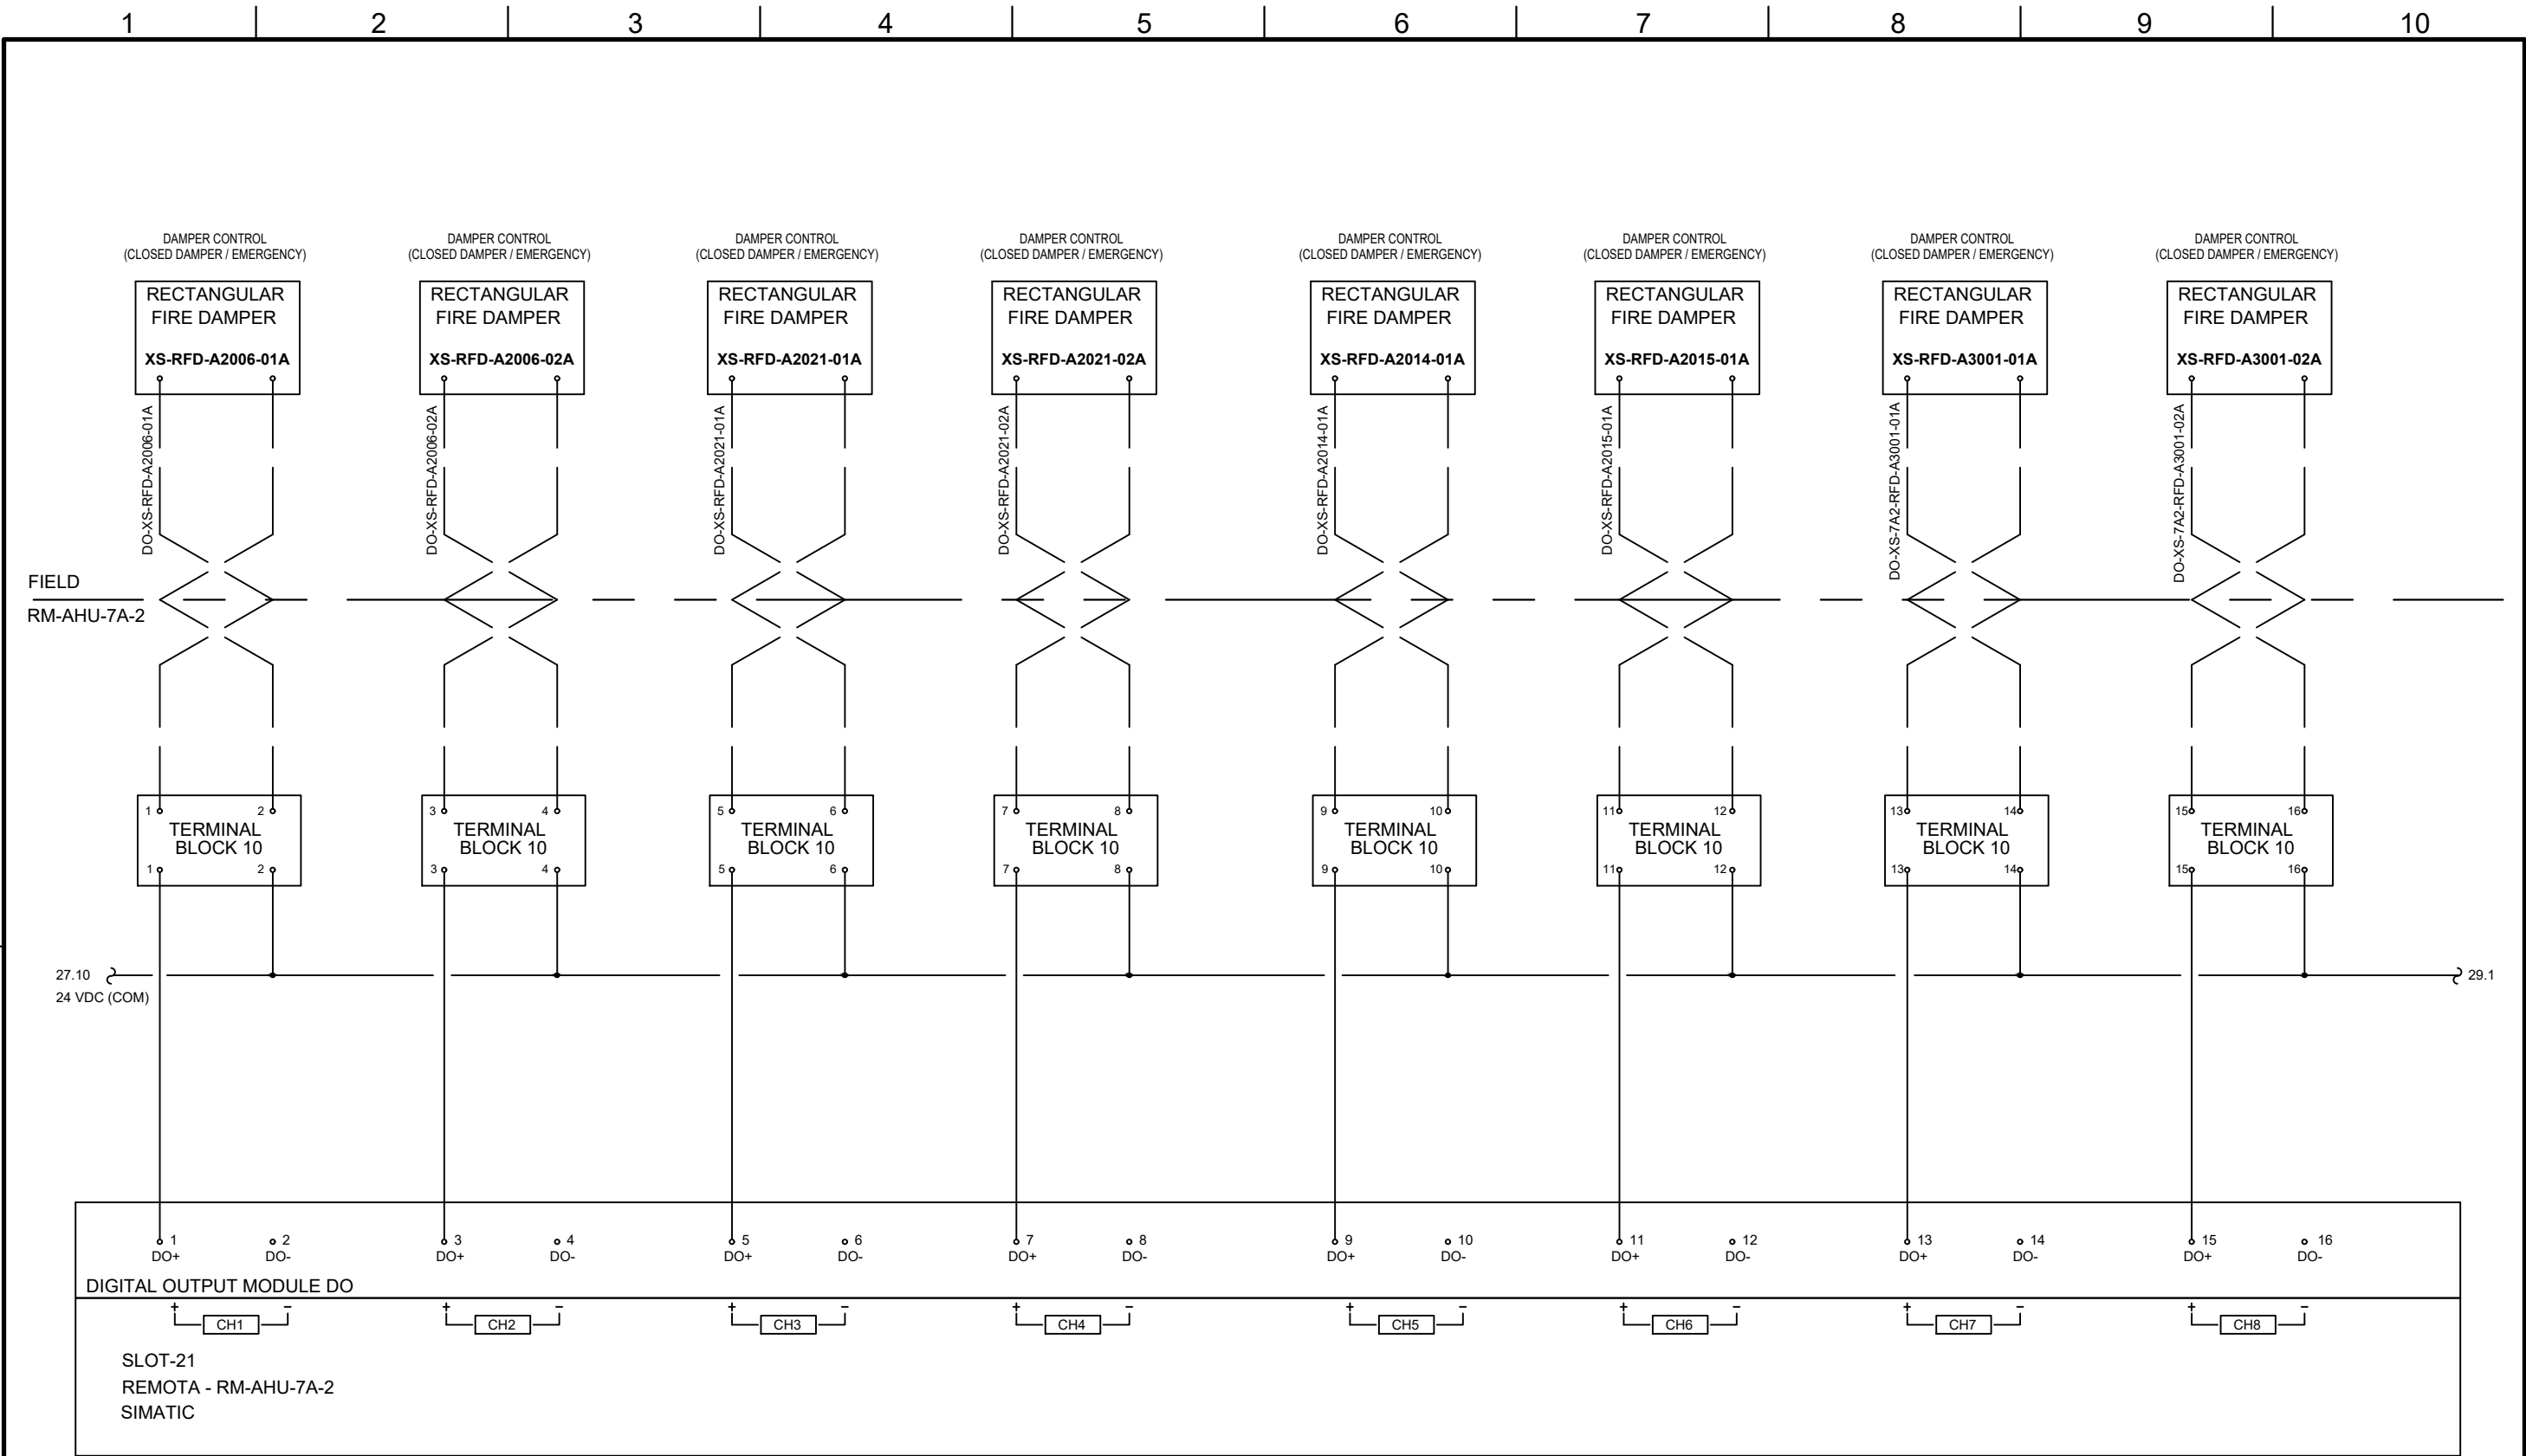

DOC NR: 569-DB7A-AIC-232-005

CLIENT NR: 7A-I-0-3-17

DRAWING TITLE:

DRUG PRODUCT
BMS - WIRING DIAGRAM

SHEET: 28 OF 30

REV: 1

