



Integrated
Project
Services

721 ARBOR WAY, SUITE 100
BLUE BELL,
PENNSYLVANIA 19422
PHONE: 610.828.4090
FAX: 610.828.3656
www.ipsdb.com

IPS Professional Engineers and Architects, PC.




REV	DATE	DESCRIPTION	BY	CHECK	APPR
A	08/03/2020	REV. BD ISSUE	MAV	MAF	MSS
B	16/07/2020	FINAL BD ISSUE	MAV	MAF	MSS
C	03/08/2021	50% DD ISSUE	ACC	MAF	MAJ
D	19/07/2021	100% DD ISSUE	ACC	MAF	RSP
0	19/07/2021	ISSUE FOR CONSTRUCTION	ACC	MAF	RSP
1	18/07/2021	ISSUED FOR CONSTRUCTION CONSIDERING COMMENTS	ACC	MAF	RSP



R. Dr. Cesário Mota Júnior, 424 - Vila Buarque, São Paulo - SP, 01221-020

GENERAL NOTES: / NOTAS GERAIS:

- FOR LEGEND, ABBREVIATIONS AND SYMBOL, SEE SHEETS 7B-I-2-3-01.
- FOR FIRE ALARM RIBER DIAGRAM SEE SHEET 7B-I-2-3-02.
- ALL INDICATION DEVICES ARE 75 CANDELAS UNLESS OTHERWISE NOTED.
- ALL NOTIFICATION DEVICES ARE MOUNTED AT 2400 MM.
- ALL MANUAL PULL STATIONS ARE MOUNTED AT 1400 MM.
- ALL DETECTING DEVICES ARE MOUNTED IN THE CEILING.
- FACP AND FBAT ARE MOUNTED AT 1200 MM.
- SUPPORTS TO CABLE TRAYS AND CONDUITS SHALL BE PROVIDED TO EACH 2.00 METERS.
- ALL FIRE ALARM CONDUITS SHALL BE IDENTIFY RINGS EACH 3m IN RED COLOR. EACH CONDUIT MUST HAVE ONE IDENTIFY.
- ALL TELECOMMUNICATION ETHERNET CABLES BY OWNER'S TELECOMMUNICATION CONTRACTOR.
- ALL DIMENSIONS SHALL BE IN MILLIMETERS UNLESS NOTED OTHERWISE.
- FOR FA DESIGN BASIS SEE DOCUMENT PRD-AC-TSP-010.
- SYMBOL RAM IN RED BELONGS TO THE FIRE DAMPER (HVAC). THE BLUE RAM SYMBOL BELONGS TO THE EMERGENCY DOOR (ACS).
- A RAM SYMBOL IN RED BELONGS TO THE EMERGENCY DOOR (HVAC). E O SIMBOLO RAM AZUL PERTENCE A PORTA DE EMERGENCIA (ACS).

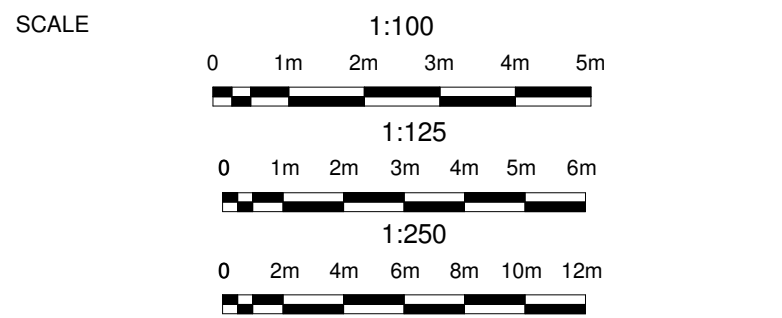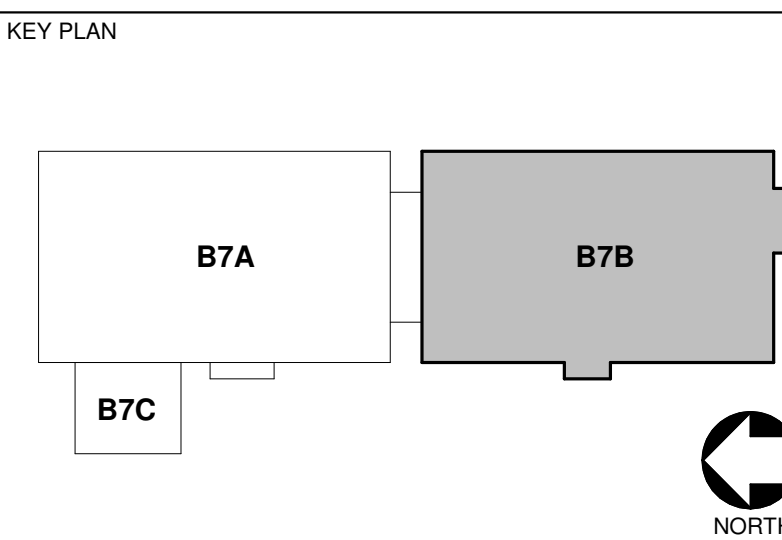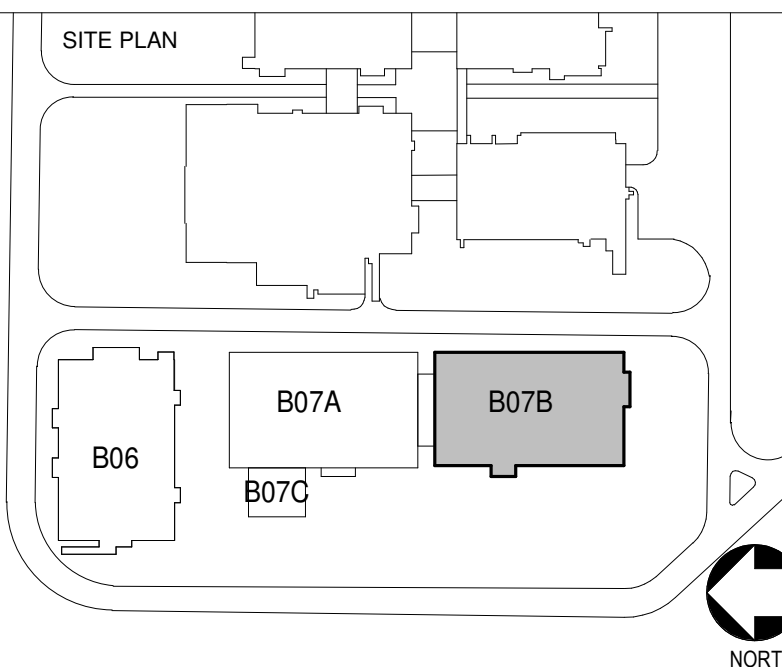

CONFIDENTIAL

THE INFORMATION CONTAINED HEREIN MAY NOT BE USED OR REPRODUCED IN ANY MANNER WITHOUT WRITTEN PERMISSION OF INTEGRATED PROJECT SERVICES.




DRUG SUBSTANCE FIRE ALARM SYSTEMS FIRST FLOOR

ENGINEER	ARCHITECT	DESIGNER	IPS PROJECT #
MAF	BJE	FJT	ITD19439.01
DRAWN BY	REVIEWED BY	SCALE	CADD FILE NAME
JHA	MSS	AS NOTED	

XREF FILE(S)	DRAWING NUMBER
--------------	----------------

7B-I-2-3-23

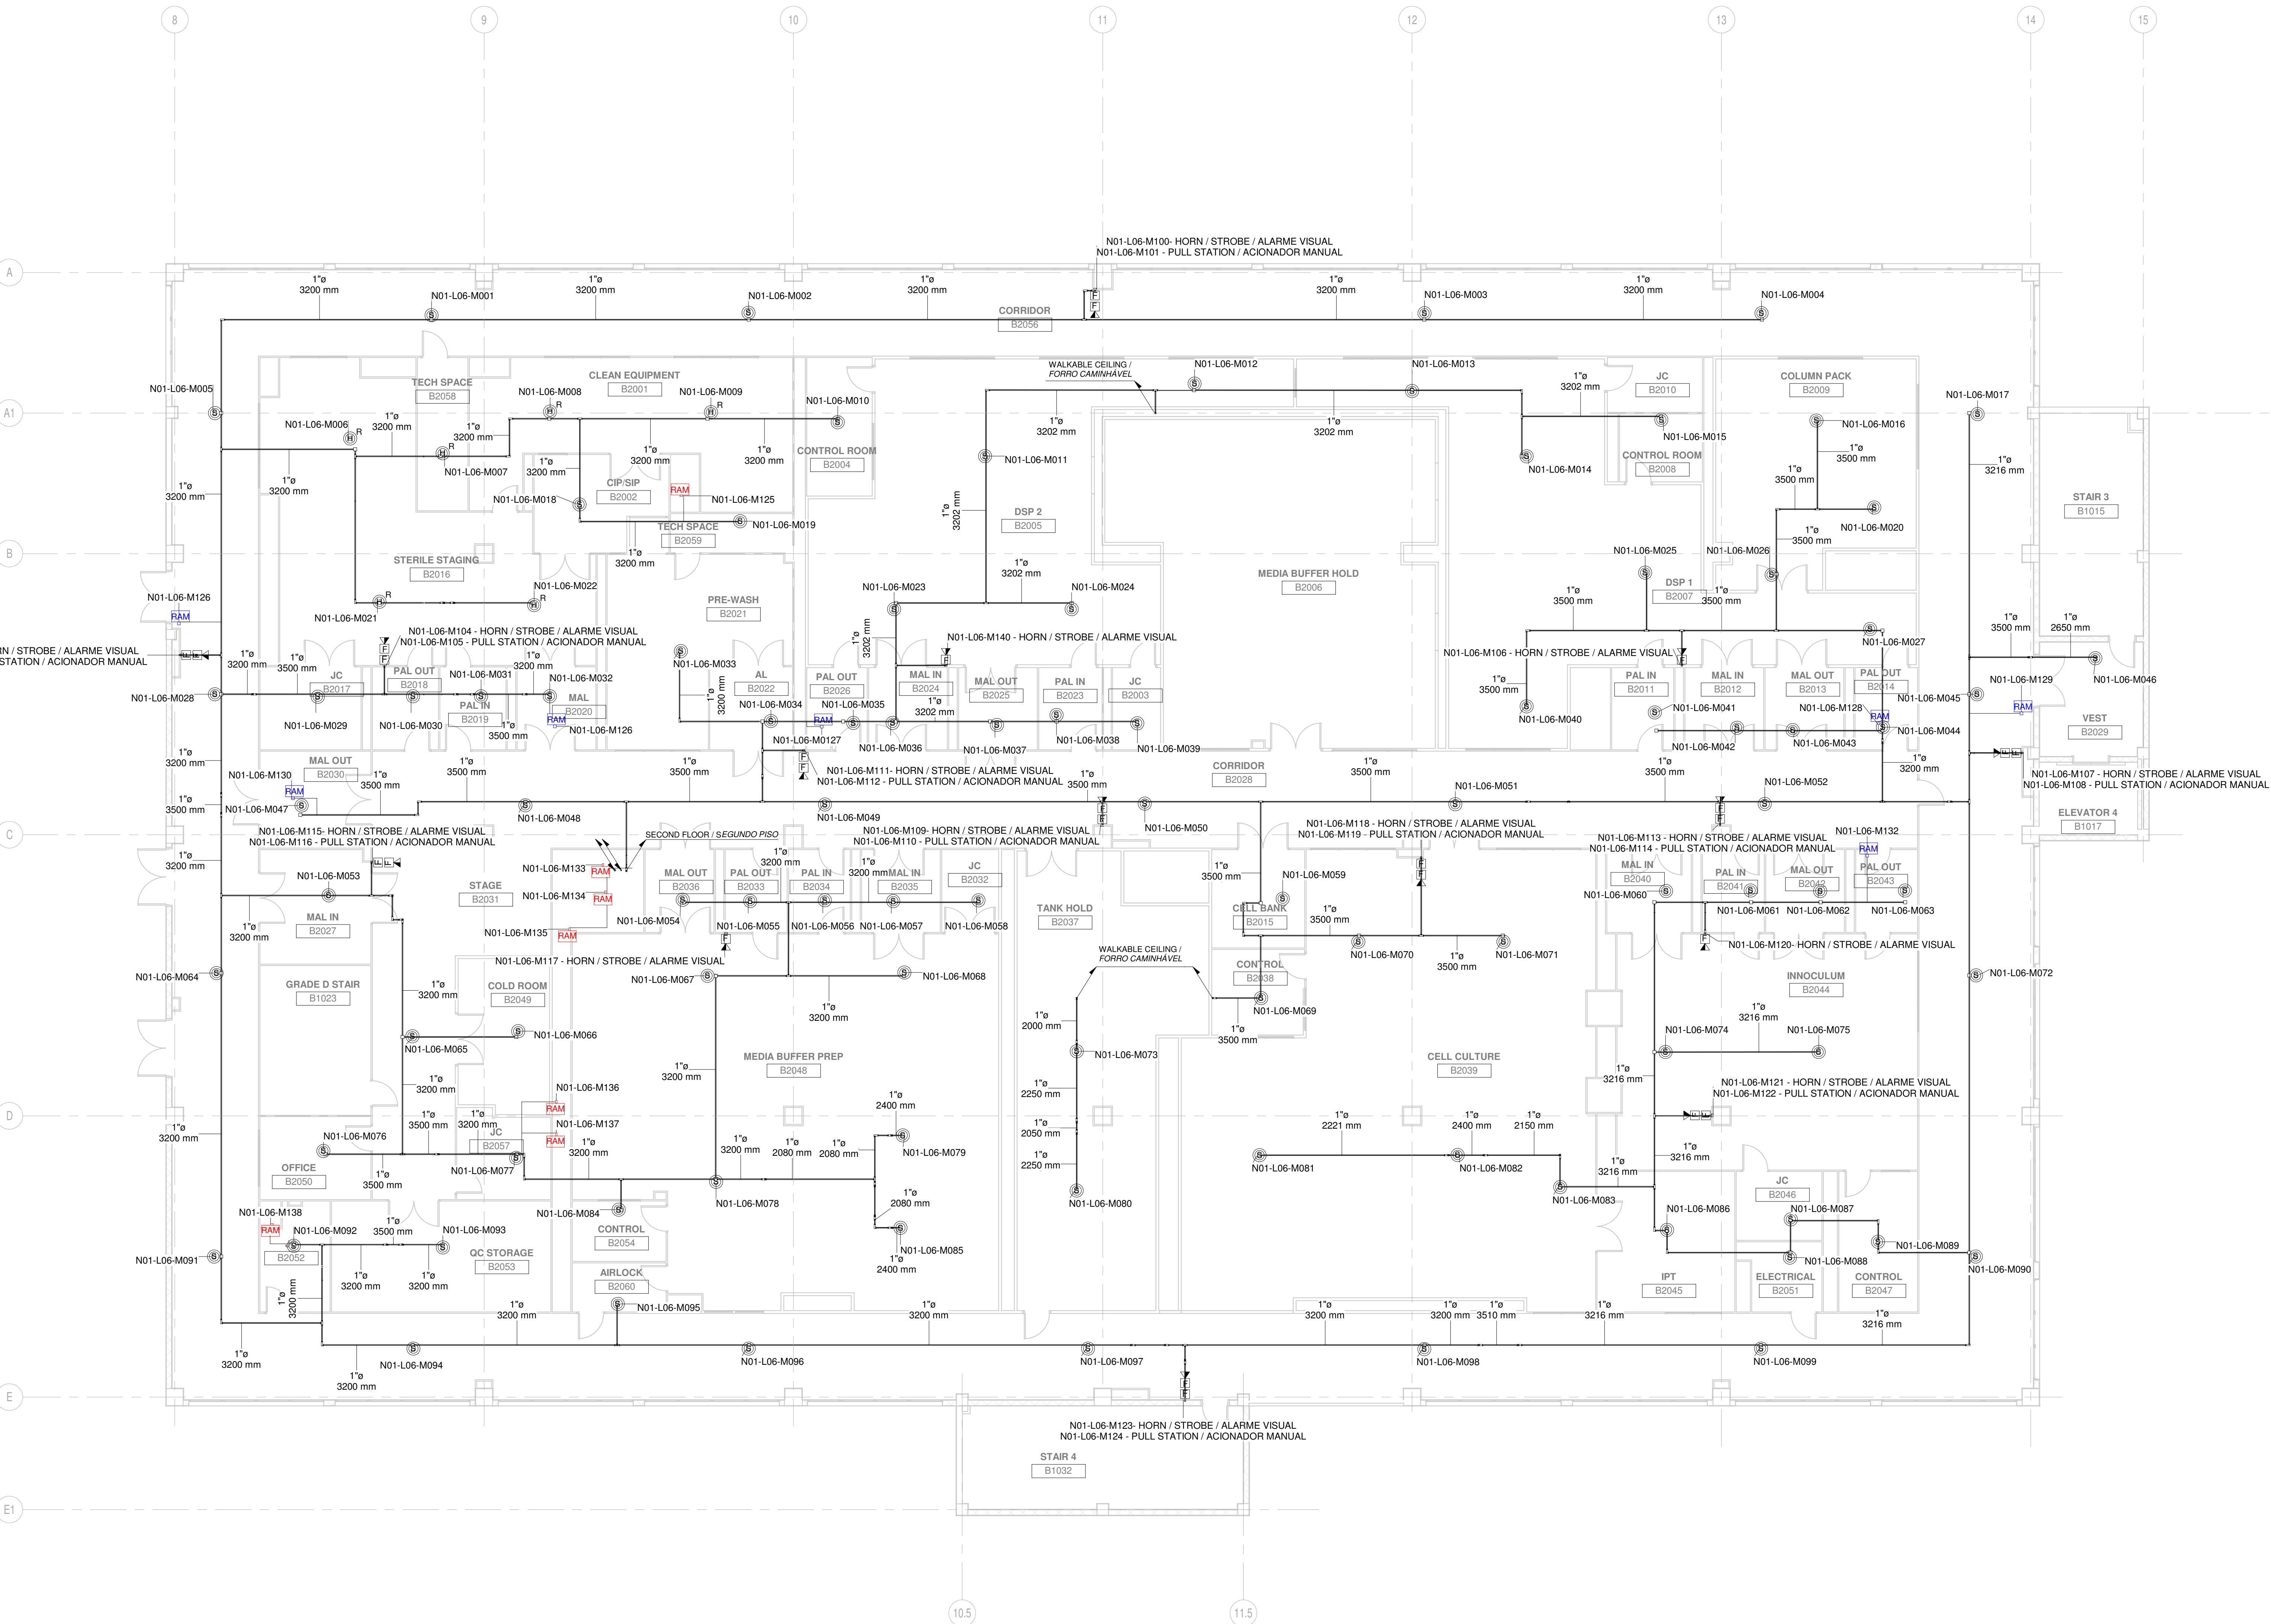

1 DRUG SUBSTANCE - FIRE ALARM FIRST FLOOR

7B-I-2-3-23 SCALE: 1:100