

1 DRUG SUBSTANCE - FIRE ALARM SYSTEM WALKABLE CEILING
7B-I-0-3-03 SCALE: 1:100

REVISION D NOTES / NOTAS REVISÃO D

 ADDED SMOKE DETECTORS TO THE SLAB SURFACES.
 ADICIONADO DETECTORES DE FUMAÇA A SUPERFÍCIES DA

REVISION 0 NOTES / NOTAS REVISÃO 0

ADDED B07-NCA-01.

ADDED B07-NCA-01.
 ADICIONADO B07-NCA-01

RELOCATED B07-FACP-01.
 RELOCADO B07-FACP-01

REVISION 1 NOTES / NOTAS REVISÃO 1

TRANSLATED TO PORTUGUESE.
 TRADUZIDO PARA O PORTUGUÊS.

Integrated Project Control of the Co

Project
Services
Engineering Design/Build Compliance Consulting

Project
Services

Fax: 610.828.3656 www.ipsdb.com

IPS Professional Engineers and Architects, PC.

 REV
 DATE
 DESCRIPTION
 BY
 CHECK
 APPR

 A
 28AUG2020
 90% BD ISSUE
 MAV
 MAF
 MSS

 B
 16OCT2020
 FINAL BD ISSUE
 MAV
 MAF
 MSS

 C
 05MAR2021
 30% DD ISSUE
 ACC
 MAF
 MAJ

 D
 06OCT2021
 90% DD ISSUE
 ACC
 MAF
 RSP

 0
 19OCT2021
 ISSUE FOR CONSTRUCTION
 ACC
 MAF
 RSP

 1
 16NOV2021
 ISSUED FOR CONSTRUCTION CONSIDERING COMMENTS
 ACC
 MAF
 RSP



R. Dr. Cesário Mota Júnior, 424 - Vila Buarque, São Paulo - SP, 01221-020

GENERAL NOTES:/ NOTAS GERAIS:

1. FOR LEGEND, ABBREVIATIONS AND SYMBOL SEE SHEETS 7B-I-0-0-01.

PARA LEGENDA, ABREVIATURAS E SÍMBOLOS VEJA FOLHAS 7B-0-0-0-01.

2. FOR FIRE ALARM RISER DIAGRAM SEE SHEET 7B-I-0-7-02

2. FOR FIRE ALARIM RISER DIAGRAM SEE SHEET 7B-1-07-02
PARA DIAGRAMAS DE FIRE ALARM VER DES. № 7B-1-0-7-02
3. ALL INDICATION DEVICES ARE 75 CANDELAS UNLESS OTHERWISE NOTED.
TODOS OS DISPOSITIVOS DE INDICAÇÃO DE LUMINOSIDADE SÃO DE 75 CANDELAS, SALVO ONDE INDICADO.
4. ALL NOTIFICATION DEVICES ARE MOUNTED AT 2400 MM.

ALL NOTIFICATION DEVICES ARE MOUNTED AT 2400 MM.
 *TODOS OS DISPOSITIVOS DE NOTIFICAÇÃO SÃO MONTADOS A 2400 mm.* ALL MANUAL PULL STATIONS ARE MOUNTED AT 1400 MM.
 *TODAS AS BOTOEIRAS MANUAIS SÃO MONTADAS A 1400 mm.* ALL DETECTING DEVICES ARE MOUNTED IN THE CEILING.
 *TODOS OS DISPOSITIVOS DE DETECÇÃO SÃO MONTADOS NO TETO.* FACP AND FBAT\_ARE MOUNTED AT 1200 MM.

FACP E FBAT SÃO MONTADOS A 1200 mm.

8. SUPORTES TO CABLE TRAYS AND CONDUITS SHALL BE PROVIDE TO EACH 2,00 METERS.

SUPORTES P/ BANDEJAS, ELETROD. DEVEM SER MONTADOS A CADA 2m

9. ALL FIRE ALARM CONDUITS SHALL BE IDENTIFY RINGS EACH 3m IN RED COLLOR. EACH CONDUIT MUST HAVE ONE IDENTIFY.

TODOS OS ELETROD. DE ALARME DE INCÊNDIO DEVEM SER IDENTIFICADOS C/ ANÉIS A CADA 3m EM VERMELHO. CADA ELETROD.

10. MATERIAL LIST SEE DOCUMENT NUMBER PRD-AIC-TS-011

LISTA DE MATERIAIS VER DOCUMENTO №PRD-AIC-TS-011

11. TO DRAWING LIST SEE DOCUMENT 7B-I-0-0-01.

PARA LISTA DE DESENHOS, VER DOCUMENTO № 7B-I-0-0-01.

DEVE TER UMA IDENTIFICAÇÃO.

12. ALL TELECOMMUNICATION ETHERNET CABLING BY OWNER'S TELECOMMUNICATION CONTRACTOR.
TODOS OS CABEAMENTOS DE TELECOMUNICAÇÕES ETHERNET SERÃO PELA EMPREITEIRA DE TELECOMUNICAÇÕES.
13. ALL DIMENSIONS SHALL BE IN MILLIMETERS UNLESS NOTED OTHERWISE


TODAS DIMENSÕES EM MILÍMETROS, SALVO ONDE INDICADAS.

14. FOR FA DESIGN BASIS SEE DOCUMENT PRD-AIC-TSP-010.


PARA DESENHO "FA" CONSULTE O DOCUMENTO № PRD-AIC-TSP-010.


15. SYMBOL RAM IN RED BELONGS TO THE FIRE DAMPER (HVAC). THE BLUE RAM SYMBOL BELONGS TO THE EMERGENCY DOOR (ACS).

A RAM SÍMBOLO EM VERMELHO PERTENCE AO DAMPER DE INCÊNDIO (HVAC). E O SÍMBOLO RAM AZUL PERTENCE À PORTA DE EMERGÊNCIA

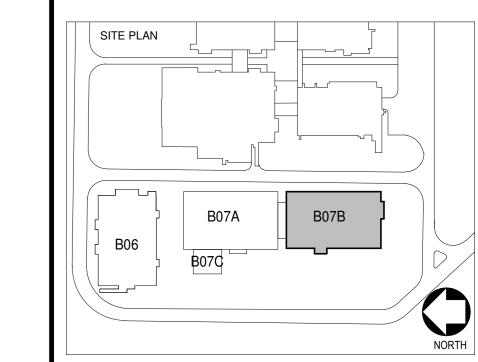

KEY P

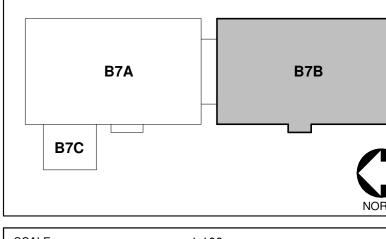



CONFIDENTIAL

THE INFORMATION CONTAINED HEREIN MAY NOT BE USED OR REPRODUCED IN ANY MANNER WITHOUT WRITTEN PERMISSION OF INTEGRATED PROJECT SERVICES.



BURITI EPCMV PROJECT

DRAWING TITLE

DRUG SUBSTANCE FIRE ALARM SYSTEMS WALKABLE CEILING FLOOR

DRAWN BY REVIEWED BY SCALE

JHA MSS SCALE

AS NOTED

7B-I-0-3-03