
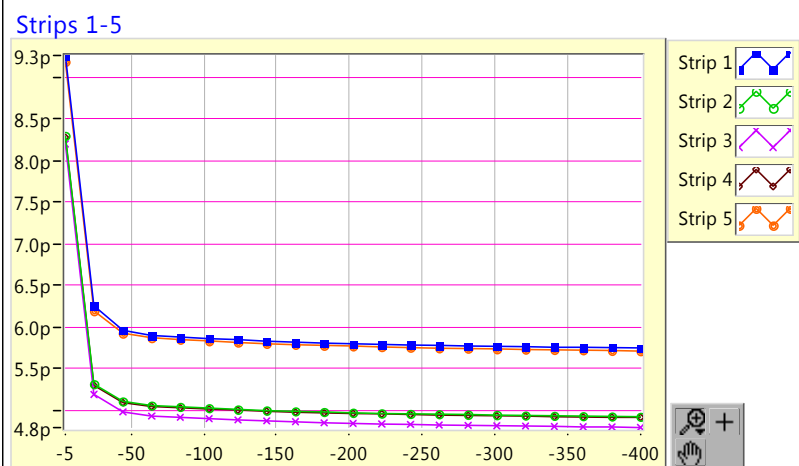


View_measurement.vi
C:\Users\root\Desktop\ProductionDB_040629_INP_modification_Oct_2015\Istrip-measurement\
View_measurement.vi
Last modified on 10/12/2015 at 3:49 PM
Printed on 11/24/2015 at 3:28 PM

CV 33305010000619

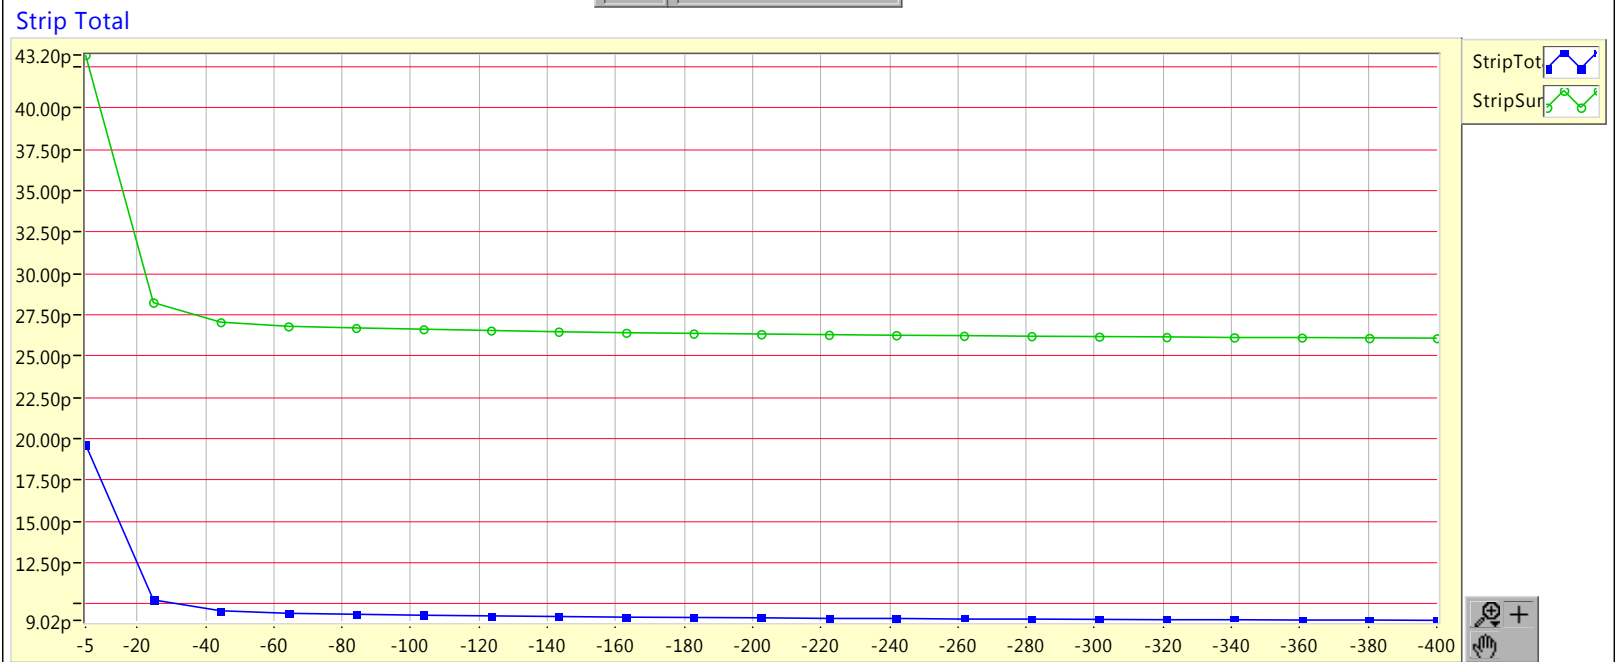

Output Array

0	-5.00E+0	9.26E-12
0	-2.48E+1	6.25E-12
0	-4.45E+1	5.96E-12