



(a) RTM 5-min LMP — PJM-RTO, 2024-07-08

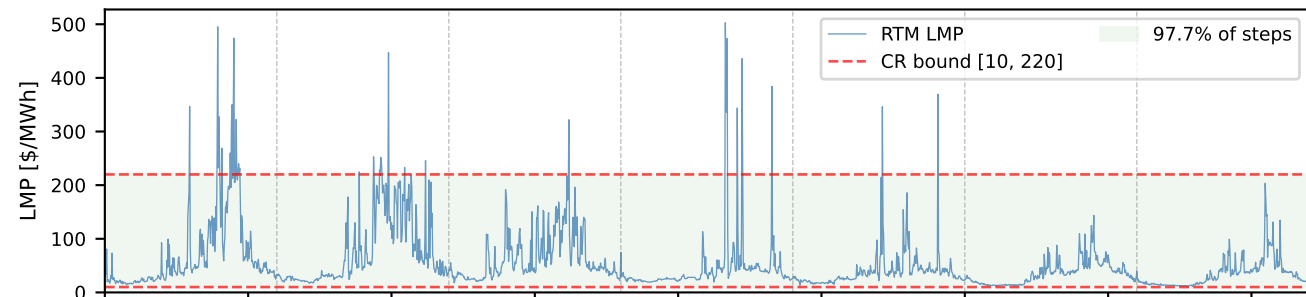

(b) Hourly DAM LMP

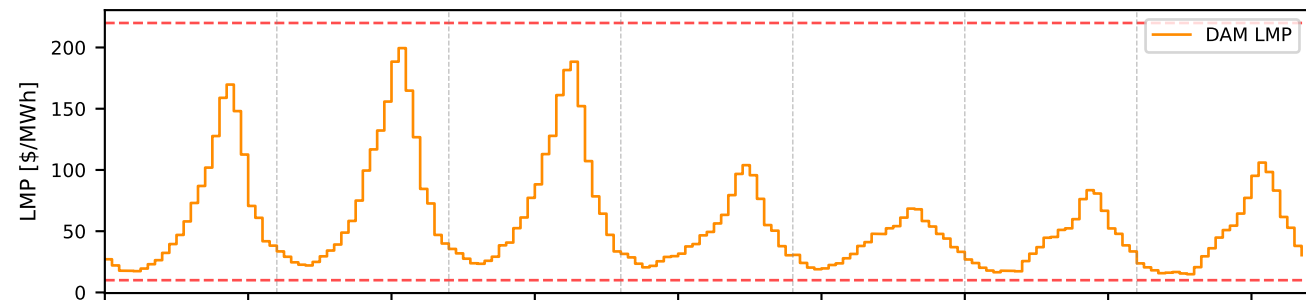

(c) 5-min PV Generation (1 MW capacity)

