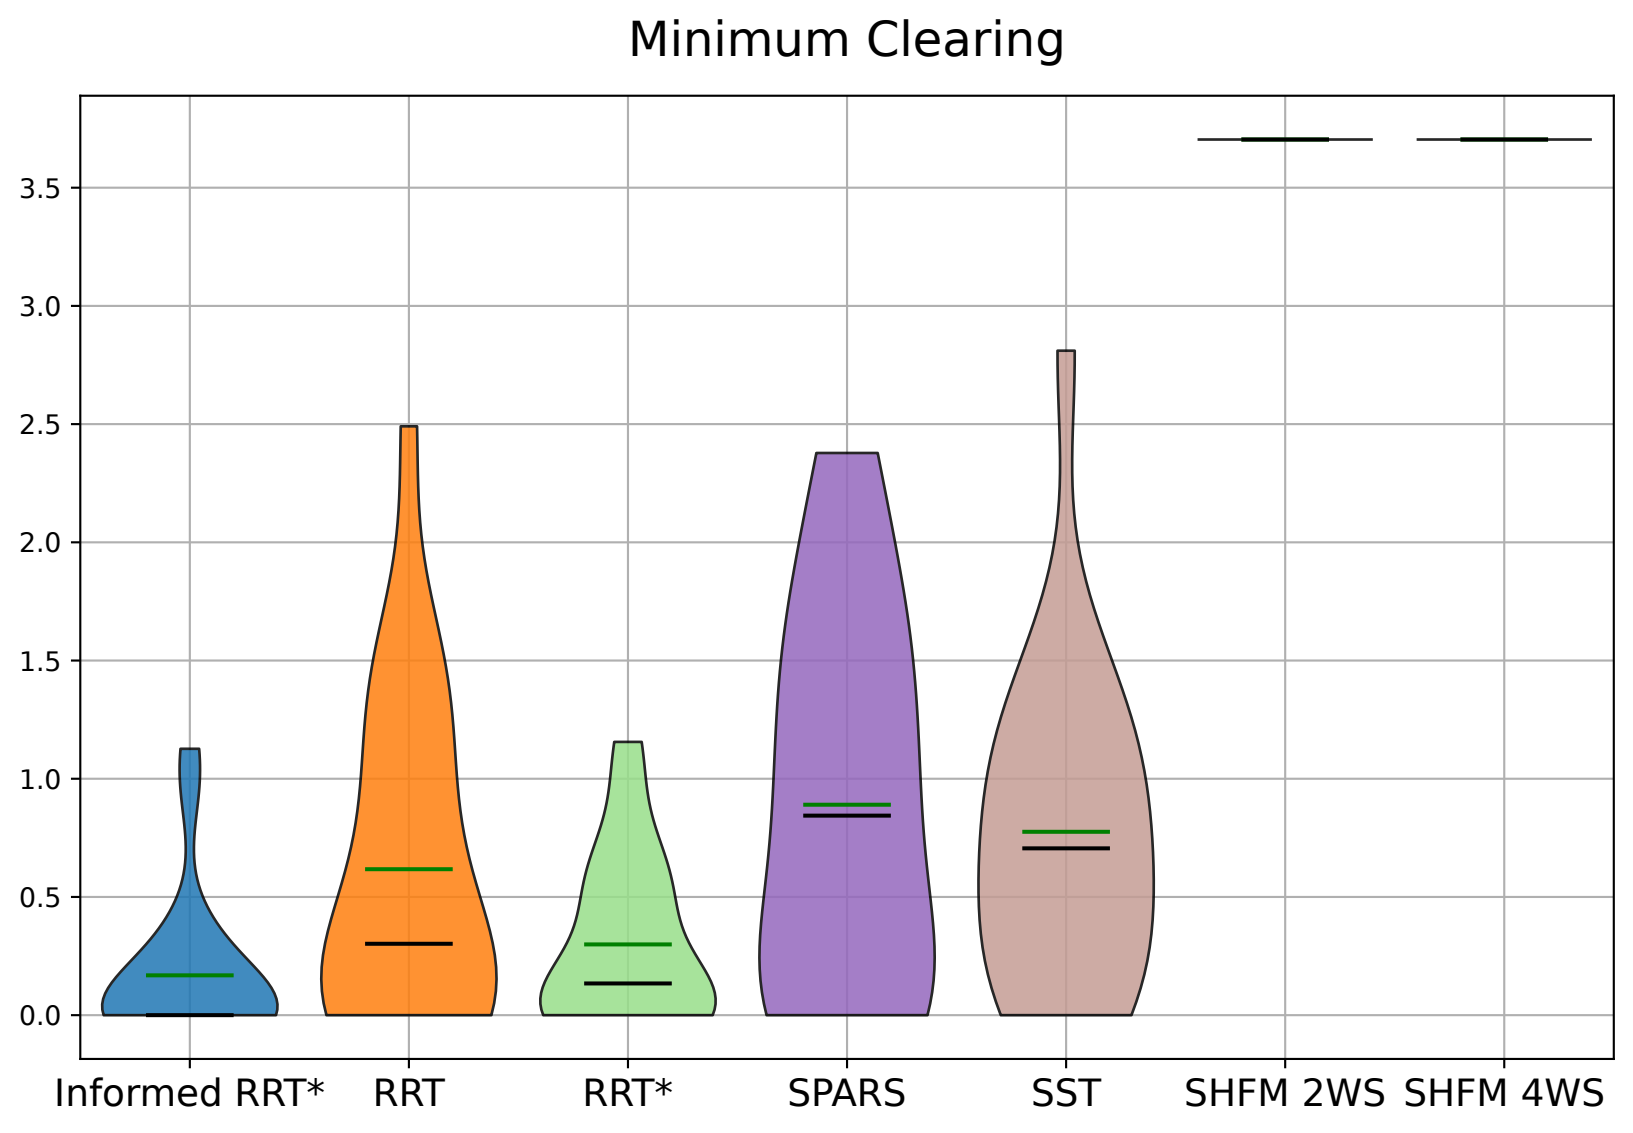
Minimum Clearing
3.5
3.0
2.5
2.0
1.5
1.0
0.5
0.0
Informed RRT*
RRT
RRT*
SPARS
SST
SHFM 2WS
SHFM 4WS