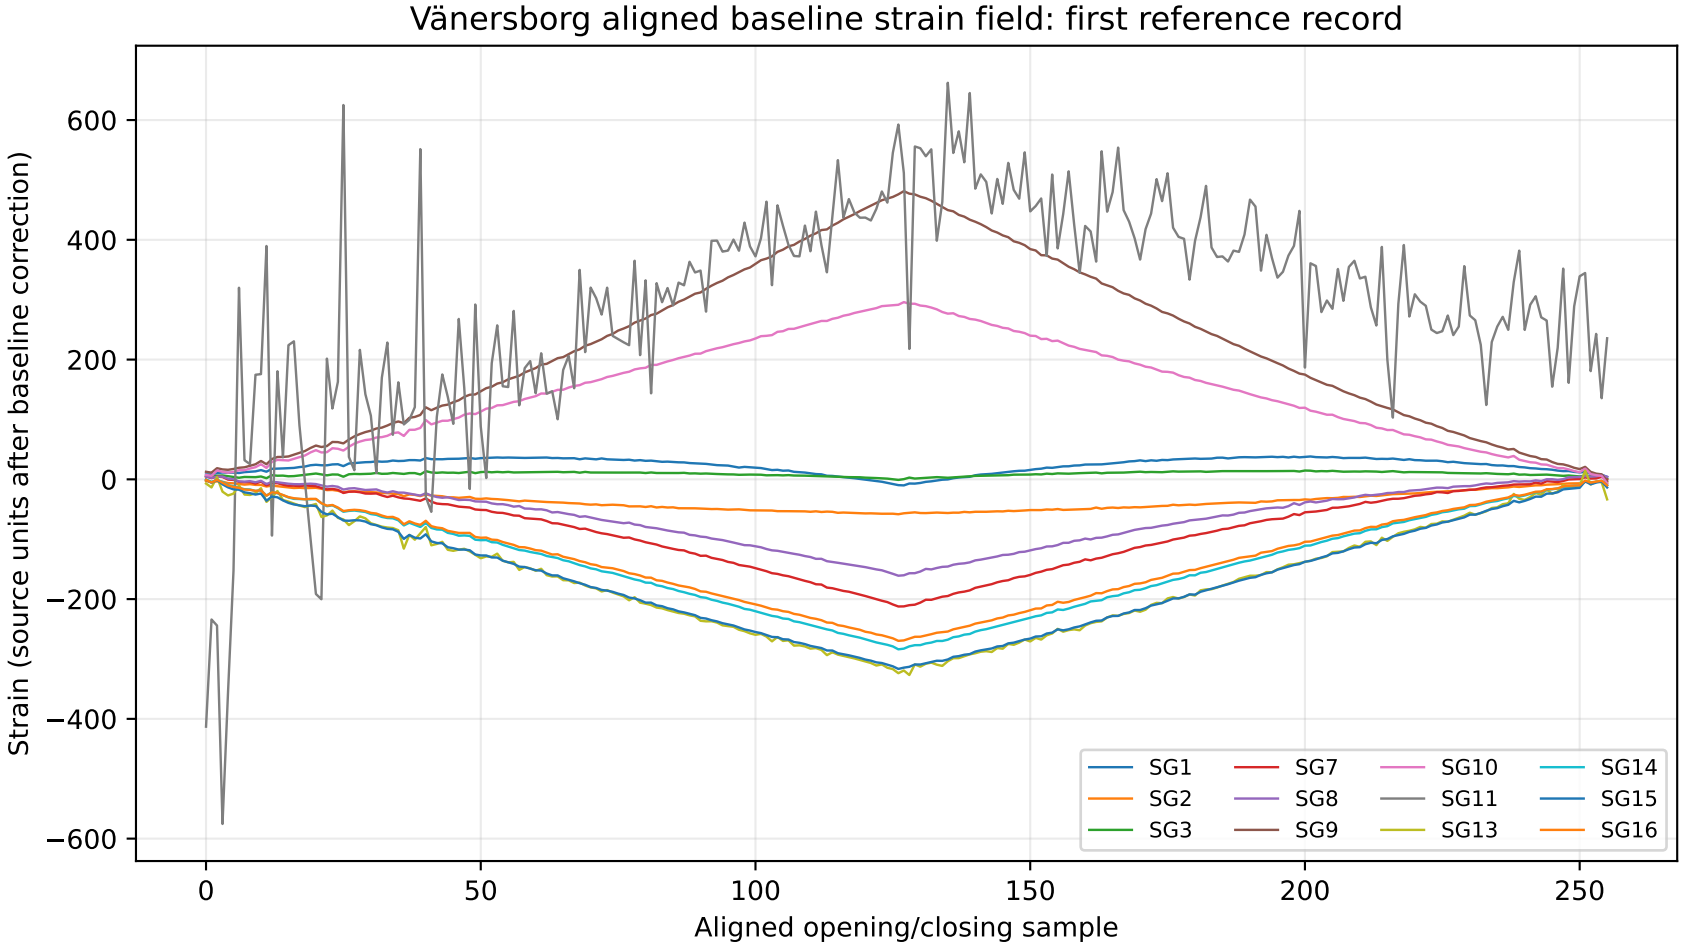
Vänersborg aligned baseline strain field: first reference record
Strain (source units after baseline correction)
Aligned opening/closing sample
600
400
200
0
−200
−400
−600
0
50
100
150
200
250
SG1
SG2
SG3
SG7
SG8
SG9
SG10
SG11
SG13
SG14
SG15
SG16