


**PDU Cabinet**

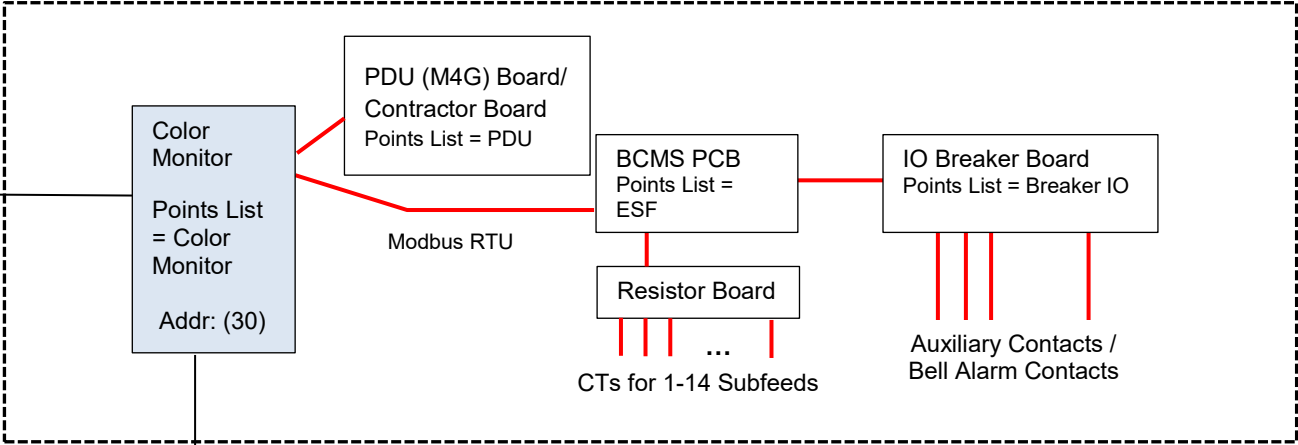

1 2 3  
Downstream Modbus addresses must be assigned to each device consecutively from 1.

30 31 32 33  
Monitor's Upstream Address (30) is added to each device's downstream address for upstream addressing.

**Monitor is secondary device on upstream Modbus segment.**

**Monitor is Modbus primary on its downstream Modbus segment.**

