




PDU's with 200-300 kVA transformers have 6.25" rear spacers.

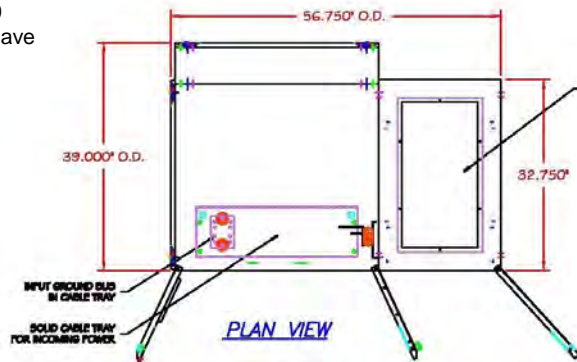

PDU's with subfeeds have solid cable trays above or below the subfeeds. Customers provide their own conduit or cable cut-outs.

NOTES:

1. OPERATOR INTERFACE PANEL.
2. 500AT MAIN INPUT BREAKER.
3. 6 (225A) SUBFEEDS.
4. INPUT CONNECTION LOCATION.
5. MINIMUM OF 36" CLEARANCE FOR DOOR SWING.
6. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
7. UNIT SHIPPED ASSEMBLED.
8. ESTIMATED SHIPPING WEIGHT 2680#.

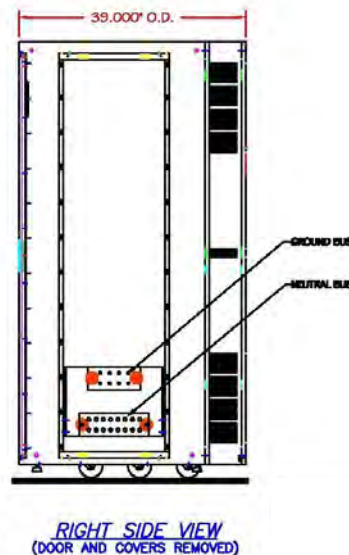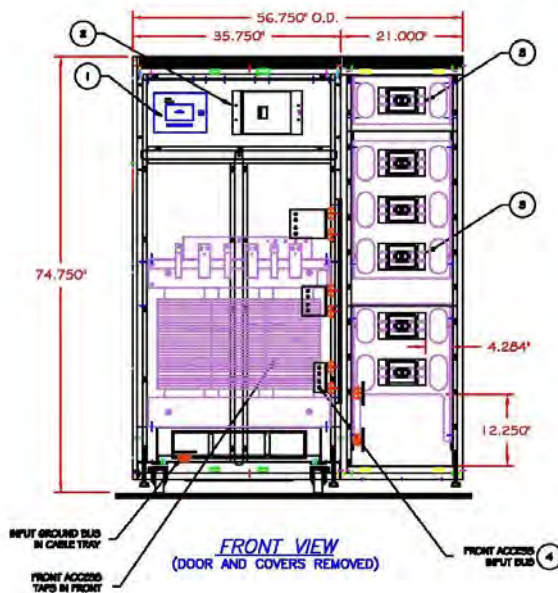

Side Cars can be installed on one or both sides of the Main Cabinet.

9" and 12" Side Cars are side-facing only.

21" Side Cars are both front- and side-facing and can be used as front-only.

Neutral and ground bus bar are installed in the Side Car for subfeed connections. Holes are 3/8" or 1/2" dia.