


(4) Building Alarms: NO Dry Contact Connections from Customer

Ribbon Cable to PDU M4G Board

Remote EPO Connection to PDU M4G Board

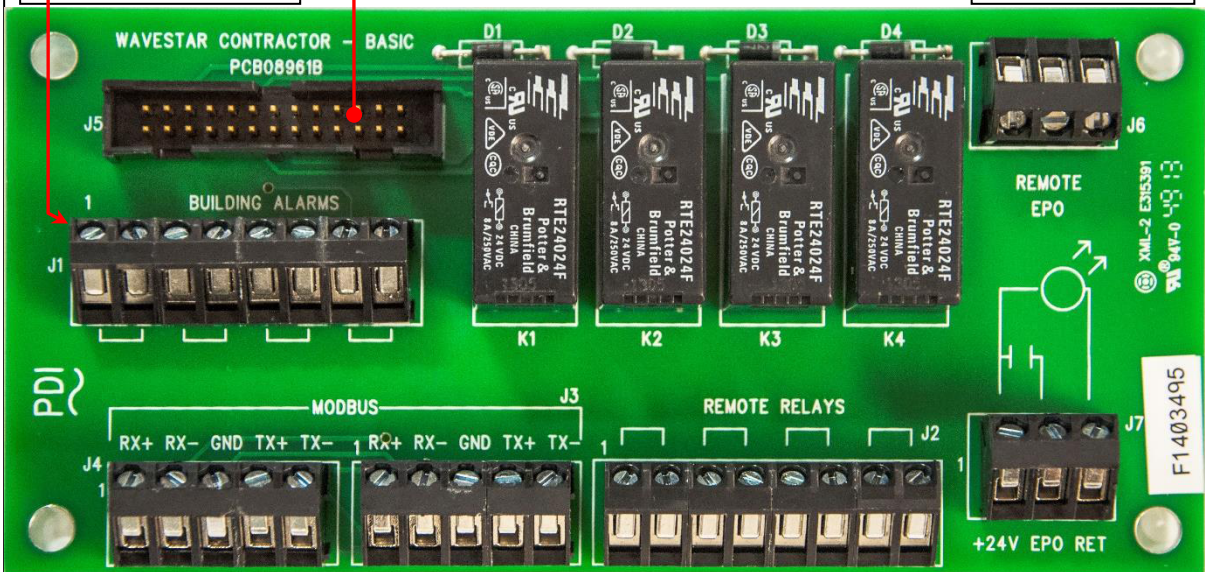

Modbus Upstream to Customer  
Modbus primary device

Modbus Downstream to Devices in Monitor Chain

(4) Remote Relays, NO Dry Contacts

Leftmost relay is triggered by PDU Summary Alarm by default.

Remote EPO NO Dry Contact Connection from Customer

Paralleled Connectors