


# REACTOR POWER PANEL AND BYPASS CABINET SINGLE LINE

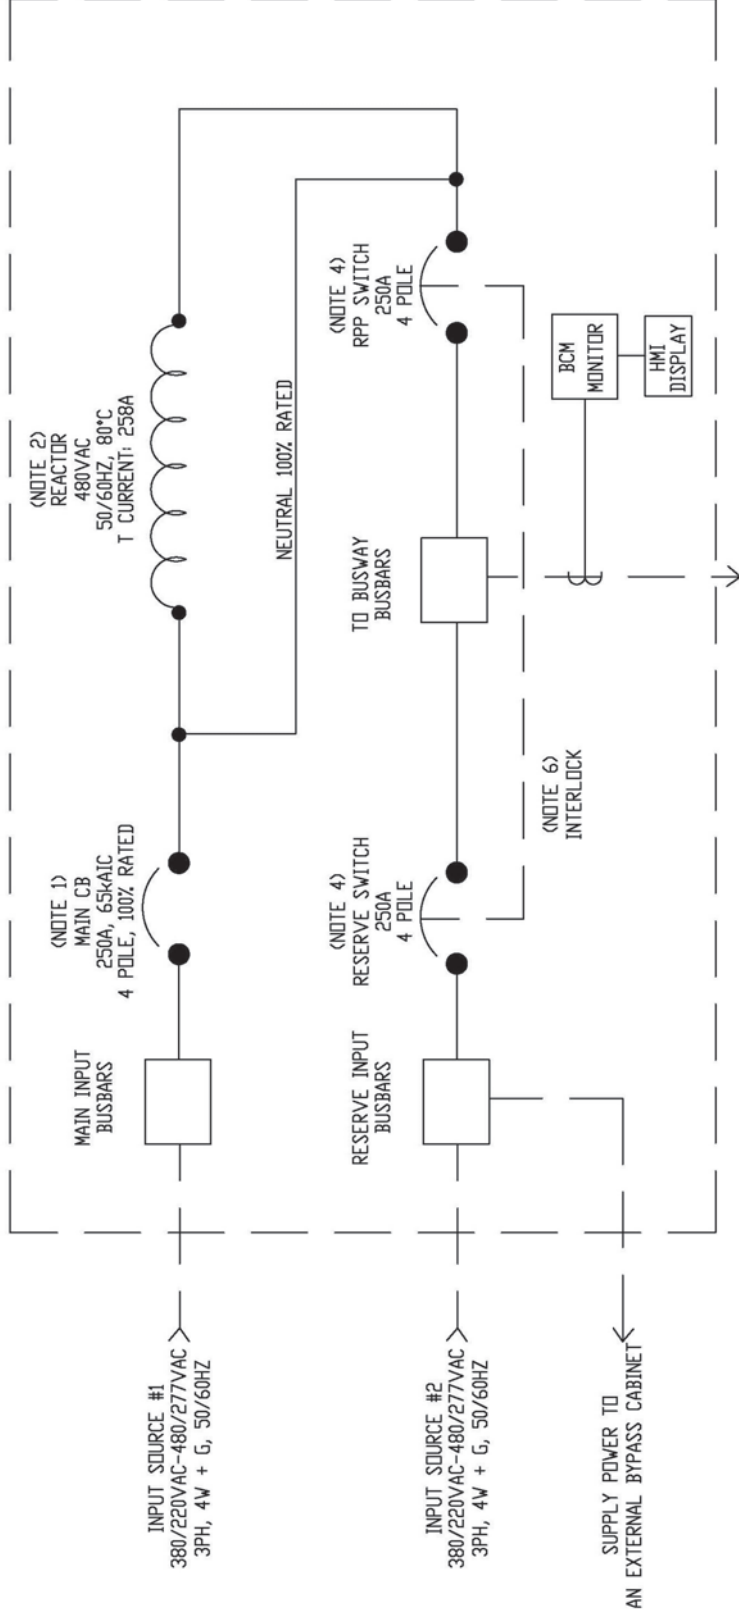

6. MECHANICAL TRANSFER BAR
5. MONITOR SYSTEM: SEE TABLE ON PAGE 1
4. RESERVE SWITCH AND RPP SWITCH: SEE TABLE ON PAGE 1
3. SWITCHBOARD CABINET STANDARD: UL 891 AND IEC 61439
2. HARMONIC FILTERING CURRENT LIMITING REACTOR -158  $\mu$ H +/-  
AIR CORE INDUCTANCE OF 73.5  $\mu$ H -3% +10%, TEMPERATURE RISE 80°C
1. MAIN CB: SEE TABLE ON PAGE 1

NOTES:

SIZE	DWG. NO.	REV
B	92-15200002	X7
SCALE: NTS	SHEET 4 OF 4	