


(4) Building Alarms: NO  
Dry Contact Connections  
from Customer

Ribbon Cable to PDU  
M4G Board

Remote EPO  
Connection to PDU  
M4G Board

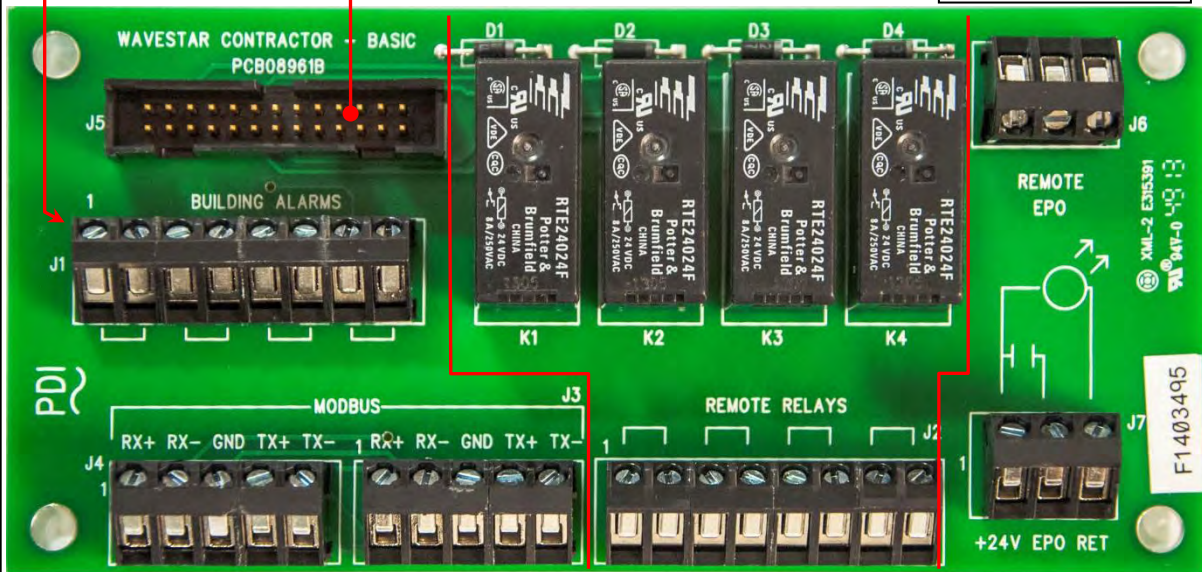

Modbus Upstream  
to Customer BMS

Modbus  
Downstream to  
Devices in Monitor  
Chain

(4) Remote Relays, NO Dry  
Contacts

Leftmost relay is triggered by  
PDU Summary Alarm by  
default.

Remote EPO NO Dry  
Contact Connection  
from Customer