


24VDC Power from
PDU M4G Board

REPO Signal to
PDU M4G Board

Modbus
Upstream

Modbus
Downstream

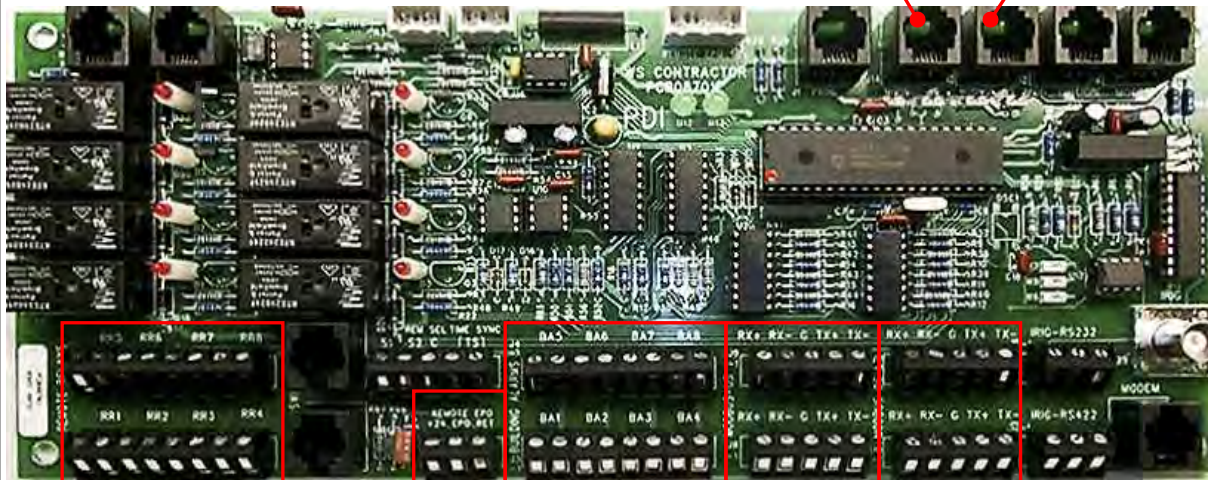

Outputs:
- Remote Relays
- RR1-RR8
- Dry contacts (NO)

Input:
- Remote EPO
Connection (Dry
contacts (NO))

Inputs:
-Building Alarms
BA1-BA8 (Dry
contacts (NO))

Modbus
Upstream:
paralleled
connectors
Outputs:

Modbus
Downstream:
paralleled
connectors

Customer Connections are all on this side of the Enhanced Contractor Board