


Top cable entry Input Section.

Swing out entire
Monitoring Section.
(See Figure 19.)

Ground busbar is
above Main Input
Circuit Breaker.

Connect phase
cables to top of
circuit breaker.

Cables to
transformer cables
are below Main
Input Circuit
Breaker.

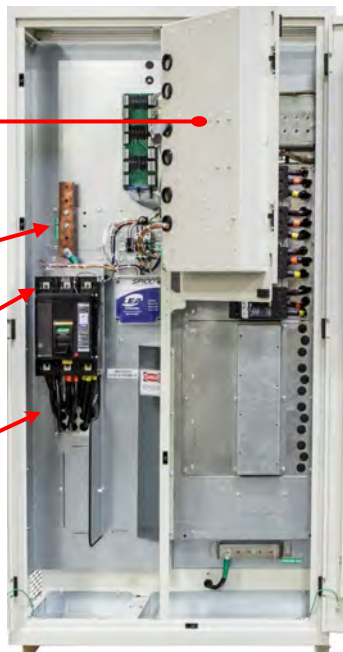

Wiring for the Input Breaker and position of the
ground busbar depends on choice of top or bottom
cable entry.

Customer should specify top or bottom cable entry
at the time of the order.

Bottom cable entry Input Section.

Cables to
transformer cables
are above Main Input
Circuit Breaker.

Connect phase
cables to bottom of
circuit breaker.

Ground busbar is
below Main Input
Circuit Breaker.



DO NOT USE
PDI CONNECTION ONLY

